



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**CAIRO (S/N 60346927)**  
Component  
**Starboard Genset**  
Fluid  
**CHEVRON DELO 400 MULTIGRADE 15W40 (6 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>MW0062581</b>	MW0062459	MW0047462
Sample Date		Client Info		<b>10 Apr 2024</b>	26 Mar 2024	20 Feb 2024
Machine Age	hrs	Client Info		<b>11900</b>	11649	11161
Oil Age	hrs	Client Info		<b>239</b>	204	204
Filter Age	hrs	Client Info		<b>239</b>	204	204
Oil Changed		Client Info		<b>Changed</b>	Changed	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>4</b>	7	7
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>14</b>	16	15
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>0</b>	2	2
Lead	ppm	ASTM D5185m	>17	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>70	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**

There is no indication of any contamination in the oil.


Silicon	ppm	ASTM D5185m	>25	<b>2</b>	4	4
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	4	4
Fuel	%	ASTM D3524	>4.0	<b>&lt;1.0</b>	▲ 3.3	▲ 3.1
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>8.8</b>	8.6	8.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>18.5</b>	18.3	17.9
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>2</b>	3	5
Boron	ppm	ASTM D5185m	151	<b>82</b>	98	80
Barium	ppm	ASTM D5185m	0.4	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	250	<b>29</b>	28	28
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	0	<b>765</b>	673	725
Calcium	ppm	ASTM D5185m	2046	<b>1705</b>	1436	1420
Phosphorus	ppm	ASTM D5185m	1043	<b>775</b>	652	734
Zinc	ppm	ASTM D5185m	943	<b>901</b>	760	848
Sulfur	ppm	ASTM D5185m	5012	<b>3784</b>	3015	3373
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>14.8</b>	14.8	14.1
Base Number (BN)	mg KOH/g	ASTM D2896	12.5	<b>7.7</b>	7.5	7.7
Visc @ 100°C	cSt	ASTM D445	14.4	<b>12.1</b>	▲ 12.2	▲ 12.3


**FT-IR (Direct Trend)**

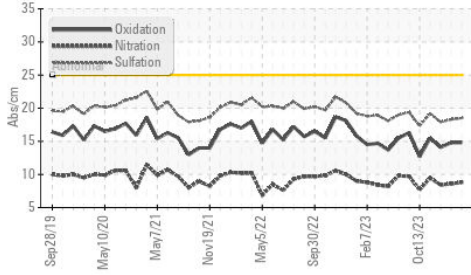


**Base Number**

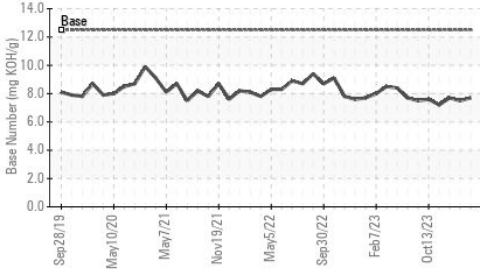


**Viscosity @ 100°C**

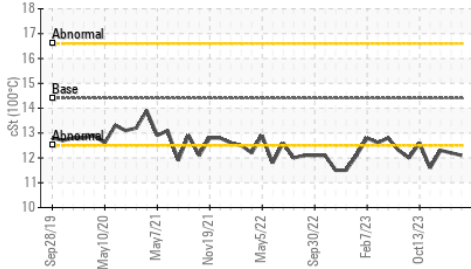


**Fuel Dilution**

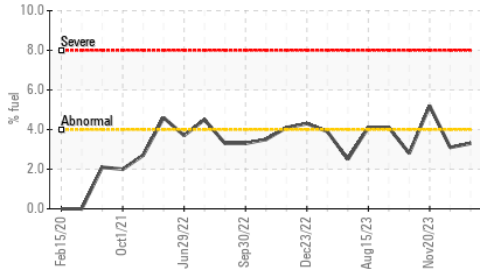


**Ferrous Alloys**

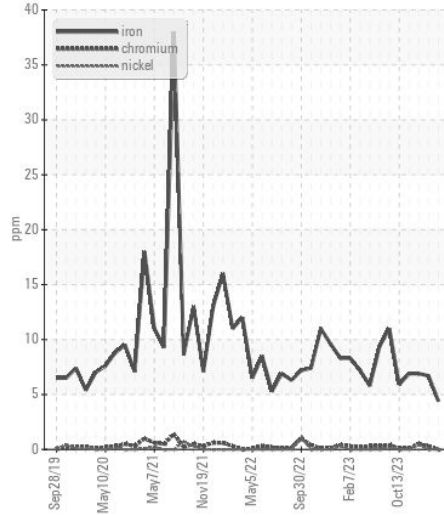


**Non-ferrous Metals**

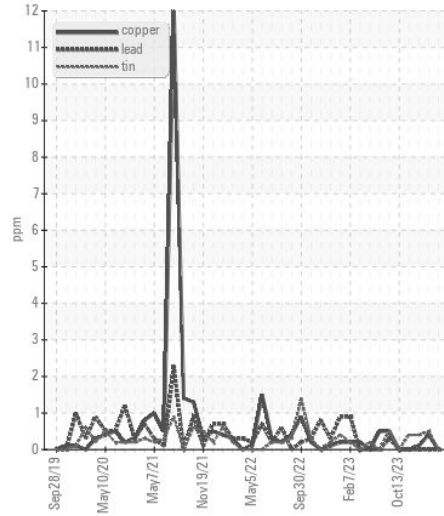

**Viscosity @ 100°C**

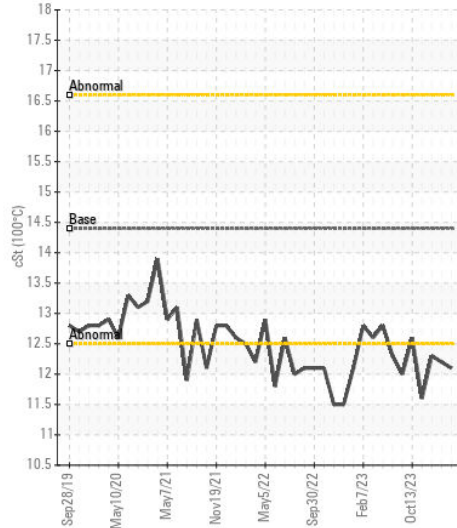

**Base Number**

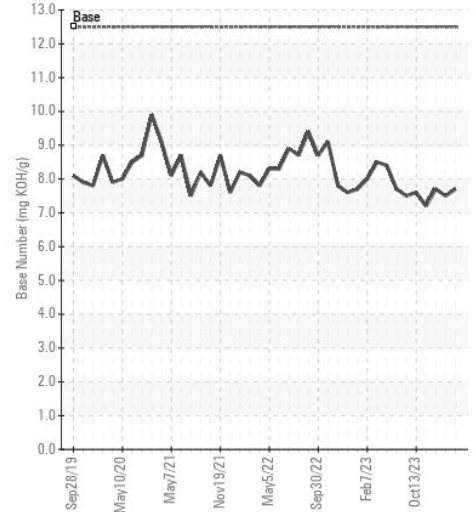

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : MW0062581

**Lab Number** : 06158728

**Unique Number** : 10994151

**Test Package** : MAR 2 ( Additional Tests: FUELDILUTION )

**Received** : 24 Apr 2024

**Tested** : 30 Apr 2024

**Diagnosed** : 30 Apr 2024 - Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**AMERICAN COMMERCIAL LINES**

PO BOX 610, 1701 E. MARKET STREET

JEFFERSONVILLE, IN

US 47130

Contact: RONALD SCHNEIDER

ronald.schneider@bargaeacbl.com

T:

F: (812)288-1644