



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
IZ/16WM
 Component
Gearbox
 Fluid
MOBIL MOBILGEAR SHC XMP 320 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0807521	WC0807379	WC0695193
Sample Date		Client Info		08 Feb 2024	06 Jul 2023	07 Jan 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		30384	25368	20773
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>200	17	11	13
Chromium	ppm	ASTM D5185m	>15	0	0	0
Nickel	ppm	ASTM D5185m	>15	0	1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	0
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>200	0	0	<1
Tin	ppm	ASTM D5185m	>25	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION











There is no indication of any contamination in the component. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>50	3	5	6
Potassium	ppm	ASTM D5185m	>20	0	2	<1
Water	%	ASTM D6304	>0.2	NEG	NEG	NEG
Particles >4µm		ASTM D7647	>20000	1531	9404	663
Particles >6µm		ASTM D7647	>5000	303	3086	115
Particles >14µm		ASTM D7647	>640	25	290	6
Particles >21µm		ASTM D7647	>160	8	70	2
Particles >38µm		ASTM D7647	>40	1	2	0
Particles >71µm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	18/15/12	20/19/15	17/14/10
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>15	0	0	<1
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		0	1	0
Calcium	ppm	ASTM D5185m	0	0	1	0
Phosphorus	ppm	ASTM D5185m	485	422	417	381
Zinc	ppm	ASTM D5185m	0	31	11	23
Sulfur	ppm	ASTM D5185m		5501	4514	4224
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	1.11	0.99	1.00
Visc @ 40°C	cSt	ASTM D445	335	344	346	345
Visc @ 100°C	cSt	ASTM D445	38.3	38.5	38.4	38.1
Viscosity Index (VI)	Scale	ASTM D2270	164	161	160	159

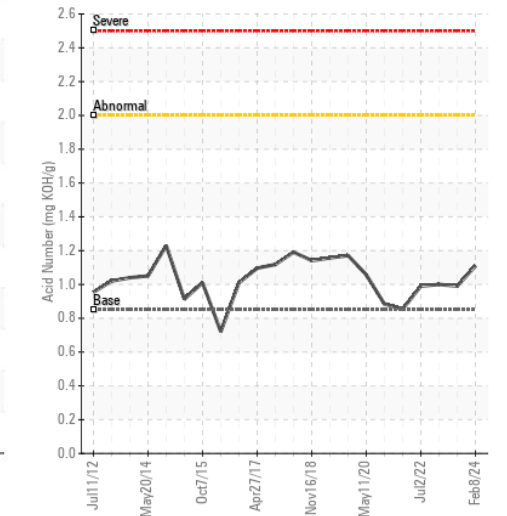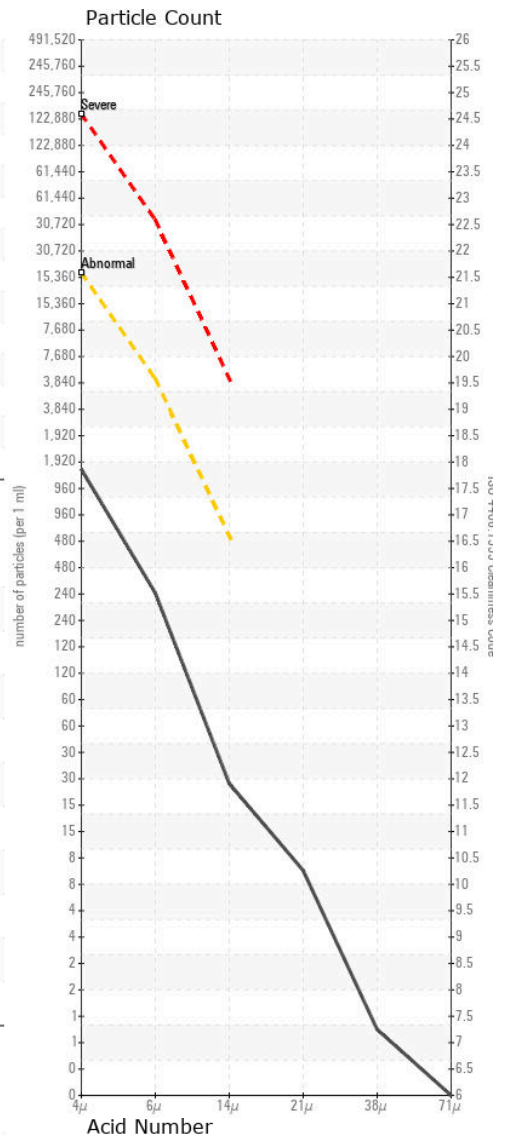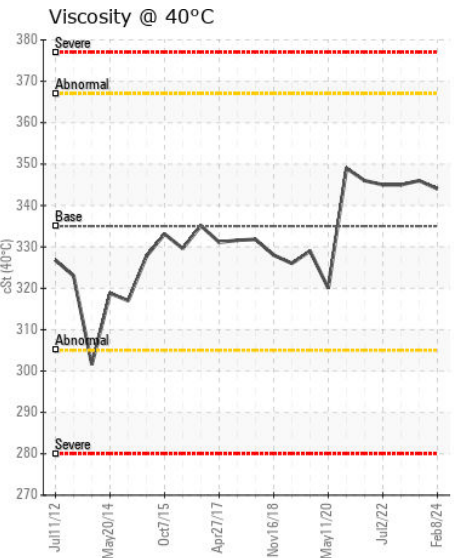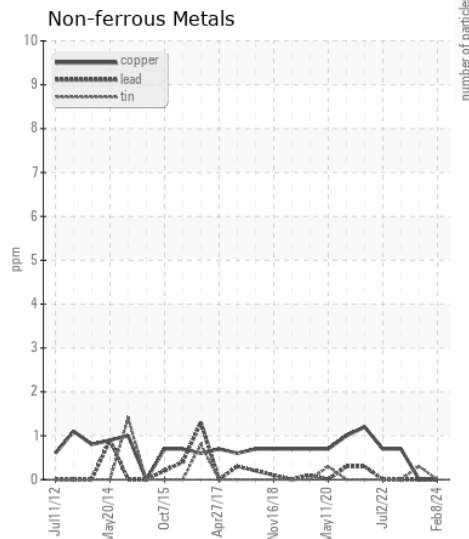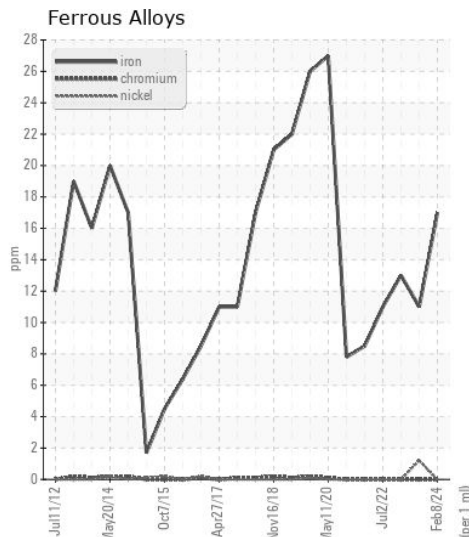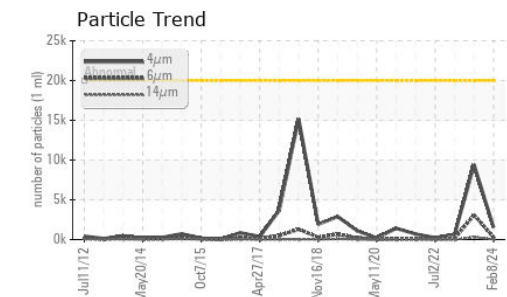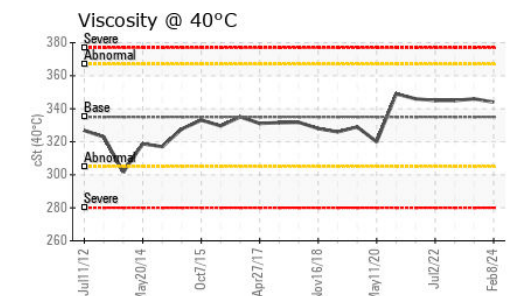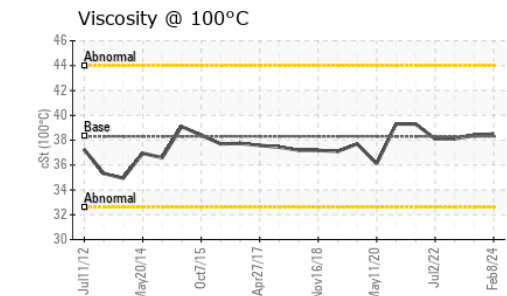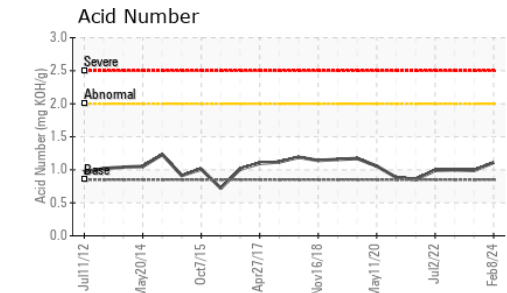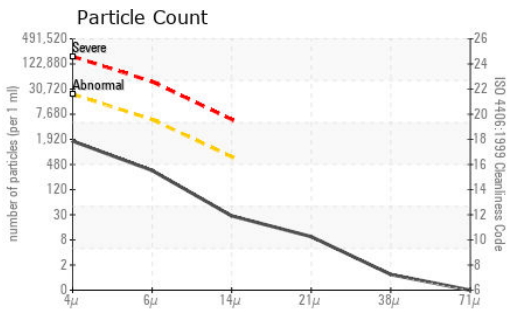

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0807521 **Received** : 24 Apr 2024
Lab Number : 06159088 **Tested** : 26 Apr 2024
Unique Number : 10994511 **Diagnosed** : 26 Apr 2024 - Jonathan Hester
Test Package : PLANT (Additional Tests: KV100, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

JPHYTEC

JP
 Contact: Service

T:
 F: