



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
IZ/9WM
Component
Gearbox
Fluid
MOBIL MOBILGEAR SHC XMP 320 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0807464	WC0807372	WC0695220
Sample Date		Client Info		21 Nov 2023	29 May 2023	16 Jan 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		28320	25200	21416
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>200	12	9	12
Chromium	ppm	ASTM D5185m	>15	0	0	0
Nickel	ppm	ASTM D5185m	>15	0	1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	0
Lead	ppm	ASTM D5185m	>100	0	<1	0
Copper	ppm	ASTM D5185m	>200	1	<1	3
Tin	ppm	ASTM D5185m	>25	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION











There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>50	8	10	10
Potassium	ppm	ASTM D5185m	>20	0	2	<1
Water	%	ASTM D6304	>0.2	NEG	NEG	NEG
Particles >4µm		ASTM D7647	>20000	5252	543	1714
Particles >6µm		ASTM D7647	>5000	1325	183	323
Particles >14µm		ASTM D7647	>640	137	16	16
Particles >21µm		ASTM D7647	>160	42	6	3
Particles >38µm		ASTM D7647	>40	2	0	1
Particles >71µm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	20/18/14	16/15/11	18/16/11
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>15	0	0	<1
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		<1	2	<1
Calcium	ppm	ASTM D5185m	0	0	1	0
Phosphorus	ppm	ASTM D5185m	485	448	453	427
Zinc	ppm	ASTM D5185m	0	25	5	29
Sulfur	ppm	ASTM D5185m		5572	4591	4359
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	1.30	1.14	1.14
Visc @ 40°C	cSt	ASTM D445	335	338	344	338
Visc @ 100°C	cSt	ASTM D445	38.3	37.9	37.7	37.6
Viscosity Index (VI)	Scale	ASTM D2270	164	161	158	160

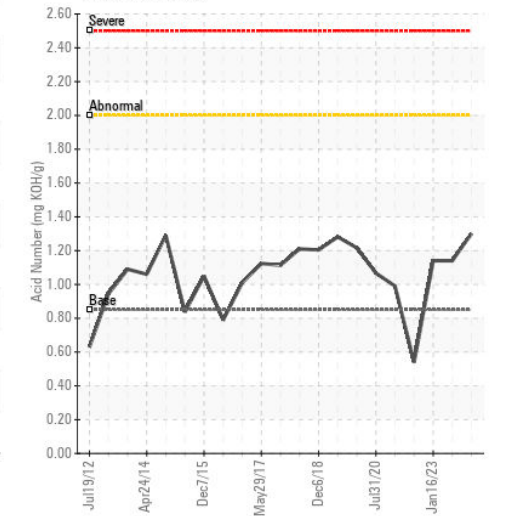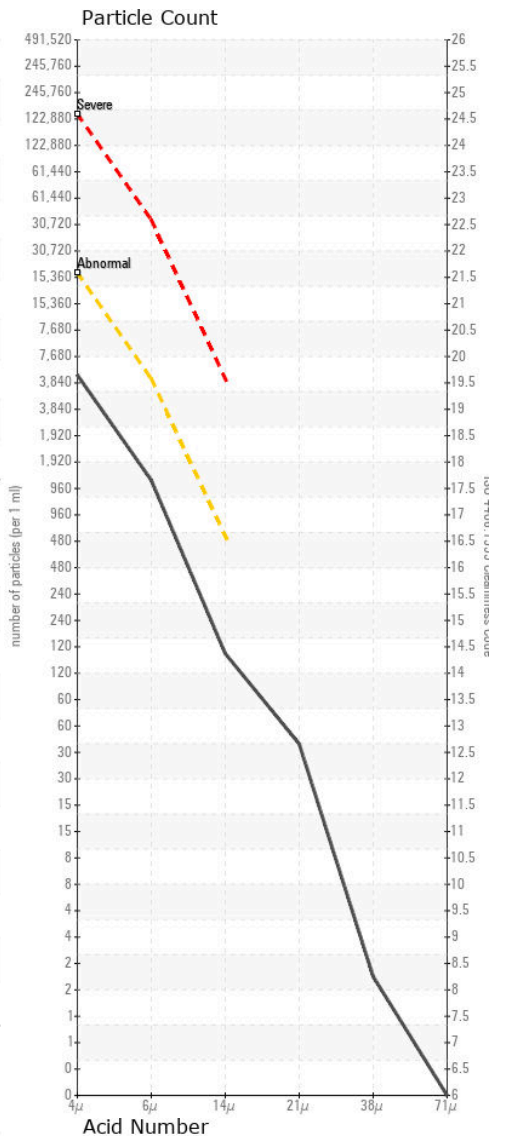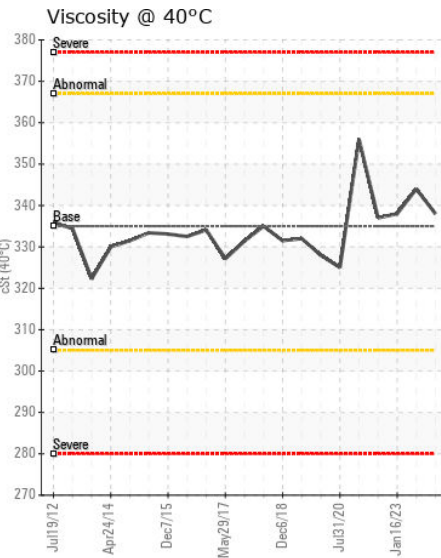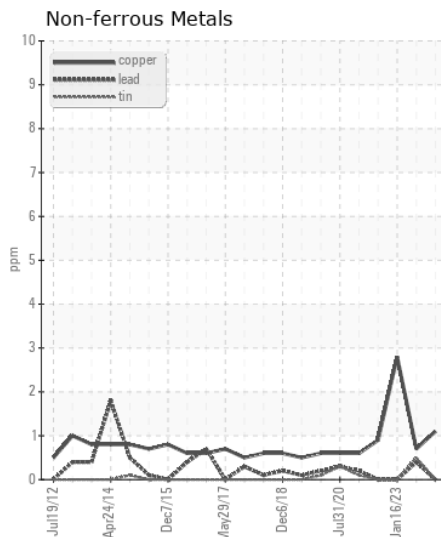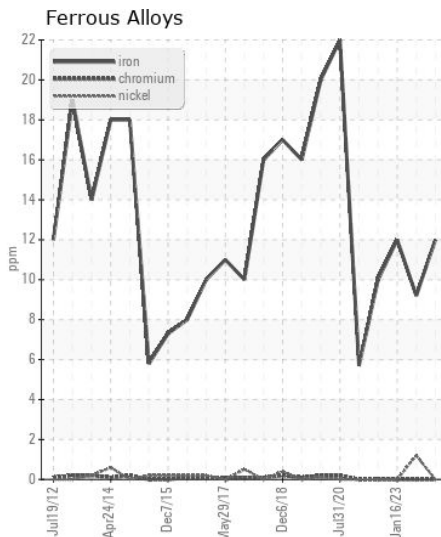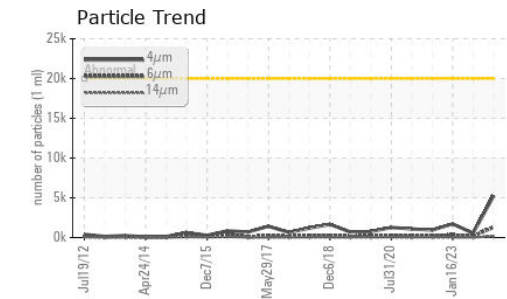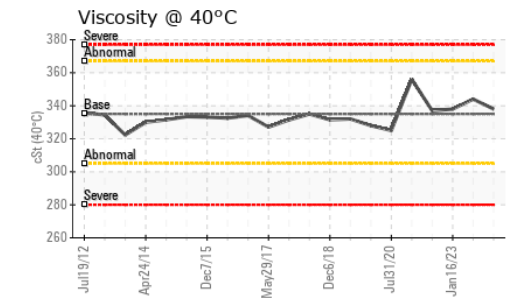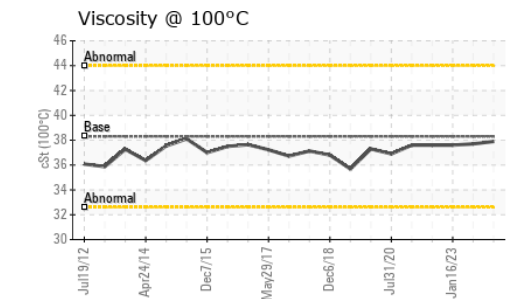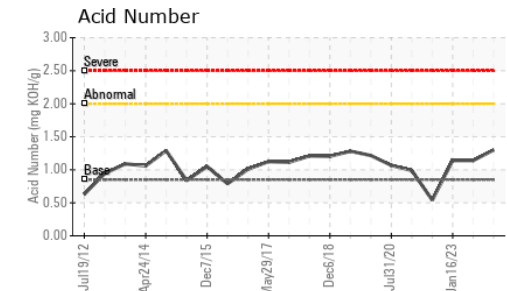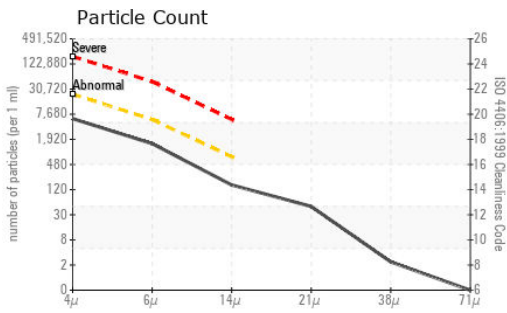

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0807464 **Received** : 24 Apr 2024
Lab Number : 06159098 **Tested** : 26 Apr 2024
Unique Number : 10994521 **Diagnosed** : 26 Apr 2024 - Jonathan Hester
Test Package : PLANT (Additional Tests: KV100, VI)

JPHYTEC

JP
 Contact: Service

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: