



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
ATLAS COPCO 050116
 Component
Compressor
 Fluid
ATLAS COPCO PAROIL S (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.











CONTAMINATION

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TO50002097	---	---
Sample Date		Client Info		19 Apr 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				ABNORMAL	---	---
Iron	ppm	ASTM D5185m	>50	4	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>15	0	---	---
Lead	ppm	ASTM D5185m	>65	0	---	---
Copper	ppm	ASTM D5185m	>65	0	---	---
Tin	ppm	ASTM D5185m	>10	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Silicon	ppm	ASTM D5185m	>35	<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304	>0.1	0.005	---	---
ppm Water	ppm	ASTM D6304	>1000	58	---	---
Particles >4µm		ASTM D7647	>10000	▲ 49368	---	---
Particles >6µm		ASTM D7647	>2500	● 3822	---	---
Particles >14µm		ASTM D7647	>320	38	---	---
Particles >21µm		ASTM D7647	>80	9	---	---
Particles >38µm		ASTM D7647	>20	0	---	---
Particles >71µm		ASTM D7647	>4	0	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 23/19/12	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Sodium	ppm	ASTM D5185m		3	---	---
Boron	ppm	ASTM D5185m	0	0	---	---
Barium	ppm	ASTM D5185m	0	<1	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m	0	0	---	---
Magnesium	ppm	ASTM D5185m	0	1	---	---
Calcium	ppm	ASTM D5185m	0	84	---	---
Phosphorus	ppm	ASTM D5185m	100	202	---	---
Zinc	ppm	ASTM D5185m	0	240	---	---
Sulfur	ppm	ASTM D5185m	200	569	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.38	---	---
Visc @ 40°C	cSt	ASTM D445	46.0	46.6	---	---
Visc @ 100°C	cSt	ASTM D445	7.3	7.4	---	---
Viscosity Index (VI)	Scale	ASTM D2270	133	121	---	---

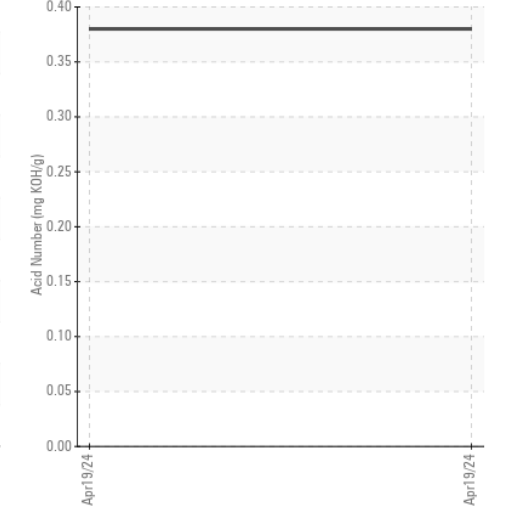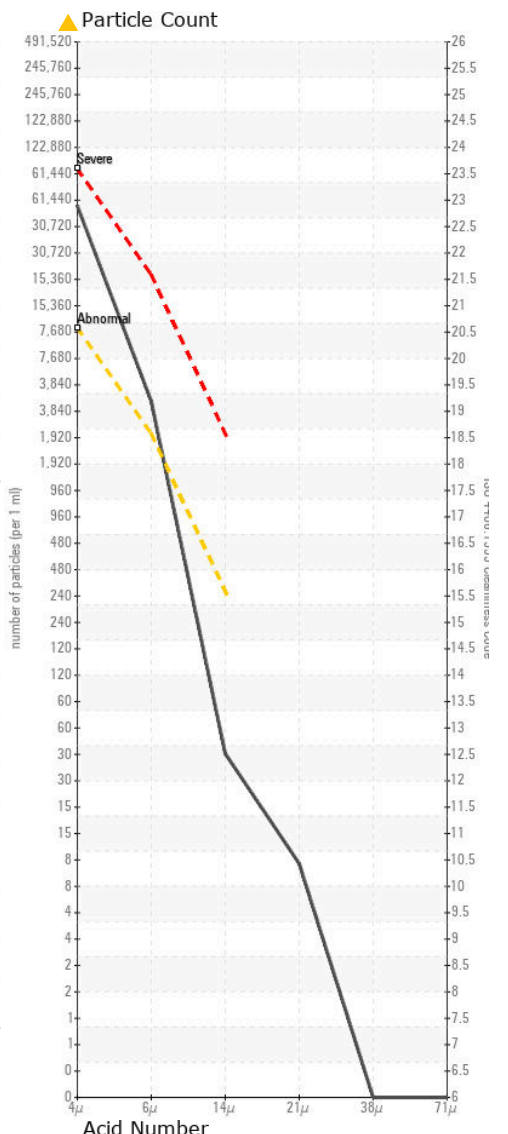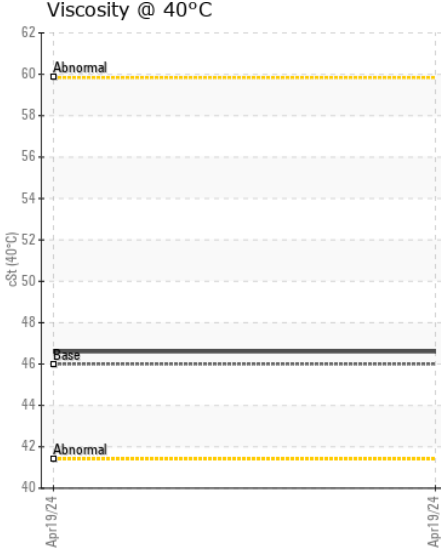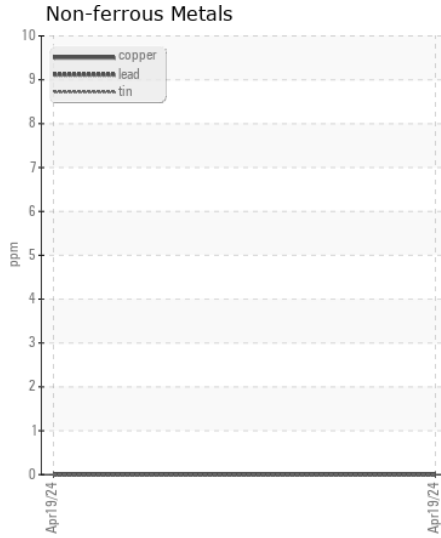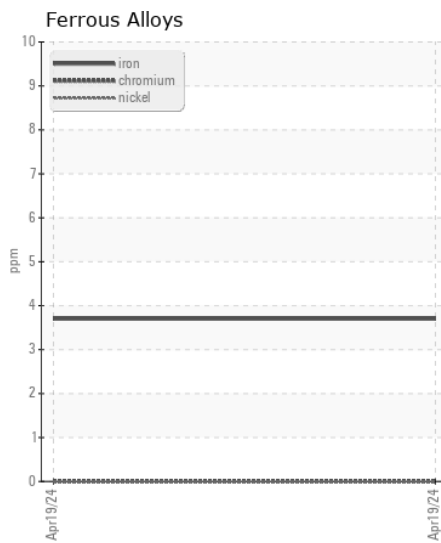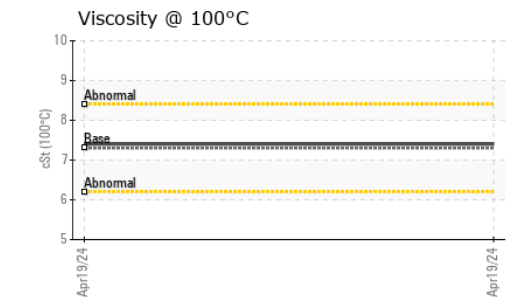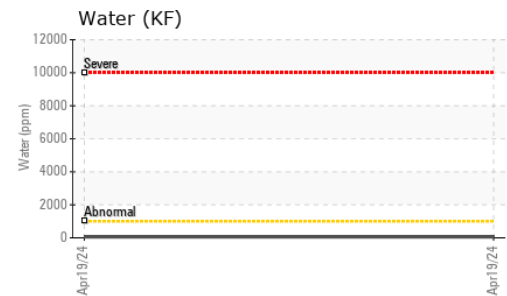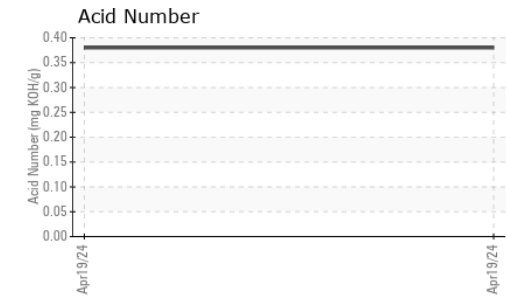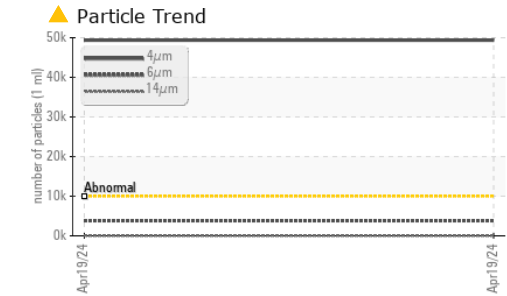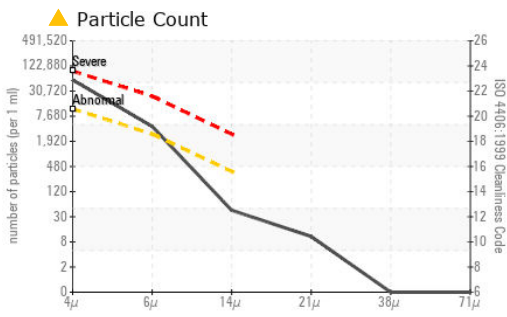

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO50002097 **Received** : 24 Apr 2024
Lab Number : 06159115 **Tested** : 25 Apr 2024
Unique Number : 10994538 **Diagnosed** : 26 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

US SHORING
 11070 SOUTH PIPELINE RD
 EULESS, TX
 US 76040
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)