

ATLAS COPCO 254031H - LONESTAR PACKAGING Component Compressor Fluid QUINCY QUINSYN (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	V		7			7.			•																					
	V	Ľ		Ξ	1	f	١.	F	1																					
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

All component wear rates are normal.


CONTAMINATION

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

F 1 1 1		TION
FLUI	וטאכ	TION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TO50001851	QUC0000567	
Sample Date		Client Info		16 Apr 2024	11 Oct 2023	
Machine Age	hrs	Client Info		8432	6914	
Oil Age	hrs	Client Info		0	0	
Filter Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	Not Changd	
Filter Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ATTENTION	
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>5	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>15	<1	<1	
Lead	ppm	ASTM D5185m	>65	0	0	
Copper	ppm	ASTM D5185m	>65	<1	<1	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Silicon	nom	ASTM D5185m	>35	<1	<1	
Potassium	ppm ppm	ASTM D5185m	>20	<1	1	
Water	%	ASTM D5185III	>0.1	0.013	0.003	
		ASTM D6304 ASTM D6304	>1000	133	32.6	
ppm Water Particles >4µm	ppm	ASTM D0304 ASTM D7647	>1000	22678	13497	
Particles >4µm		ASTM D7647 ASTM D7647	>2500	4179	3864	
Particles >14µm		ASTM D7647 ASTM D7647	>320	182	320	
Particles >21µm		ASTM D7647	>80	51	105	
Particles >38µm		ASTM D7647	>20	4	5	
Particles >71µm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>20/18/15	A 22/19/15	21/19/15	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	LIGHT	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	
Sodium	ppm	ASTM D5185m		2	1	
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m		0	0	
Calcium	ppm	ASTM D5185m		0	1	
Phosphorus	ppm	ASTM D5185m		135	106	
Zinc	ppm	ASTM D5185m		85	65	
Sulfur	ppm	ASTM D5185m		1014	1101	
Acid Number (AN)	mg KOH/g	ASTM D8045	.10	0.30	0.29	
Visc @ 40°C	cSt	ASTM D445	44.6	45.8	45.5	
Visc @ 100°C	cSt	ASTM D445	7.8	7.8	7.9	
Viscosity Index (VI)	Scale	ASTM D2270	132	139	145	

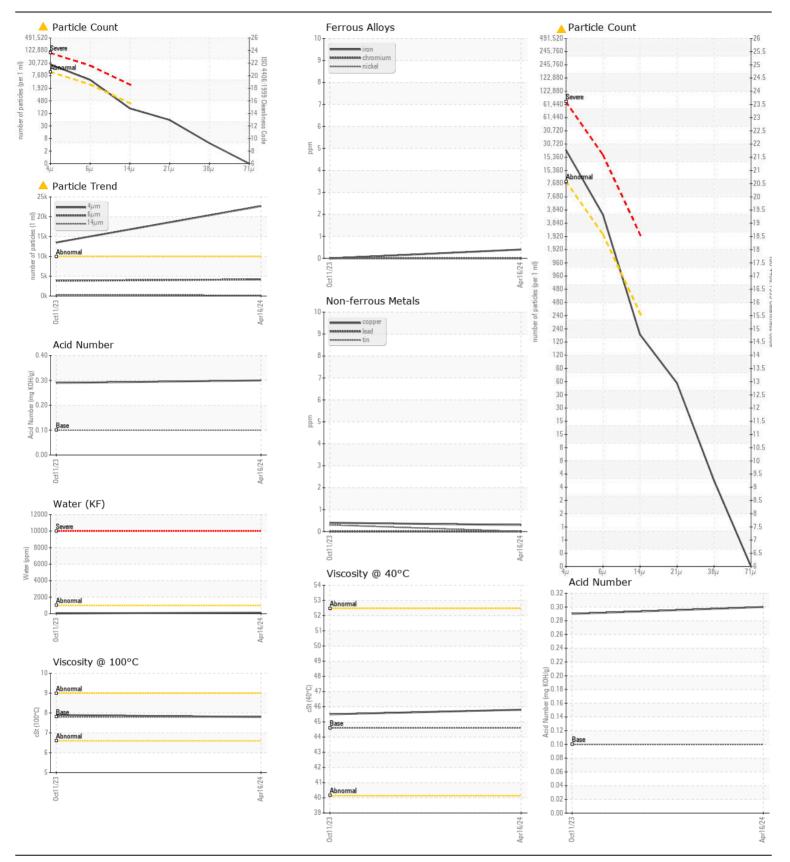

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 QUALITY COMPRESSOR Sample No. : TO50001851 Received : 25 Apr 2024 4428 CR 616 Lab Number : 06160344 ALVARADO, TX Tested : 26 Apr 2024 : 27 Apr 2024 - Don Baldridge US 76009 Unique Number : 10995767 Diagnosed Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI) Contact: SEAN Certificate L2367 SEAN@QCOMPRESSOR.COM To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (817)822-1333 F: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: SEAN ? - QUAALV Page 2 of 2