

[DUNN] Machine Id ONAN F190595926 Component Genset Fluid DIESEL ENGINE OIL SAE 40 (--- GAL)

DILGLE LINGINE OIL GAL 40 (GAL)							
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
	Sample Number		Client Info		VPA053611		
No corrective action is recommended at this time. Resample at the next service interval to monitor.	Sample Date		Client Info		23 Apr 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
WEAR	Iron		ASTM D5185m		<1		
WEAN	Chromium	ppm	ASTM D5185m		0		
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m	>2			
	Silver	ppm		. E	<1		
	Aluminum	ppm	ASTM D5185m		0		
	Lead	ppm	ASTM D5185m ASTM D5185m		<1 0		
		ppm	ASTM D5185m ASTM D5185m		0		
	Copper Tin	ppm	ASTM D5185m				
	Vanadium	ppm	ASTM D5185m	>10	<1 0		
	White Metal	ppm	*Visual	NONE	NONE		
		scalar		NONE			
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	6		
	Potassium	ppm	ASTM D5185m	>20	<1		
There is no indication of any contamination in the oil.	Fuel		WC Method	>4.0	<1.0		
	Water		WC Method	>0.1	NEG		
	Glycol		WC Method		NEG		
	Soot %	%	*ASTM D7844		0.1		
	Nitration	Abs/cm	*ASTM D7624	>20	4.9		
	Sulfation	Abs/.1mm	*ASTM D7415	>30	17.2		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m	>216	0		
	Boron	ppm	ASTM D5185m	-	15		
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.	Barium	ppm	ASTM D5185m	10	0		
	Molybdenum	ppm	ASTM D5185m		58		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m	450	920		
	Calcium	ppm	ASTM D5185m		1062		
	Phosphorus	ppm	ASTM D5185m		991		
	Zinc	ppm	ASTM D5185m		1143		
	Sulfur	ppm	ASTM D5185m		3478		
	Outstation	Also / door		05	10.0		

Oxidation

Visc @ 100°C cSt

13.0


9.0

12.91

Abs/.1mm *ASTM D7414 >25

ASTM D445 14.4

Base Number (BN) mg KOH/g ASTM D2896 8.5

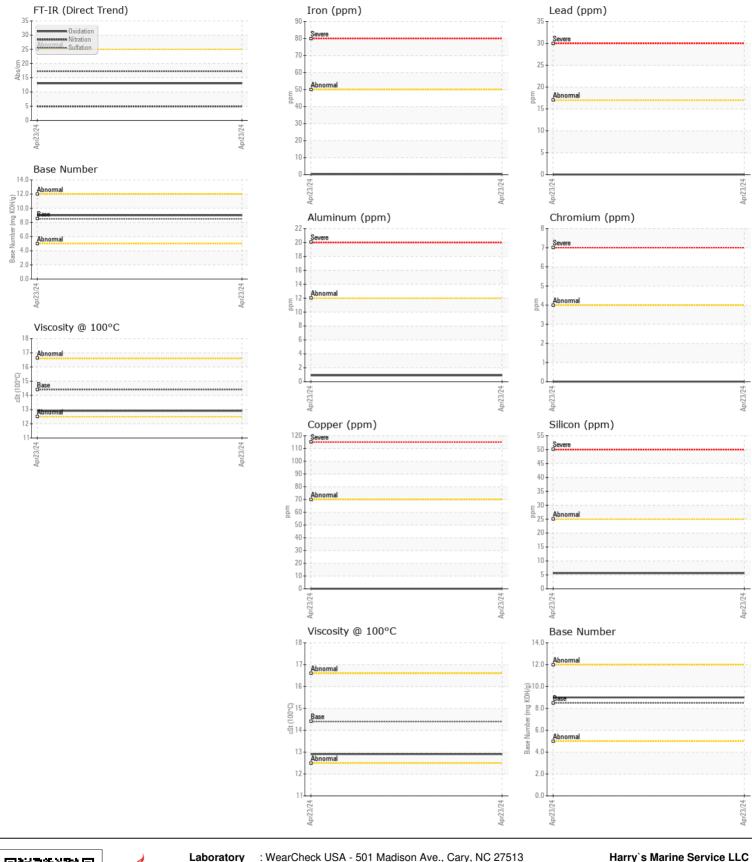

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Harry's Marine Service LLC Sample No. : VPA053611 Received 1141 N. Citrus St. : 25 Apr 2024 Lab Number : 06160919 Tested Orange, CA : 25 Apr 2024 Unique Number : 10996342 Diagnosed : 25 Apr 2024 - Sean Felton US 92887 Test Package : MOB 1 (Additional Tests: TBN) Contact: TARAH AULD Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. info@harrysmarine.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (714)771-7899 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F:

Contact/Location: TARAH AULD - VP867279 Page 2 of 2