

# COMP B - MIDSOUTH (S/N STNU140900159)

## Refrigeration Compressor

{not provided} (--- GAL)

### RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

#### **WEAR**

All component wear rates are normal.

#### **CONTAMINATION**

There is a trace of moisture present in the oil. Elemental level of silicon (Si) above normal indicating ingress of dirt/seal material.

## FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0910529		
Sample Date		Client Info		18 Apr 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Filter Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Filter Changed		Client Info		N/A		
Sample Status				ABNORMAL		
Iron	ppm	ASTM D5185m	>8	0		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>3	0		
Lead	ppm	ASTM D5185m	>2	0		
Copper	ppm	ASTM D5185m	>8	<1		
Tin	ppm	ASTM D5185m	>4	0		
Vanadium	ppm	ASTM D5185m		0		
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Silicon	ppm	ASTM D5185m	>15	<b>3</b> 1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D5103III	>0.01	0.016		
ppm Water	ppm	ASTM D6304	>100	▲ 166		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.01	NEG		
	Scalai	visuai	20.01			
Sodium	ppm	ASTM D5185m		<1		
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		108		
Acid Number (AN)	mg KOH/g	ASTM D974		0.013		
Vier @ 4000	. 01			A 00.0		


Visc @ 40°C

cSt

ASTM D445

Contact/Location: JACK BLURTON - MCQHAR

**29.8** 

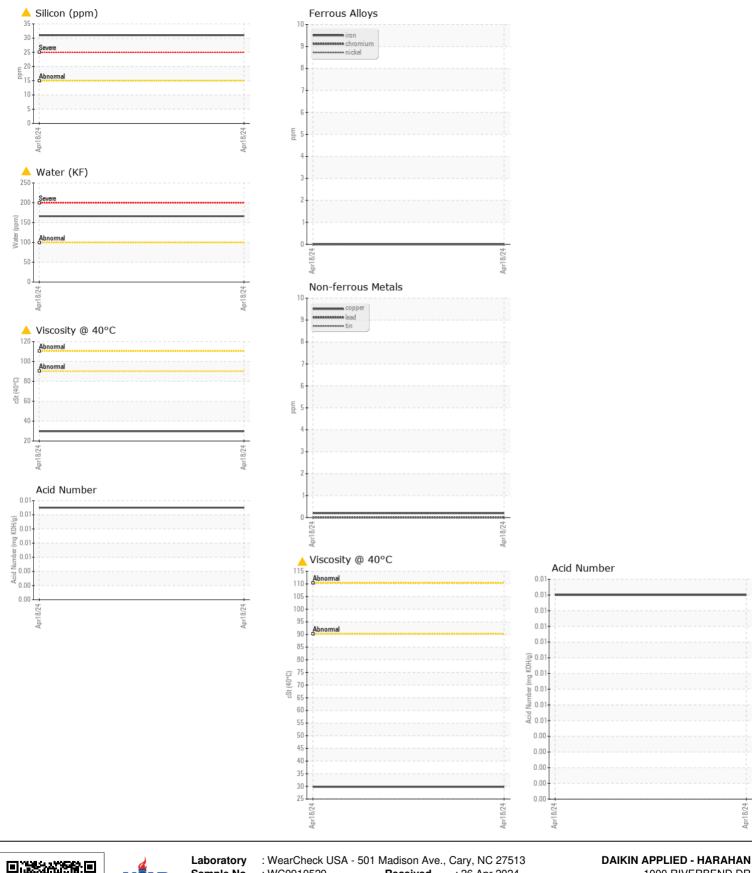

Sample No. Received 1000 RIVERBEND DR : WC0910529 : 26 Apr 2024 Lab Number : 06161591 SAINT ROSE, LA Tested : 30 Apr 2024 Unique Number : 10997014 : 30 Apr 2024 - Don Baldridge US 70087 Diagnosed Test Package : IND 2 Contact: JACK BLURTON Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. jack.blurton@daikinapplied.com \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (504)206-8283 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: x:

Contact/Location: JACK BLURTON - MCQHAR Page 2 of 2