



# OIL ANALYSIS REPORT

WEAR	<b>ABNORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>



Machine Id  
**JENBACHER GM03 (S/N 1144731)**  
Component  
**Biogas Engine**  
Fluid  
**MAHLER Q8 Mahler G8 SAE 40 (--- GAL)**

## RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0880403</b>	WC0880435	WC0880429
Sample Date		Client Info		<b>25 Apr 2024</b>	19 Apr 2024	12 Apr 2024
Machine Age	hrs	Client Info		<b>51274</b>	51141	50992
Oil Age	hrs	Client Info		<b>159</b>	26	465
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>ABNORMAL</b>	ABNORMAL	SEVERE

## WEAR

The iron level is abnormal. All other component wear rates are normal.

Iron	ppm	ASTM D5185m	>20	<b>▲ 24</b>	▲ 20	▲ 50
Chromium	ppm	ASTM D5185m	>5	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>15	<b>3</b>	2	4
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>15	<b>1</b>	0	1
Tin	ppm	ASTM D5185m	>5	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

## CONTAMINATION

There is no indication of any contamination in the oil.


Silicon	ppm	ASTM D5185m	>200	<b>11</b>	13	31
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844	>2	<b>0.1</b>	0	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.7</b>	5.8	7.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>15.9</b>	15.7	17.0
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>.2	<b>NEG</b>	NEG	NEG

## FLUID CONDITION


The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>20	<b>2</b>	1	2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>6</b>	8	4
Calcium	ppm	ASTM D5185m		<b>2217</b>	2296	2255
Phosphorus	ppm	ASTM D5185m		<b>392</b>	399	354
Zinc	ppm	ASTM D5185m		<b>434</b>	451	380
Sulfur	ppm	ASTM D5185m		<b>2479</b>	2526	2235
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>10.9</b>	10.0	11.9
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.951</b>	0.946	0.46
Base Number (BN)	mg KOH/g	ASTM D2896	8.0	<b>7.81</b>	7.63	8.01
Visc @ 100°C	cSt	ASTM D445	13.2	<b>13.0</b>	12.9	13.2


▲ Ferrous Alloys

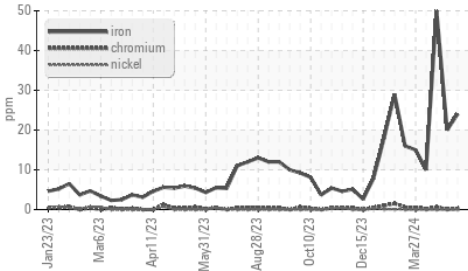


▲ Iron (ppm)

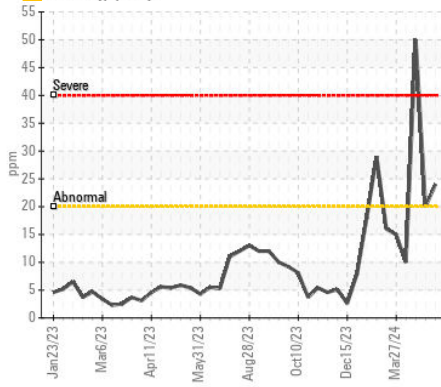


Lead (ppm)

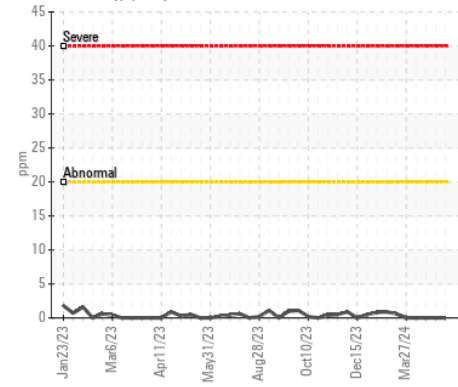


FT-IR (Direct Trend)

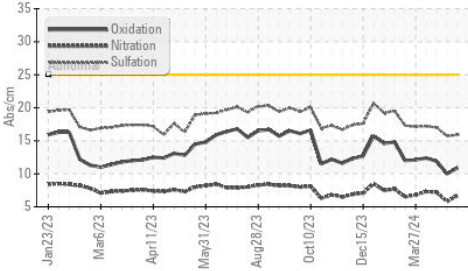


Aluminum (ppm)

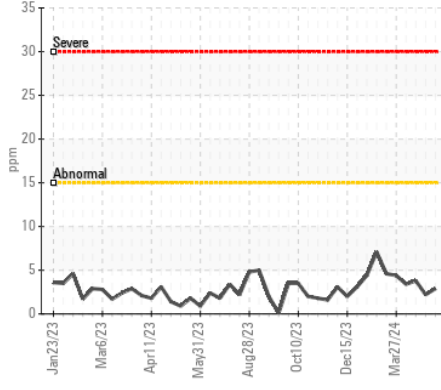


Chromium (ppm)

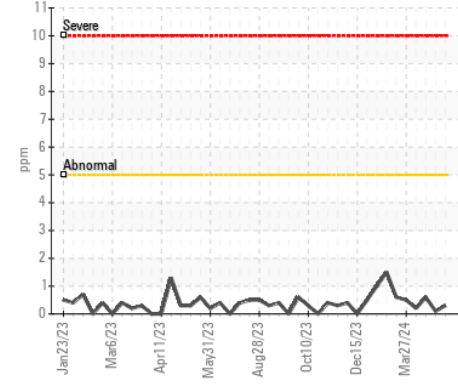


Acid Number

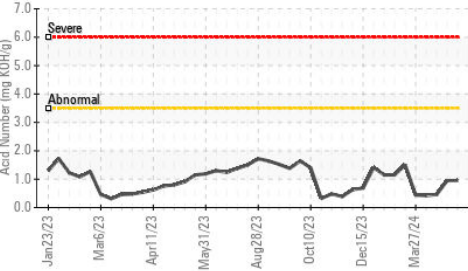


Copper (ppm)

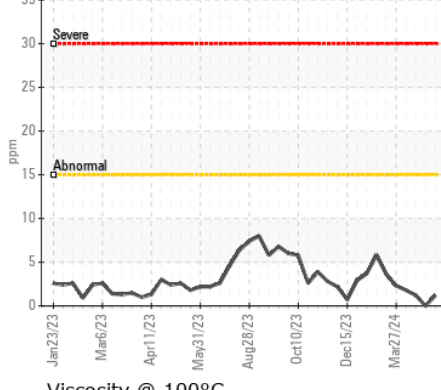


Silicon (ppm)

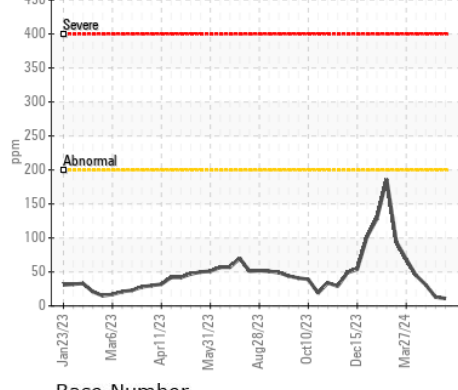


Base Number

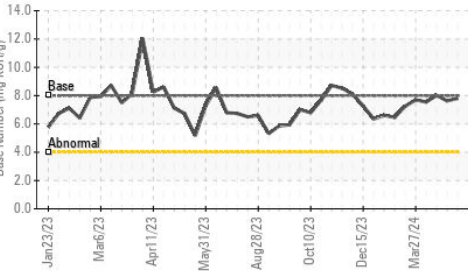

Viscosity @ 100°C

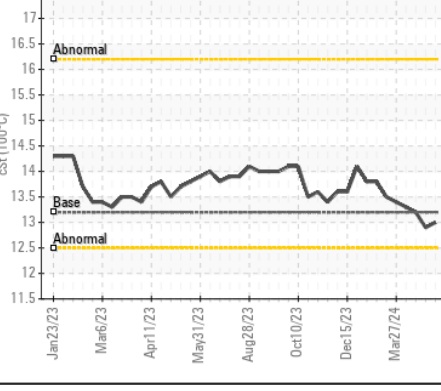

Base Number

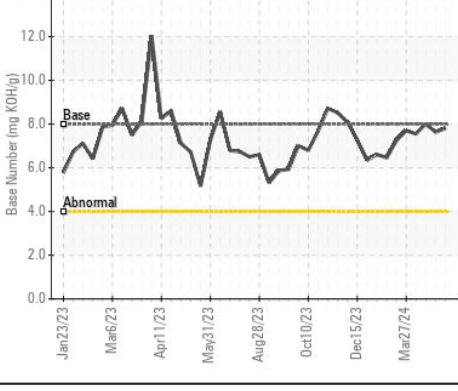

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0880403  
**Lab Number** : 06161688  
**Unique Number** : 10997111  
**Test Package** : MOB 2

**Received** : 26 Apr 2024  
**Tested** : 30 Apr 2024  
**Diagnosed** : 30 Apr 2024 - Sean Felton

**PINE RIDGE**  
 105 BAILEY JESTER RD  
 GRIFFIN, GA  
 US 30224  
 Contact: STEPHEN SAVAGE  
 stephen.savage@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)