



OIL ANALYSIS REPORT

WEAR	SEVERE
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
LGS00181
 Component
Middle Biogas Engine
 Fluid
CITGO PACEMAKER GAS ENGINE LFG LA 40 (--- GAL)

RECOMMENDATION

We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0803463	WC0803407	WC0803406
Sample Date		Client Info		22 Apr 2024	15 Apr 2024	08 Apr 2024
Machine Age	hrs	Client Info		66963	66882	66712
Oil Age	hrs	Client Info		67	287	116
Filter Age	hrs	Client Info		67	287	116
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				SEVERE	NORMAL	NORMAL

WEAR

The lead level is severe.

Iron	ppm	ASTM D5185m	>45	3	6	2
Chromium	ppm	ASTM D5185m	>2	<1	<1	0
Nickel	ppm	ASTM D5185m	>2	0	0	<1
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	1	2
Lead	ppm	ASTM D5185m	>5	▲ 64	<1	0
Copper	ppm	ASTM D5185m	>14	3	1	2
Tin	ppm	ASTM D5185m	>13	2	3	2
Vanadium	ppm	ASTM D5185m		0	<1	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION














There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>200	63	181	91
Potassium	ppm	ASTM D5185m	>20	0	0	2
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	3.2	3.3	3.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.4	16.8	15.6
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

Sodium	ppm	ASTM D5185m		100	1	2
Boron	ppm	ASTM D5185m		3	0	<1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		7	2	1
Manganese	ppm	ASTM D5185m		<1	0	1
Magnesium	ppm	ASTM D5185m		22	29	15
Calcium	ppm	ASTM D5185m		1481	1462	1469
Phosphorus	ppm	ASTM D5185m		290	284	302
Zinc	ppm	ASTM D5185m		333	312	360
Sulfur	ppm	ASTM D5185m		2900	3191	3294
Oxidation	Abs/.1mm	*ASTM D7414	>25	7.0	7.2	6.9
Acid Number (AN)	mg KOH/g	ASTM D8045	1.16	0.68	0.87	0.75
Base Number (BN)	mg KOH/g	ASTM D2896	5	3.65	3.03	3.47
Visc @ 100°C	cSt	ASTM D445	13.5	12.3	12.4	12.5

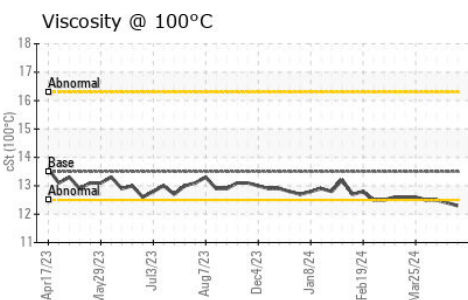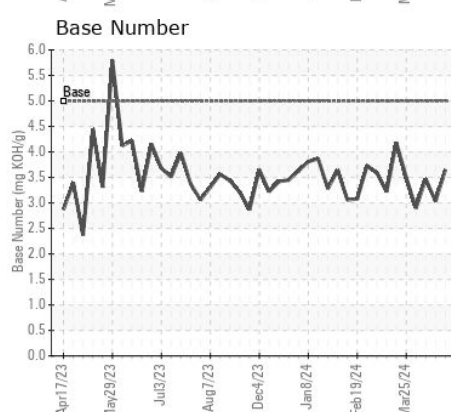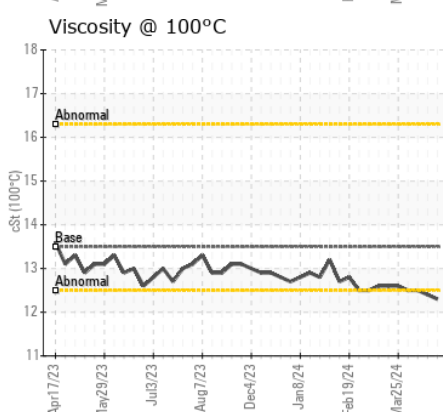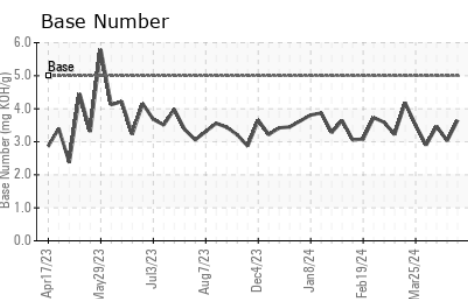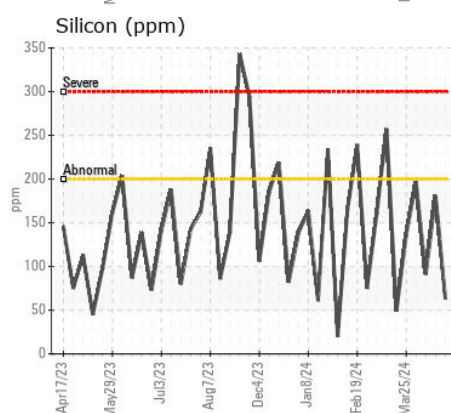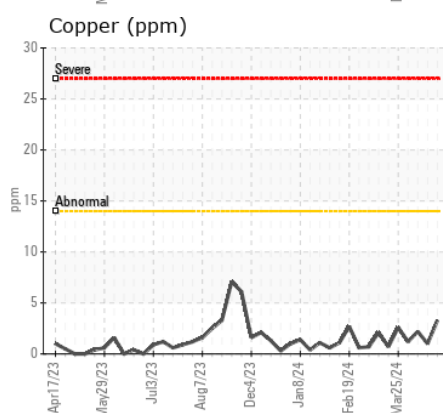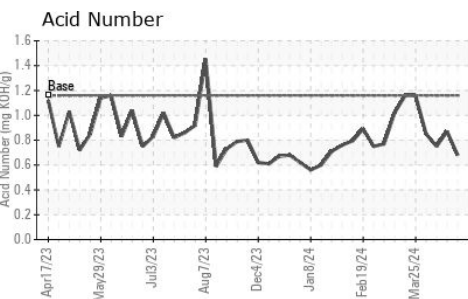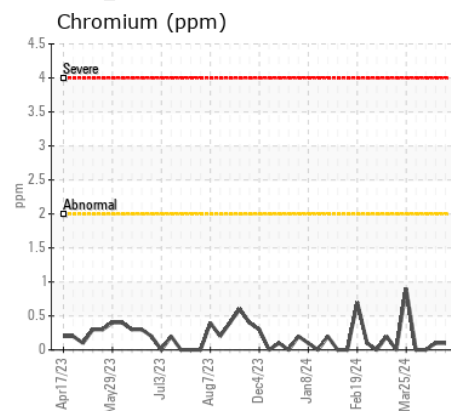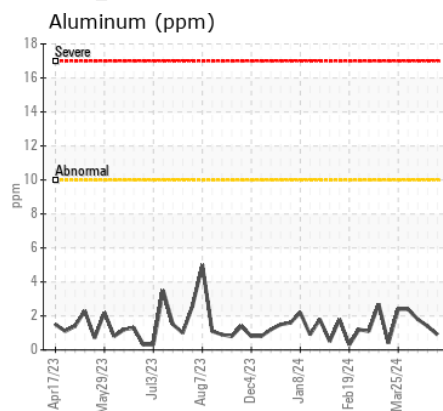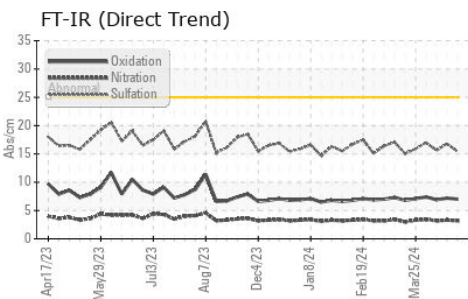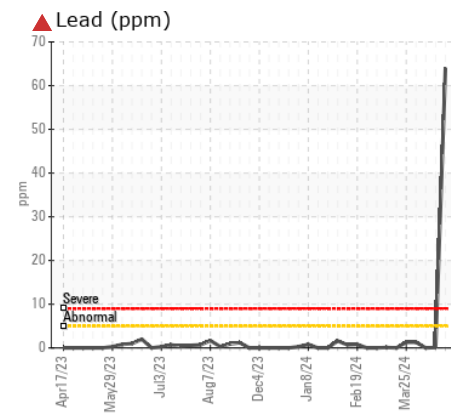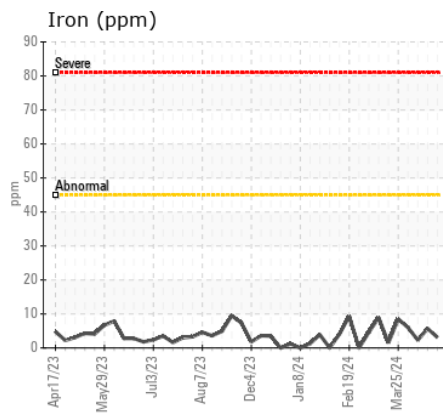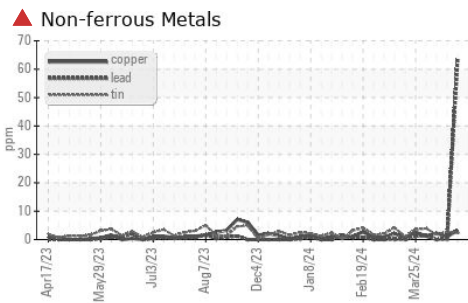

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0803463

Lab Number : 06161695

Unique Number : 10997118

Test Package : MOB 2

Received : 26 Apr 2024

Tested : 29 Apr 2024

Diagnosed : 01 May 2024 - Jonathan Hester

BLACK OAK

5054 HWY HH

HARTVILLE, MO

US 65667

Contact: CHIP MATHEWS

chip.matthews@cubedistrictenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)