CORROSION CONTAMINANTS COOLANT CONDITION

NORMAL NORMAL NORMAL


[PMO2H2714703]


ONAN GGHE-5585006 K020435506

Component Coolant

{not provided} (--- GAL)

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
The fluid is suitable for further service.	Sample Number		Client Info		DC0023221		
	Sample Date		Client Info		02 May 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Sample Status				NORMAL		
CORROSION	Total Dissolved Solids				366.5		
	Coolant Appearance		*Visual	Clear	normal		
CONTAMINANTS	Boiling Point	°C	WC Method		225		
There is no indication of any contamination in the coolant.	Specific Gravity		*ASTM D1298		1.066		
	рН	Scale 0-14	ASTM D1287		10.4		
	Nitrites	ppm	AP-053:2009		1428		
	Reserve Alkalinity	Scale 0-20	*ASTM D1121				
	Percentage Glycol	%	ASTM D3321		48.9		
	Freezing Point	°F	ASTM D3321		-31		
	Carboxylate				n/a		
	Coolant Color		*Visual		Blue		



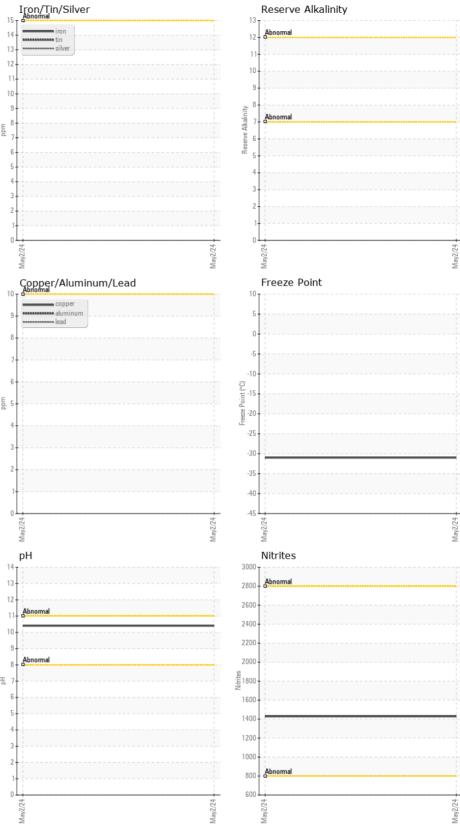



Report Id: KELOWI [WUSCAR] 06175056 (Generated: 05/16/2024 14:25:12) Rev: 1

Laboratory Sample No.

: DC0023221 Lab Number : 06175056 Unique Number : 11021109

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 09 May 2024 **Tested** : 16 May 2024

: 16 May 2024 - Jonathan Hester Diagnosed

KELLY GENERATOR & EQUIPMENT INC 1955 DALE LN OWINGS, MD US 20736

Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

LSNURR@KGE.COM T: (410)257-5225 F: (410)257-5227

Contact: LESLIE SNURR

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: LESLIE SNURR - KELOWI