



OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**CB19295**  
 Component  
**Compressor**  
 Fluid  
**INGERSOLL-RAND TURBOBLEND 46 (55 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>CCSI2014796</b>	CCSI2014816	CCSI2014829
Sample Date		Client Info		<b>04 May 2024</b>	31 Jan 2024	24 Oct 2023
Machine Age	hrs	Client Info		<b>38463</b>	37429	36422
Oil Age	hrs	Client Info		<b>6040</b>	5006	3989
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Not Changd</b>	Not Changd	Not Changd
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	<1	<1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**










There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	2	<1
Water	%	ASTM D6304	>0.1	<b>NEG</b>	NEG	NEG
Particles >4µm		ASTM D7647	>10000	<b>530</b>	468	139
Particles >6µm		ASTM D7647	>2500	<b>79</b>	156	43
Particles >14µm		ASTM D7647	>320	<b>16</b>	20	7
Particles >21µm		ASTM D7647	>80	<b>7</b>	6	3
Particles >38µm		ASTM D7647	>20	<b>0</b>	1	0
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>16/13/11</b>	16/14/11	14/13/10
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>0</b>	<1	0
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	7
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	1	0
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	2	<1
Phosphorus	ppm	ASTM D5185m		<b>15</b>	13	31
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>0</b>	0	0
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.15</b>	0.15	0.15
Visc @ 40°C	cSt	ASTM D445	46	<b>48.8</b>	44.6	44.6

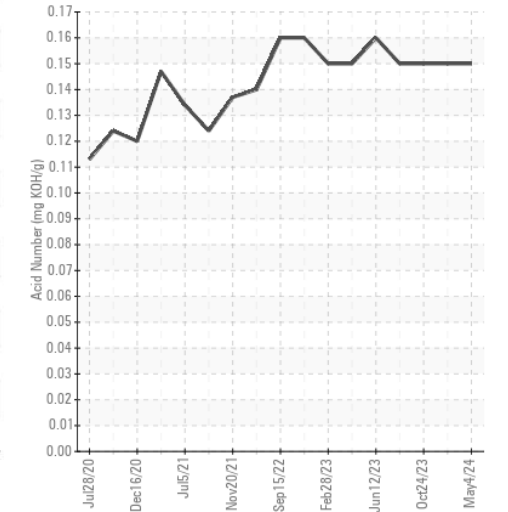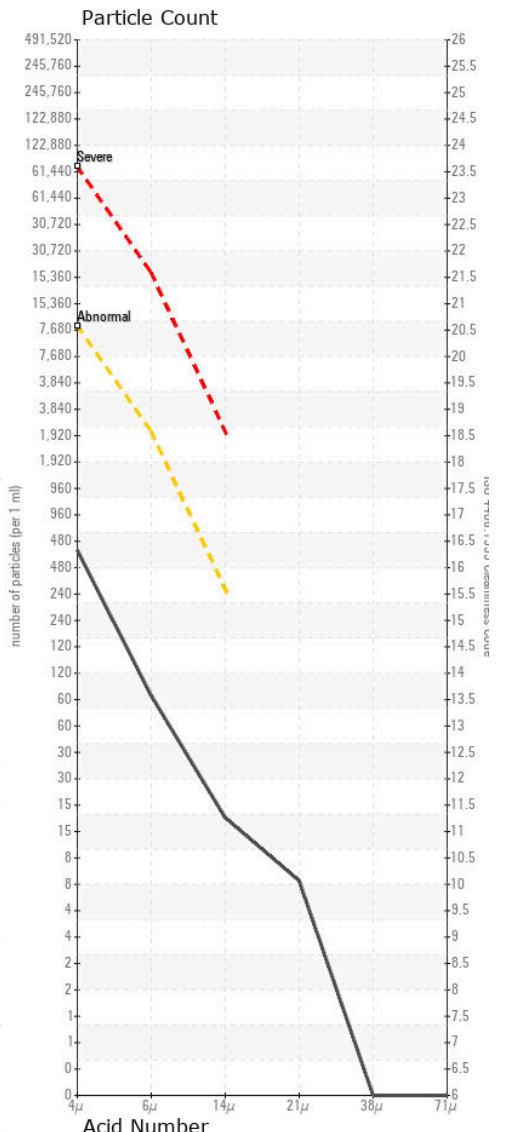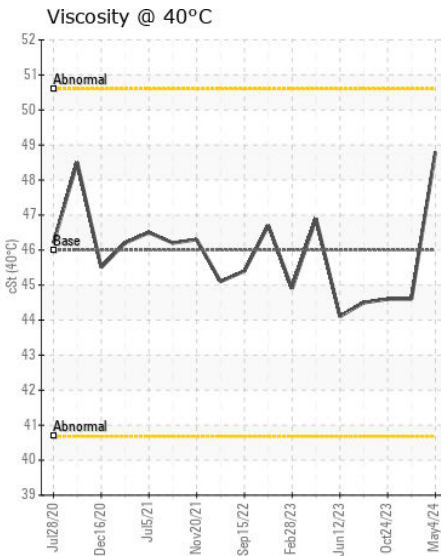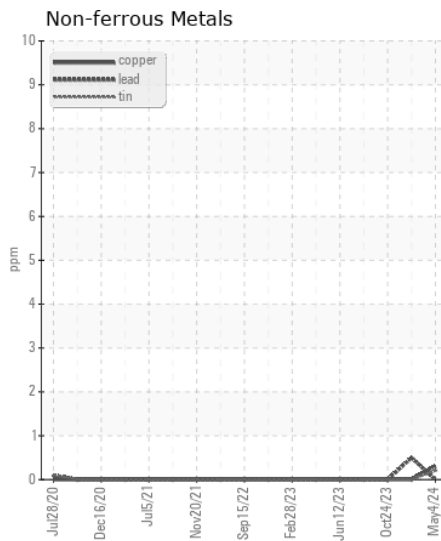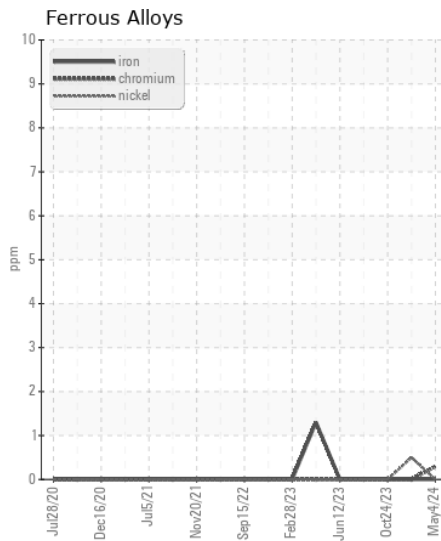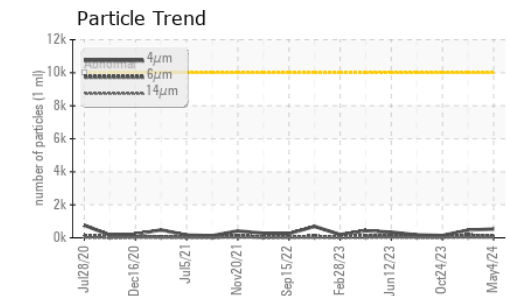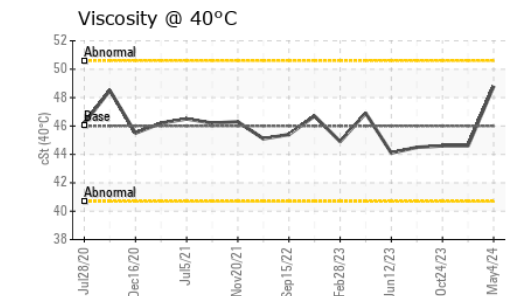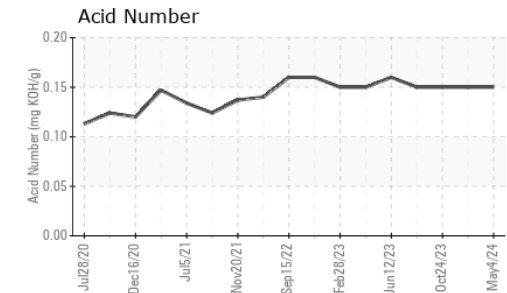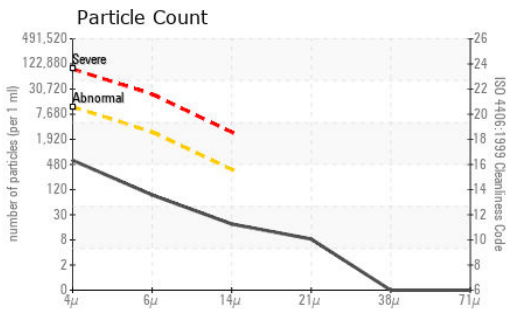

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : CCSI2014796 **Received** : 10 May 2024  
**Lab Number** : 06175440 **Tested** : 14 May 2024  
**Unique Number** : 11021493 **Diagnosed** : 14 May 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**HUNTINGTON INGALLS INDUSTRIES**  
 PO BOX 149 MS8020-01  
 PASCAGOULA, MS  
 US 39568  
 Contact: LANE RUSSELL  
 charles.russell@hii-ingalls.com  
 T: (228)935-8636  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)