



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**MP MARC 15**  
 Component  
**Air Compressor**  
 Fluid  
**DURALENE 600 20 ISO 68 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

## WEAR

All component wear rates are normal.

## CONTAMINATION

There is no indication of any contamination in the oil.

## FLUID CONDITION











The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>DC0035723</b>	DC0029985	DC0030048
Sample Date		Client Info		<b>27 Apr 2024</b>	21 Nov 2023	22 Sep 2023
Machine Age	days	Client Info		<b>0</b>	0	0
Oil Age	days	Client Info		<b>0</b>	0	0
Filter Age	days	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Changed</b>	Not Changd	Not Changd
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

Iron	ppm	ASTM D5185m	>50	<b>3</b>	<1	4
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>40	<b>1</b>	0	1
Tin	ppm	ASTM D5185m	>5	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	1	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	2	1
Water		WC Method	>0.6	<b>NEG</b>	NEG	NEG
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Debris	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	<b>NEG</b>	NEG	NEG

Sodium	ppm	ASTM D5185m		<b>37</b>	<1	35
Boron	ppm	ASTM D5185m		<b>1</b>	0	0
Barium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>1</b>	<1	0
Calcium	ppm	ASTM D5185m		<b>75</b>	2	32
Phosphorus	ppm	ASTM D5185m		<b>126</b>	<1	161
Zinc	ppm	ASTM D5185m		<b>22</b>	0	10
Sulfur	ppm	ASTM D5185m		<b>7059</b>	862	7967
Acid Number (AN)	mg KOH/g	ASTM D8045	.2	<b>0.18</b>	0.10	0.16
Visc @ 40°C	cSt	ASTM D445	65	<b>65.9</b>	67.7	65.9

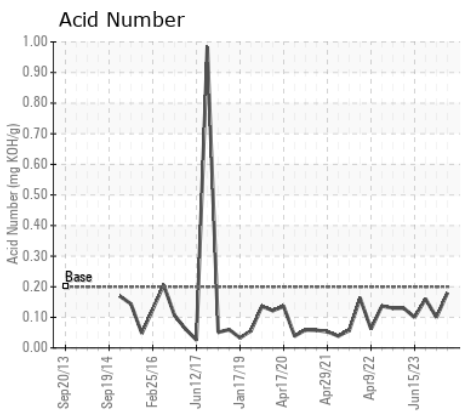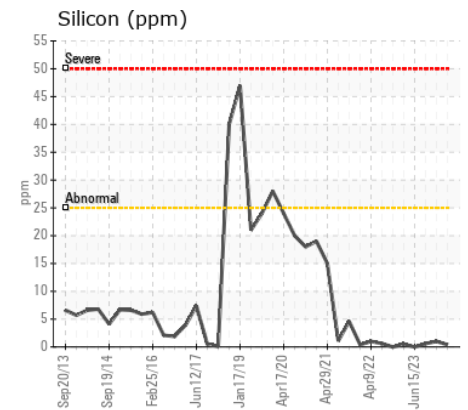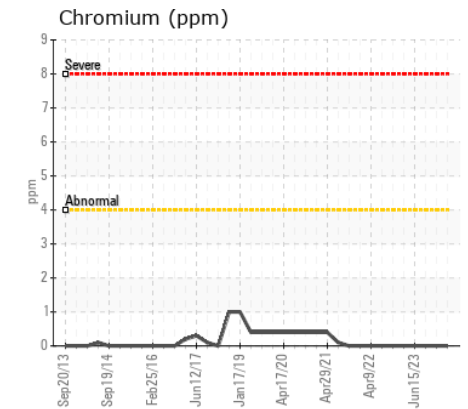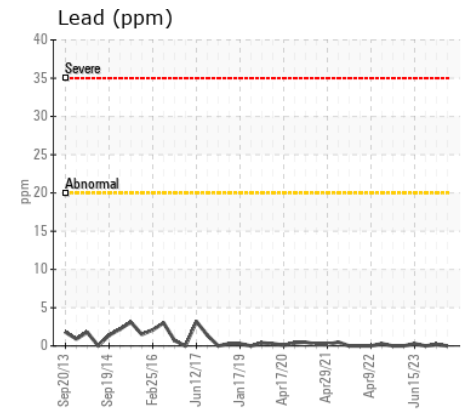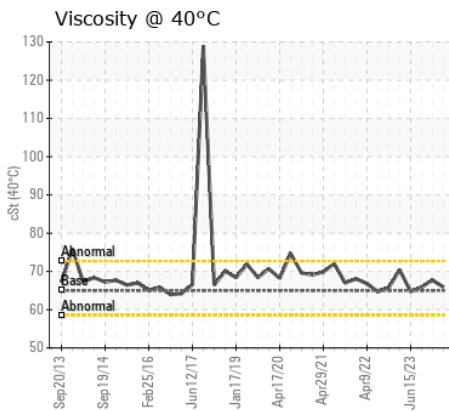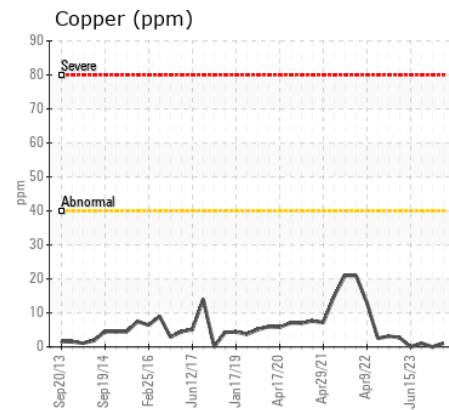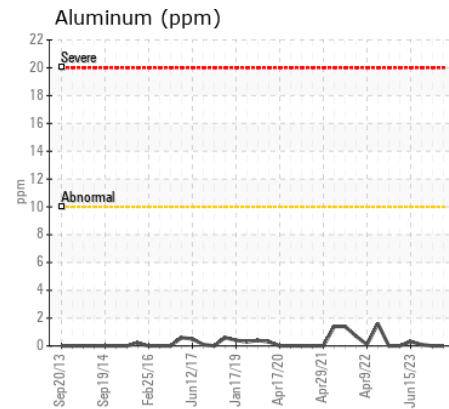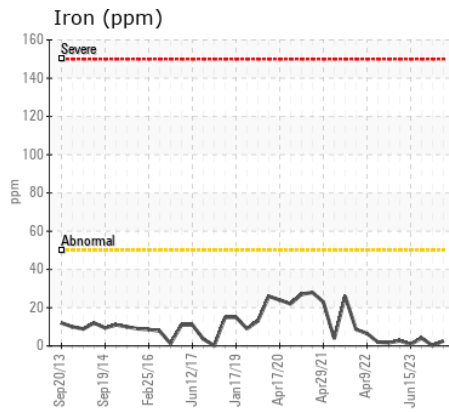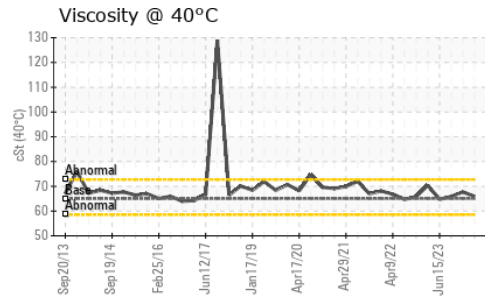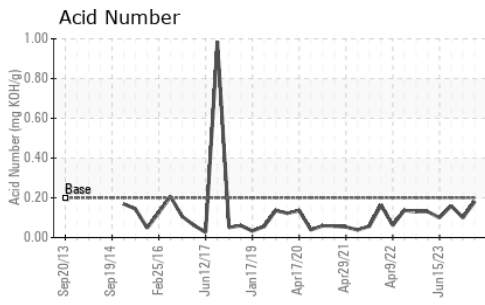

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : DC0035723  
**Lab Number** : 06175683  
**Unique Number** : 11021736  
**Test Package** : MOB 2

**Received** : 10 May 2024  
**Tested** : 13 May 2024  
**Diagnosed** : 13 May 2024 - Wes Davis

**ALSTOM - BALTIMORE**  
 1600 LUDLOW ST  
 BALTIMORE, MD  
 US 21230

Contact: SEAN MCCARTY  
 sean.mccarty@rail.bombardier.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: (443)220-0469