



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
AC-2 (S/N 13897)
 Component
Compressor
 Fluid
INGERSOLL-RAND TURBOBLEND 46 (85 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CCSI2015035	CCSI2009073	CCSI2004171
Sample Date		Client Info		30 Apr 2024	20 Jan 2020	07 Apr 2016
Machine Age	hrs	Client Info		47156	0	76805
Oil Age	hrs	Client Info		0	0	50000
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Changed
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m	>25	0	0	0
Lead	ppm	ASTM D5185m	>25	0	<1	0
Copper	ppm	ASTM D5185m	>50	0	0	0
Tin	ppm	ASTM D5185m	>15	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION










There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Silicon	ppm	ASTM D5185m	>25	0	<1	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water		WC Method	>0.1	NEG	NEG	NEG
Particles >4µm		ASTM D7647	>10000	323	147	256
Particles >6µm		ASTM D7647	>2500	63	66	139
Particles >14µm		ASTM D7647	>320	12	8	23
Particles >21µm		ASTM D7647	>80	6	3	8
Particles >38µm		ASTM D7647	>20	1	0	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/13/11	14/13/10	15/14/12
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<1	2	0
Boron	ppm	ASTM D5185m		0	<1	<1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		2	<1	0
Phosphorus	ppm	ASTM D5185m		14	30	8
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		51	50	2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.15	0.121	0.085
Visc @ 40°C	cSt	ASTM D445	46	44.8	44.8	45.62

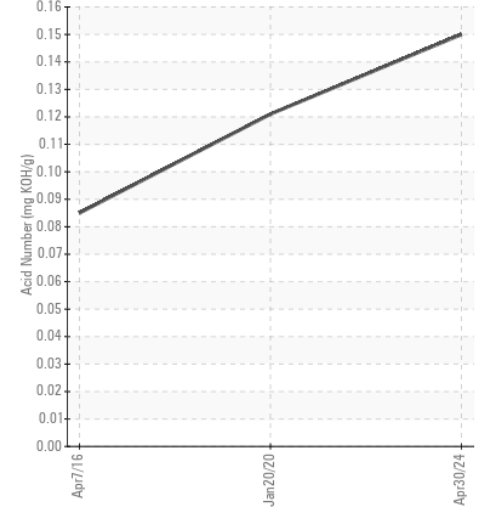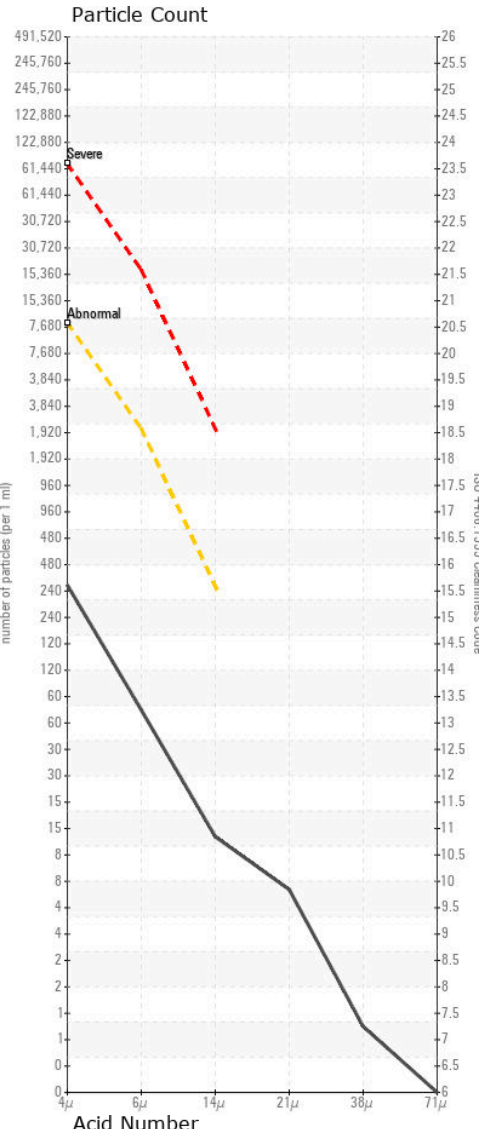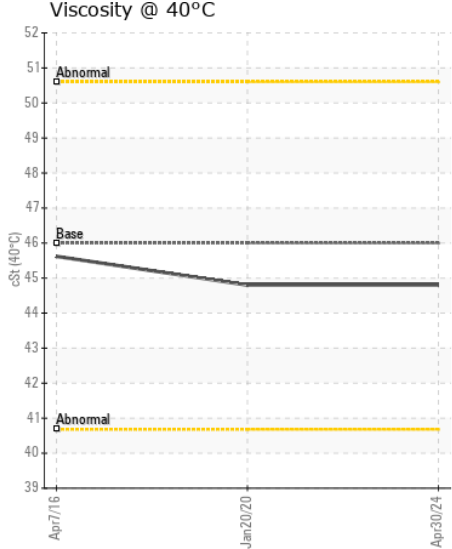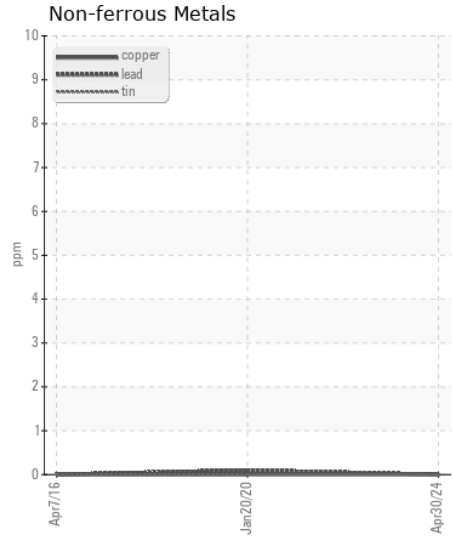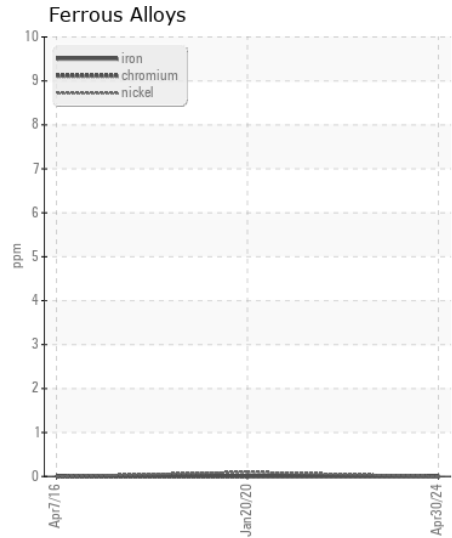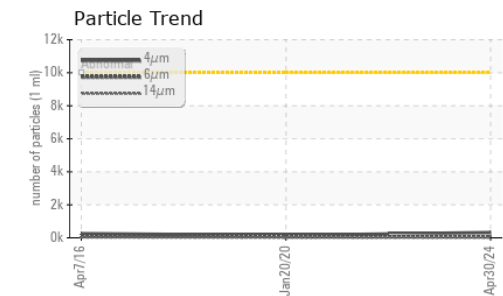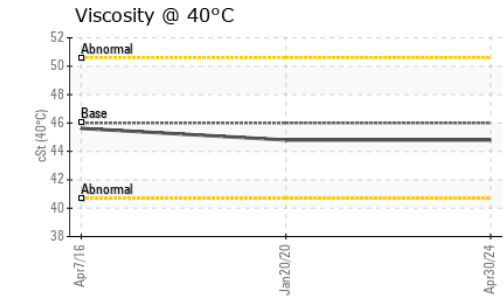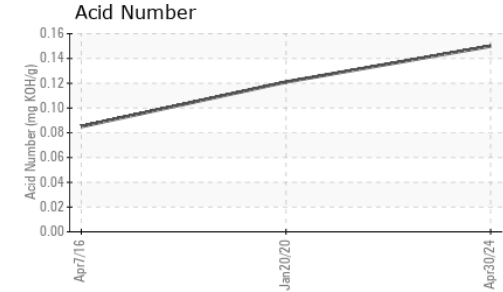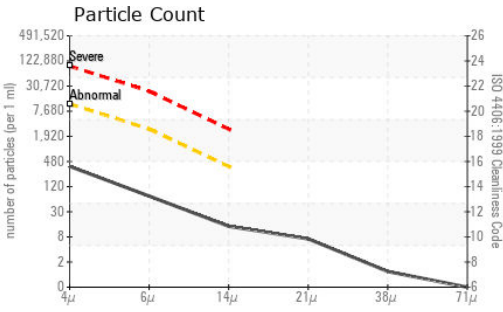

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : CCSI2015035 **Received** : 10 May 2024
Lab Number : 06176079 **Tested** : 14 May 2024
Unique Number : 11022132 **Diagnosed** : 14 May 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

OWENS-BROCKWAY GLASS
 11133 EASTMAN PARK DR
 WINDSOR, CT
 US 80550
 Contact: JOE LYNN

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (970)674-3819
 F: