
WEAR CONTAMINATION **FLUID CONDITION**

NORMAL NORMAL NORMAL

Machine Id

CCC 4002
Component
Diesel Engine

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		LW0005167	LW0008619	LW000722
	Sample Date		Client Info		23 Apr 2024	27 Jan 2024	16 Jun 202
	Machine Age	mls	Client Info		0	0	0
	Oil Age	mls	Client Info		0	0	0
	Filter Age	mls	Client Info		0	0	0
	Oil Changed		Client Info		N/A	N/A	N/A
	Filter Changed		Client Info		N/A	N/A	N/A
	Sample Status				NORMAL	NORMAL	NORMAL
WEAR	Iron	ppm	ASTM D5185m	>100	30	24	9
	Chromium	ppm	ASTM D5185m	>20	2	2	<1
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		0	0	0
	Titanium	ppm	ASTM D5185m		<1	<1	0
	Silver	ppm	ASTM D5185m	>3	0	0	0
	Aluminum	ppm	ASTM D5185m		2	2	1
	Lead	ppm	ASTM D5185m		1	<1	0
	Copper	ppm	ASTM D5185m		2	2	0
	Tin	ppm	ASTM D5185m		- <1	<1	0
	Vanadium	ppm	ASTM D5185m		<1	0	0
	White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
CONTAMINATION	Silicon	nnm	ASTM D5185m	. 25	4	2	1
CONTAININATION	Potassium	ppm	ASTM D5185m		3	2	4
There is no indication of any contamination in the oil.	Fuel	ppm	WC Method		<1.0	<1.0	<1.0
	Water		WC Method		NEG	NEG	NEG
	Glycol		WC Method	>0.2	NEG	NEG	NEG
	Soot %	%	*ASTM D7844	. 2	0.7	0.8	0.5
	Nitration	Abs/cm	*ASTM D7624	>20	12.1	10.7	5.9
	Sulfation	Abs/.1mm	*ASTM D7024		23.3	21.9	19.0
	Silt	scalar	*Visual	NONE	23.3 NONE	NONE	NONI
	Debris	scalar	*Visual	NONE	NONE	NONE	NON
	Sand/Dirt			NONE	NONE	NONE	NON
		scalar	*Visual *Visual	NORML	NORML	NORML	NOR
	Appearance Odor	scalar scalar	*Visual	NORML	NORML	NORML	NORN
	Emulsified Water		*Visual	>0.2	NEG	NEG	NEG
			Viodai				IVEG
FLUID CONDITION	Sodium	ppm	ASTM D5185m		2	0	2
The BN result indicates that there is suitable alkalinity remaining in the	Boron	ppm	ASTM D5185m		1	2	11
oil. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		2	<1	0
	Molybdenum	ppm	ASTM D5185m	100	65	61	58
	Manganese	ppm	ASTM D5185m		<1	0	<1
	Magnesium	ppm	ASTM D5185m		944	913	985
	Calcium	ppm	ASTM D5185m		1086	1030	1189
	Phosphorus	ppm	ASTM D5185m		1084	962	1138
	Zinc	ppm	ASTM D5185m		1241	1196	1363
	Sulfur	ppm	ASTM D5185m		3189	2990	4163
	Oxidation	Abs/.1mm	*ASTM D7414		22.7	21.0	14.7
	Base Number (BN)		ASTM D2896		8.1	8.0	8.6
	Visc @ 100°C	cSt	ASTM D445	14.4	13.2	13.7	13.4

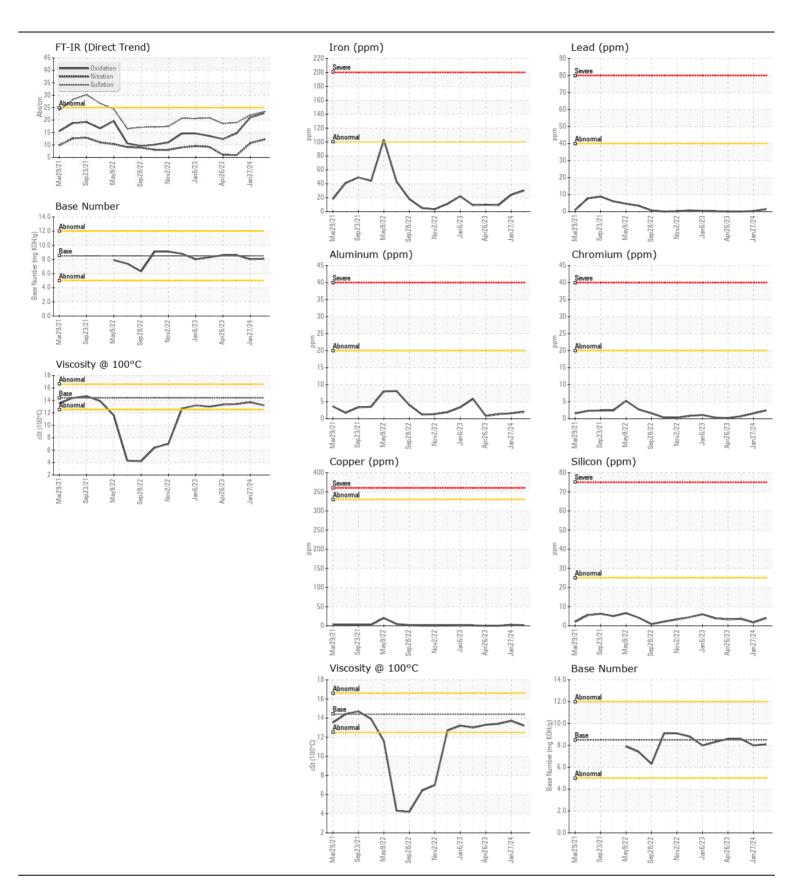



Certificate L2367

Laboratory Sample No.

Lab Number : 06176458

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : LW0005167

Received **Tested** Unique Number : 11022511 Test Package : MOB 1 (Additional Tests: TBN)

: 10 May 2024 Diagnosed

: 13 May 2024 : 13 May 2024 - Wes Davis

LRS - NILES 33541 REUM RD NILES, MI US 49120

Contact: JOHN HUGHES johnh@michianarecyclinganddisposal.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (269)684-0900 X:124 F: