



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
(EQ2706) S
Machine Id
Component
Scottsville BPS (S/N 46030427)
Fluid
PETRO CANADA DURON UHP 5W40 (16 QTS)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0934067	WC0810885	WC0696106
Sample Date		Client Info		08 May 2024	18 May 2023	11 May 2022
Machine Age	hrs	Client Info		803	778	752
Oil Age	hrs	Client Info		51	44	752
Filter Age	hrs	Client Info		0	44	0
Oil Changed		Client Info		Not Changd	Not Changd	Changed
Filter Changed		Client Info		N/A	N/A	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>90	4	2	2
Chromium	ppm	ASTM D5185m	>20	<1	0	<1
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m	>2	6	5	6
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	<1	<1
Lead	ppm	ASTM D5185m	>40	6	3	1
Copper	ppm	ASTM D5185m	>330	1	0	<1
Tin	ppm	ASTM D5185m	>15	<1	<1	0
Vanadium	ppm	ASTM D5185m		<1	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	5	2	3
Potassium	ppm	ASTM D5185m	>20	2	<1	0
Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844	>6	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	7.2	7.0	6.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	17.6	17.7	17.2
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	2	2
Boron	ppm	ASTM D5185m	65	74	72	75
Barium	ppm	ASTM D5185m	0	2	0	0
Molybdenum	ppm	ASTM D5185m	65	58	53	55
Manganese	ppm	ASTM D5185m	0	<1	<1	0
Magnesium	ppm	ASTM D5185m	1160	1016	1050	1142
Calcium	ppm	ASTM D5185m	820	938	904	964
Phosphorus	ppm	ASTM D5185m	1160	1119	1025	1136
Zinc	ppm	ASTM D5185m	1260	1212	1325	1276
Sulfur	ppm	ASTM D5185m	3000	3623	3861	3214
Oxidation	Abs/.1mm	*ASTM D7414	>25	15.8	15.8	14.5
Base Number (BN)	mg KOH/g	ASTM D2896	11.0	8.6	9.4	9.1
Visc @ 100°C	cSt	ASTM D445	14.3	13.5	13.7	14.0

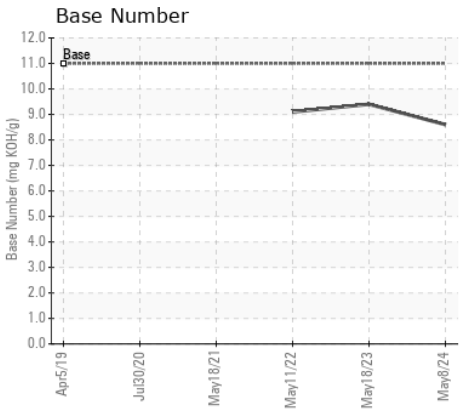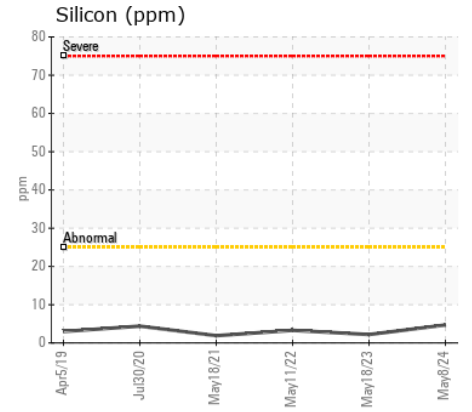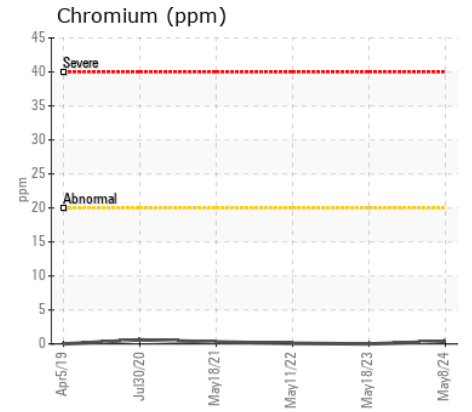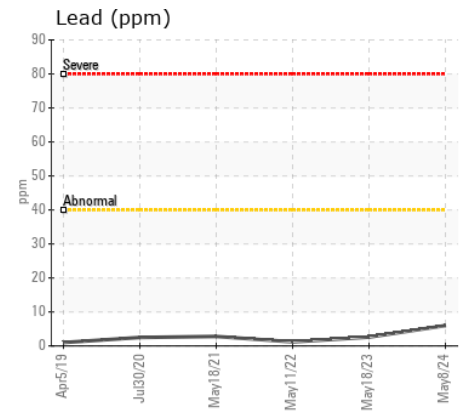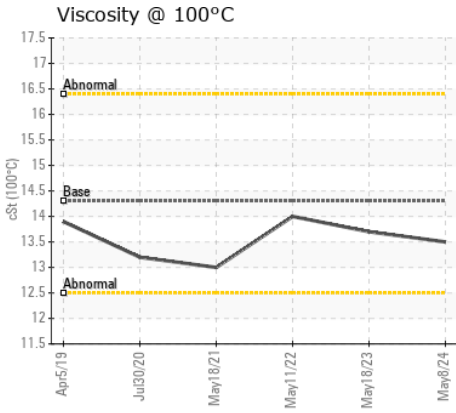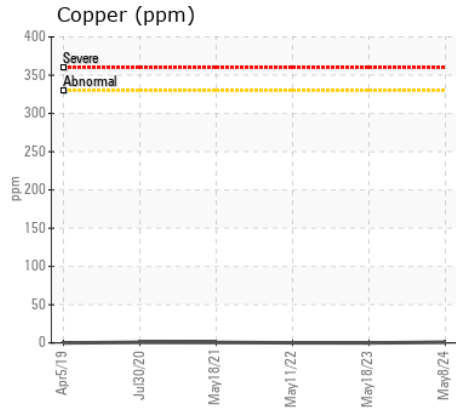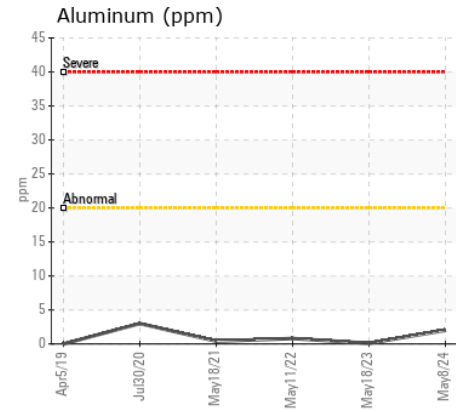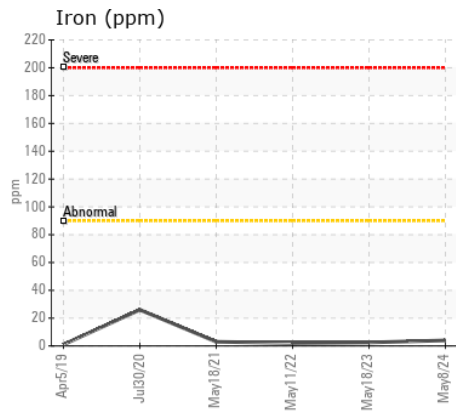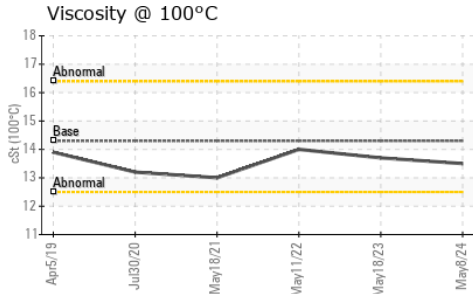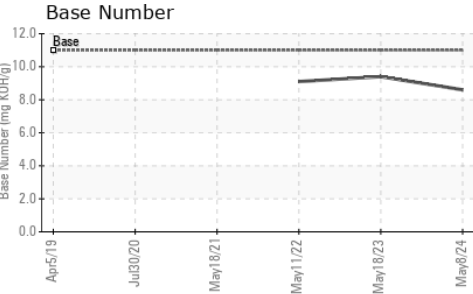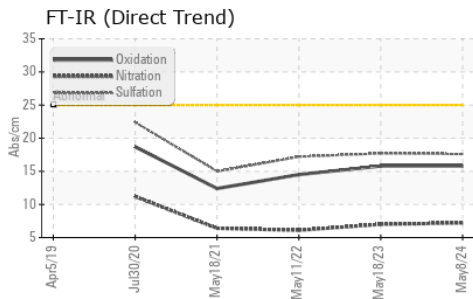

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0934067
Lab Number : 06176871
Unique Number : 11022924
Test Package : MOB 1 (Additional Tests: TBN)

MONROE COUNTY WATER AUTHORITY
 4799 DEWEY AVE
 ROCHESTER, NY
 US 14612
 Contact: SCOTT TRAIL
 scott.trail@mcwa.com
 T: (585)775-5257
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)