



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL



Area

N
Machine Id

Webster Lake Water Pump Station CAT 1500KW

Component

Diesel Engine

Fluid

CAT DIESEL ENGINE OIL 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0934078	WC0810895	WC0696116
Sample Date		Client Info		08 May 2024	18 May 2023	11 May 2022
Machine Age	hrs	Client Info		44	16	11
Oil Age	hrs	Client Info		44	16	11
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	5	4	6
Chromium	ppm	ASTM D5185m	>20	<1	0	<1
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m	>2	0	<1	<1
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>25	1	<1	1
Lead	ppm	ASTM D5185m	>40	2	2	2
Copper	ppm	ASTM D5185m	>330	20	13	11
Tin	ppm	ASTM D5185m	>15	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	5	5	7
Potassium	ppm	ASTM D5185m	>20	2	3	1
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844	>3	0	0	0.1
Nitration	Abs/cm	*ASTM D7624	>20	5.4	5.2	4.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	21.9	22.3	21.7
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		4	3	3
Boron	ppm	ASTM D5185m		74	75	77
Barium	ppm	ASTM D5185m		4	0	0
Molybdenum	ppm	ASTM D5185m		40	38	40
Manganese	ppm	ASTM D5185m		2	1	1
Magnesium	ppm	ASTM D5185m		506	486	534
Calcium	ppm	ASTM D5185m		1702	1735	1680
Phosphorus	ppm	ASTM D5185m		968	897	981
Zinc	ppm	ASTM D5185m	1460	1112	1199	1112
Sulfur	ppm	ASTM D5185m		3330	3196	2703
Oxidation	Abs/.1mm	*ASTM D7414	>25	19.1	19.3	18.5
Base Number (BN)	mg KOH/g	ASTM D2896	11.3	10.5	10.9	10.5
Visc @ 100°C	cSt	ASTM D445	15.5	12.5	12.6	12.8

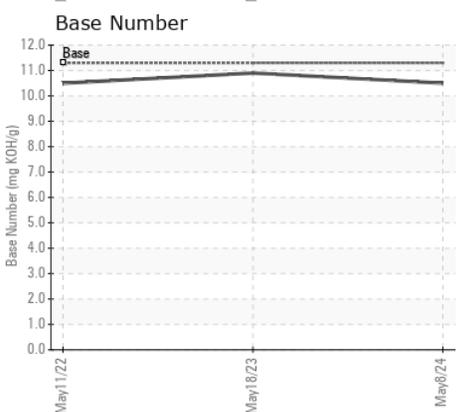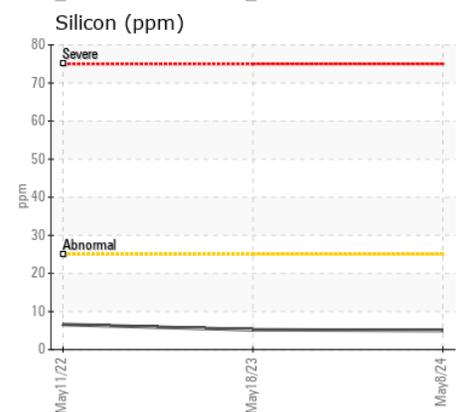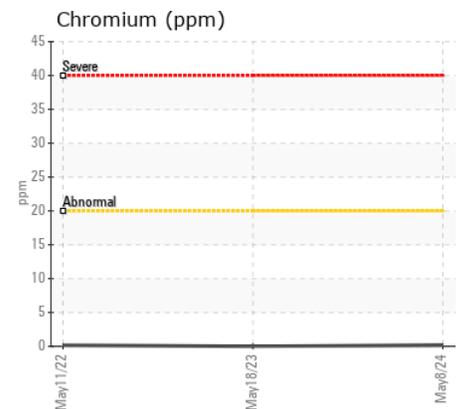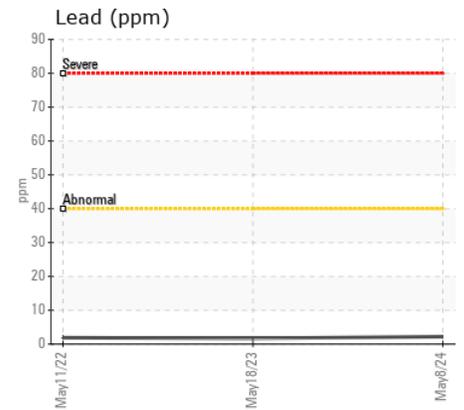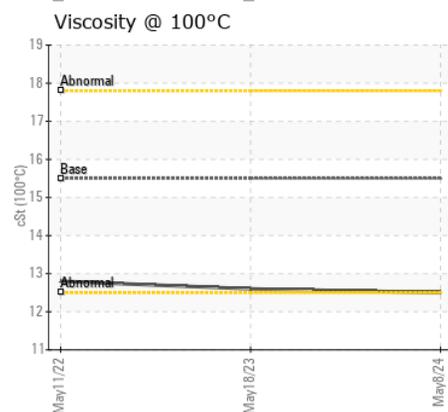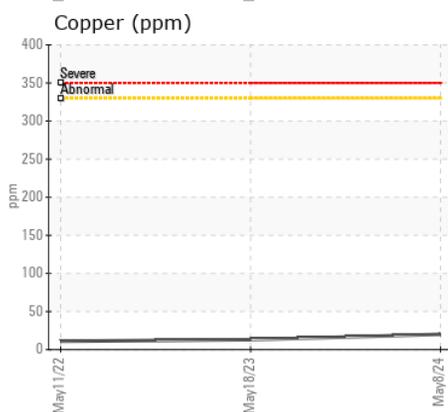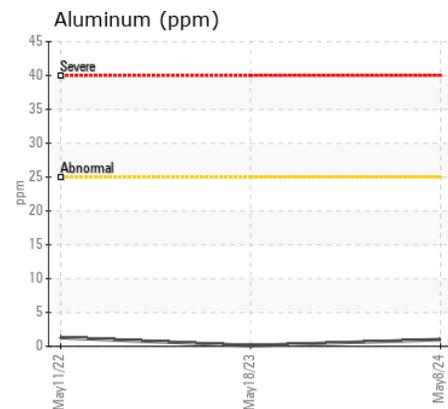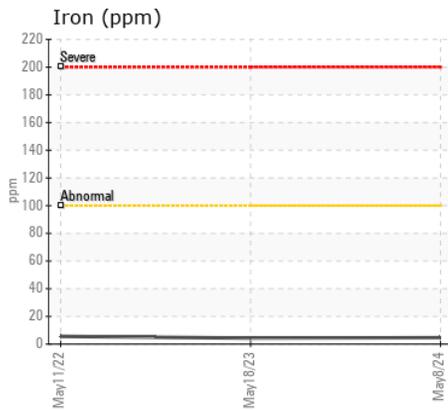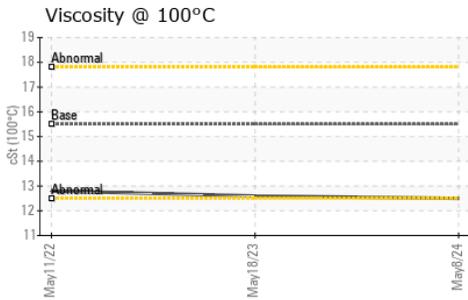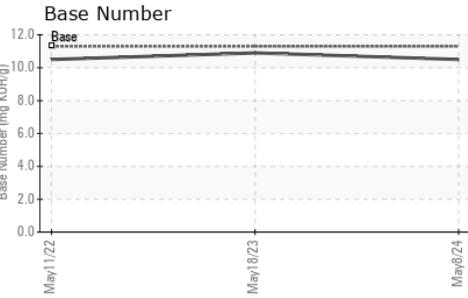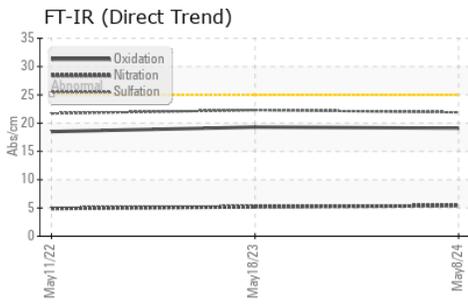

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0934078 **Received** : 13 May 2024
Lab Number : **06176912** **Tested** : 14 May 2024
Unique Number : 11022965 **Diagnosed** : 14 May 2024 - Sean Felton
Test Package : MOB 1 (Additional Tests: TBN)

MONROE COUNTY WATER AUTHORITY
 4799 DEWEY AVE
 ROCHESTER, NY
 US 14612
 Contact: SCOTT TRAIL
 scott.trail@mcwa.com
 T: (585)775-5257
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)