



**PERFORMANCE  
UNDER  
PRESSURE**

**OIL ANALYSIS REPORT**

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**CWAY\_U2120 CWAY\_U2120\_M2120**  
Component  
**Drive End Bearing**  
Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>RP0025830</b>	RP0025917	RP0034095
Sample Date		Client Info		<b>09 May 2024</b>	20 Feb 2024	15 Nov 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>2</b>	0	0
Lead	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>20	<b>2</b>	<1	0
Tin	ppm	ASTM D5185m	>20	<b>2</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**








The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	<1
Water	%	ASTM D6304	>0.05	<b>0.002</b>	0.006	0.004
ppm Water	ppm	ASTM D6304	>500	<b>18</b>	63	40
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>0</b>	0	1
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Calcium	ppm	ASTM D5185m		<b>5</b>	0	<1
Phosphorus	ppm	ASTM D5185m		<b>1</b>	0	4
Zinc	ppm	ASTM D5185m		<b>10</b>	0	0
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.055</b>	0.134	0.083
Visc @ 40°C	cSt	ASTM D445	32	<b>32.4</b>	32.2	32.0

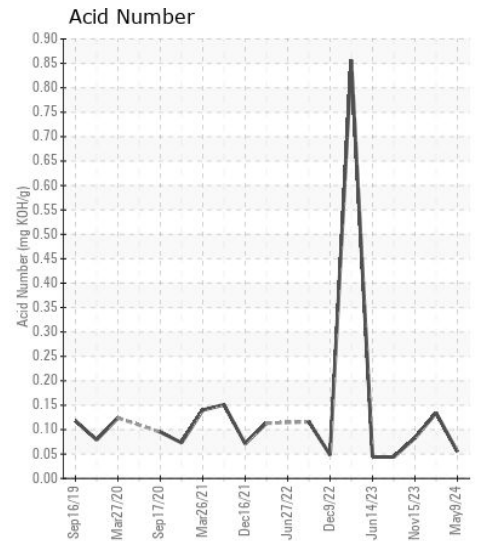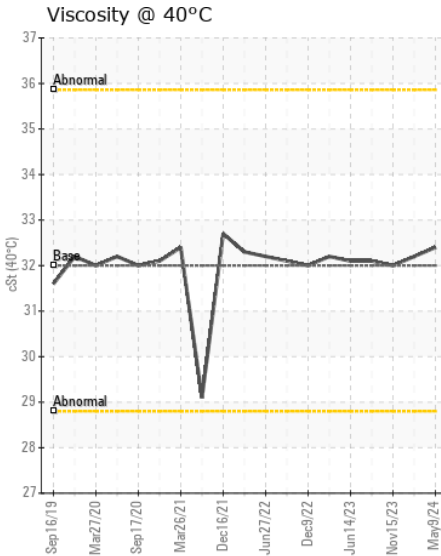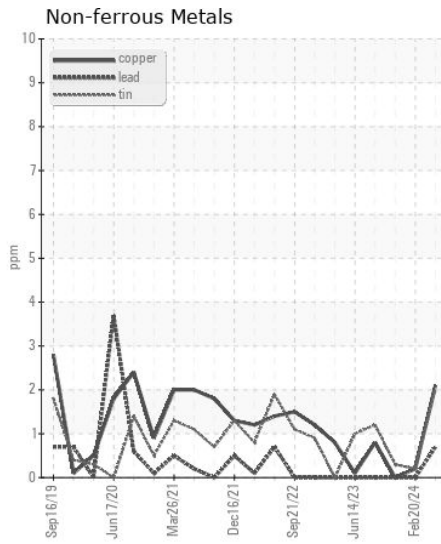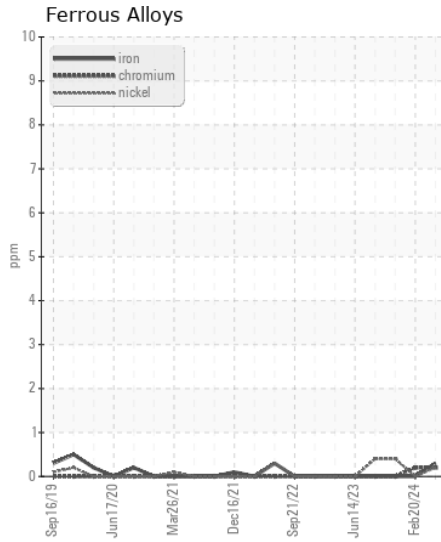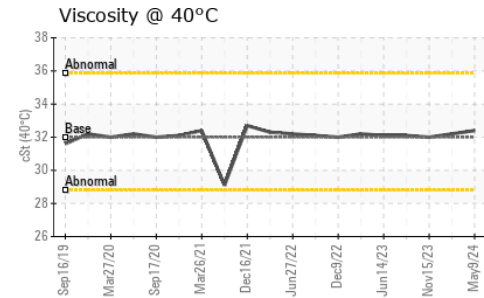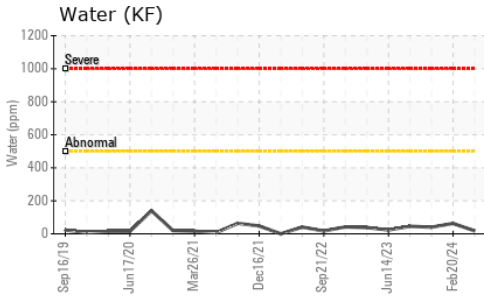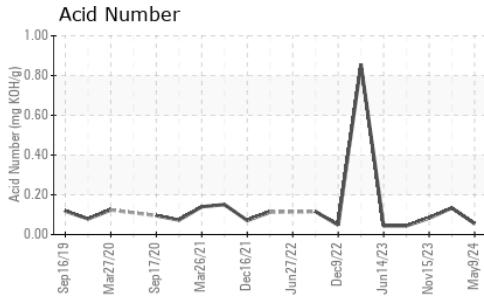

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0025830  
**Lab Number** : 06177773  
**Unique Number** : 11029099  
**Test Package** : PLANT

**Received** : 13 May 2024  
**Tested** : 17 May 2024  
**Diagnosed** : 17 May 2024 - Jonathan Hester

**ENERGY TRANSFER - WAYNE**  
 4410 TREADWELL  
 WAYNE, MI  
 US 48184  
 Contact: SCOTT VERHELLE

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (313)580-0267

F: