

Machine Id
ISUZU 5067010
Component
Diesel Fuel
Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- QTS)

RECOMMENDATION

No corrective action is recommended at this time.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		LF0001649	---	---
Sample Date		Client Info		08 May 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				NORMAL	---	---

CORROSION

All metal levels are normal indicating no corrosion in the system.

Aluminum	ppm	ASTM D5185m	<0.1	0	---	---
Nickel	ppm	ASTM D5185m	<0.1	0	---	---
Lead	ppm	ASTM D5185m	<0.1	0	---	---
Vanadium	ppm	ASTM D5185m	<0.1	<1	---	---
Iron	ppm	ASTM D5185m	<0.1	0	---	---

CONTAMINANTS





The water content is negligible. There is no indication of any contamination in the fuel.

Silicon	ppm	ASTM D5185m	<1.0	<1	---	---
Sodium	ppm	ASTM D5185m	<0.1	1	---	---
Potassium	ppm	ASTM D5185m	<0.1	<1	---	---
Water	%	ASTM D6304	<0.05	0.002	---	---
ppm Water	ppm	ASTM D6304	<500	25	---	---
Calcium	ppm	ASTM D5185m	<0.1	0	---	---
Magnesium	ppm	ASTM D5185m	<0.1	0	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	0	---	---
Zinc	ppm	ASTM D5185m	<0.1	0	---	---

FUEL CONDITION

The condition of the fuel is acceptable for the time in service.

Visc @ 40°C	cSt	ASTM D445	3.0	2.4	---	---
Sulfur	ppm	ASTM D5185m	10	6	---	---

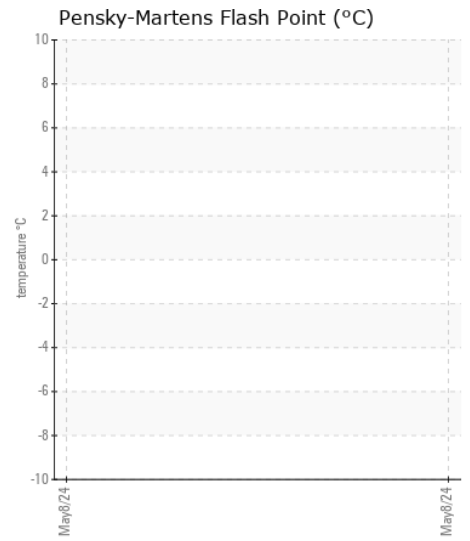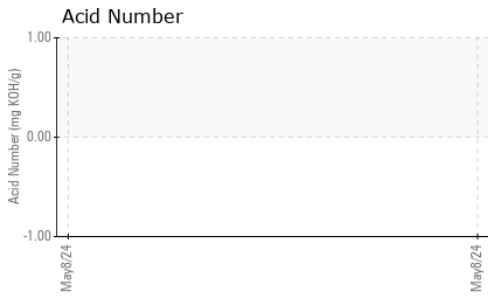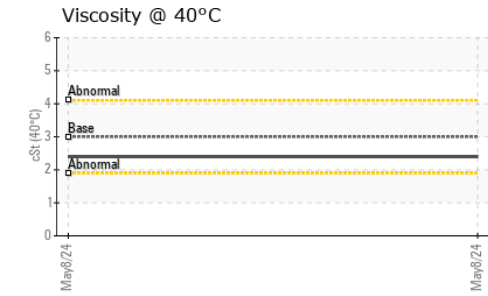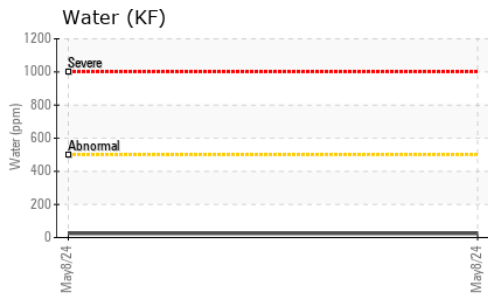

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : LF0001649 **Received** : 13 May 2024
Lab Number : 06178270 **Tested** : 17 May 2024
Unique Number : 11029596 **Diagnosed** : 17 May 2024 - Jonathan Hester
Test Package : MOB 1 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

L&W DIESEL SERVICE
 2600 W 43RD
 ODESSA, TX
 US 79764
 Contact: DREW ALLEN
 drew@lwdiesel.com

T:
F: