



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**AC-3**  
Machine Id

### SAYLOR-BEALL 3-2-K10 - COMP 2 - ENDERLIN WATER TREATMENT

Component  
**Compressor**

#### RECOMMENDATION

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>UCS06186281</b>	UCS05907718	---
Sample Date		Client Info		<b>08 May 2024</b>	20 Jul 2023	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Filter Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed		Client Info		<b>Changed</b>	Changed	---
Filter Changed		Client Info		<b>Not Changed</b>	Not Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

#### WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>4</b>	1	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>1</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>6</b>	6	---
Copper	ppm	ASTM D5185m	>50	<b>3</b>	3	---
Tin	ppm	ASTM D5185m	>15	<b>1</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---

#### CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>2</b>	<1	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	---
Water		WC Method	>0.1	<b>NEG</b>	NEG	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---

#### FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>2</b>	0	---
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	2	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Calcium	ppm	ASTM D5185m		<b>69</b>	52	---
Phosphorus	ppm	ASTM D5185m		<b>1489</b>	1118	---
Zinc	ppm	ASTM D5185m		<b>1486</b>	1261	---
Sulfur	ppm	ASTM D5185m		<b>4017</b>	2943	---
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>2.28</b>	1.64	---
Visc @ 40°C	cSt	ASTM D445		<b>158</b>	157	---

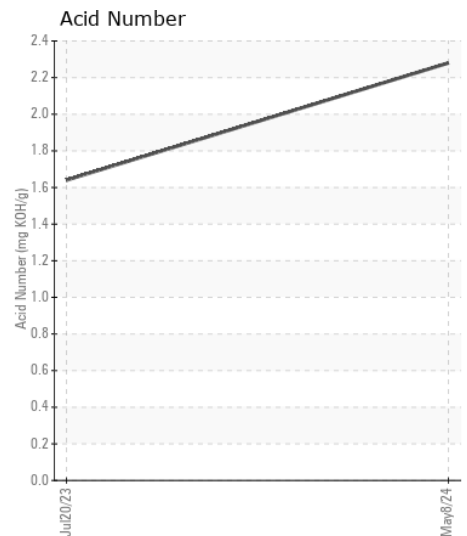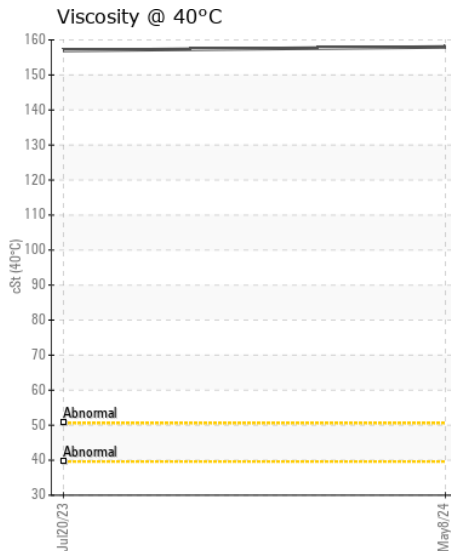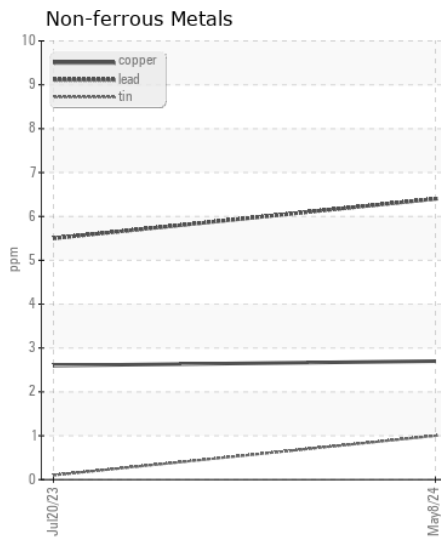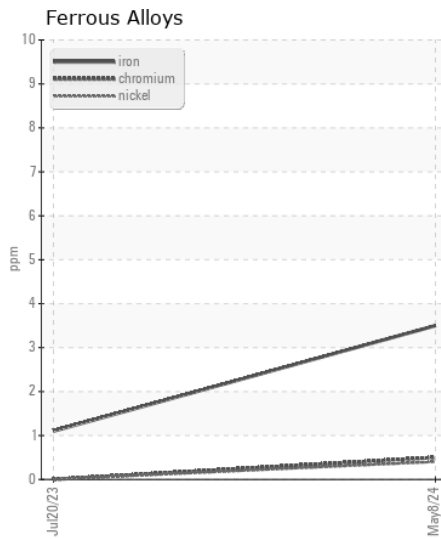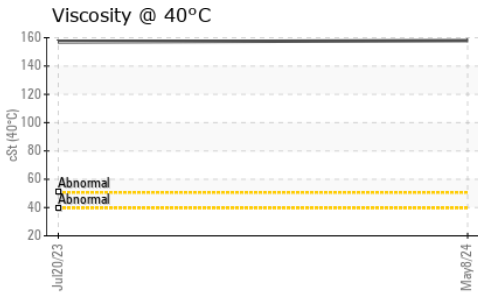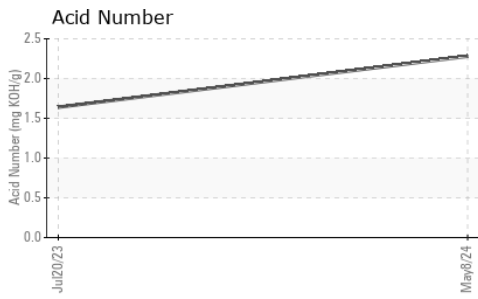

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : UCS06186281

**Lab Number** : 06186281

**Unique Number** : 11043033

**Test Package** : IND 2

**Received** : 21 May 2024

**Tested** : 22 May 2024

**Diagnosed** : 23 May 2024 - Don Baldrige

**JEMCO-MAXAIR**

WEST FARGO, ND  
US 58078

Contact: DALE K  
dalek@jemco-maxair.com

T: (701)281-0362

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)