

Kerr Machine Id KER02 Generator Thrust / Guide Bearings (S/N IS32P756)

Case Drain Thrust Bearing

	F			С)	(C)	L	-		Ś	3	()		6	3	3	(7	7	(C	(C	ì	A	١))												
-	-	 	-	-	-	1	-	-	-	-	-	-	-	-	-	-			-	-	-	-	-	-	-				-	-	-	f	-	-	-	 -	-	-	-	-	-	-	-	-	 •

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
	Sample Number		Client Info		WC0897725	WC0483329	WC0483340
Resample at the next service interval to monitor.	Sample Date		Client Info		14 May 2024	21 Jan 2024	07 Dec 2023
	Machine Age	mths	Client Info		0	0	0
	Oil Age	mths	Client Info		0	0	0
	Filter Age	mths	Client Info		0	0	0
	Oil Changed		Client Info		N/A	N/A	N/A
	Filter Changed		Client Info		N/A	N/A	N/A
	Sample Status				NORMAL	NORMAL	NORMAL
WEAR	Iron	ppm	ASTM D5185m	>85	1	<1	<1
	Chromium	ppm	ASTM D5185m	>20	0	0	0
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		0	0	0
	Titanium	ppm	ASTM D5185m		0	0	0
	Silver	ppm	ASTM D5185m		0	0	0
	Aluminum	ppm	ASTM D5185m	>40	0	0	0
	Lead	ppm	ASTM D5185m		0	0	0
	Copper	ppm	ASTM D5185m		۰ <1	0	0
	Tin	ppm	ASTM D5185m		<1	0	0
	Vanadium	ppm	ASTM D5185m	240	0	0	0
	White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
		Scalai	visual				NONL
CONTAMINATION	Silicon	ppm	ASTM D5185m	>20	1	0	<1
	Potassium	ppm	ASTM D5185m	>20	1	0	0
There is no indication of any contamination in the oil. The amount and	Water	%	ASTM D6304	>2	NEG	NEG	NEG
size of particulates present in the system are acceptable.	Particles >4µm		ASTM D7647	>5000	251	104	69
	Particles >6µm		ASTM D7647	>640	24	41	22
	Particles >14µm		ASTM D7647	>80	3	12	6
	Particles >21µm		ASTM D7647	>20	1	3	1
	Particles >38µm		ASTM D7647	>4	1	0	0
	Particles >71µm		ASTM D7647	>3	0	0	0
	Oil Cleanliness		ISO 4406 (c)	>19/16/13	15/12/9	14/13/11	13/12/10
	Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Debris	scalar	*Visual	NONE	NONE	NONE	NONE
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
	Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
	Odor	scalar	*Visual	NORML	NORML	NORML	NORML
	Emulsified Water		*Visual	>2	NEG	NEG	NEG
FLUID CONDITION	Sodium	ppm	ASTM D5185m		2	1	0
The AN local is seen to be for this field. The second time of the set of	Boron	ppm	ASTM D5185m		0	0	0
The AN level is acceptable for this fluid. The condition of the oil is	Barium	ppm	ASTM D5185m	5	0	0	0
suitable for further service.	Molybdenum	ppm	ASTM D5185m	5	0	0	0
	Manganese	ppm	ASTM D5185m		<1	0	0
	Magnesium	ppm	ASTM D5185m	5	0	0	<1
	Calcium	ppm	ASTM D5185m	5	0	0	0
	Phosphorus	ppm	ASTM D5185m	100	12	7	14
	Zinc	ppm	ASTM D5185m	25	0	0	0
	Sulfur	ppm	ASTM D5185m	1500	837	560	787
	Asid Number (ANI)	ma 1/011/a		0.00	0.00	0.040	0.07

Acid Number (AN) mg KOH/g ASTM D8045 0.08

Visc @ 40°C cSt ASTM D445 68

0.06


67.9


0.046

67.9

0.07

67.6

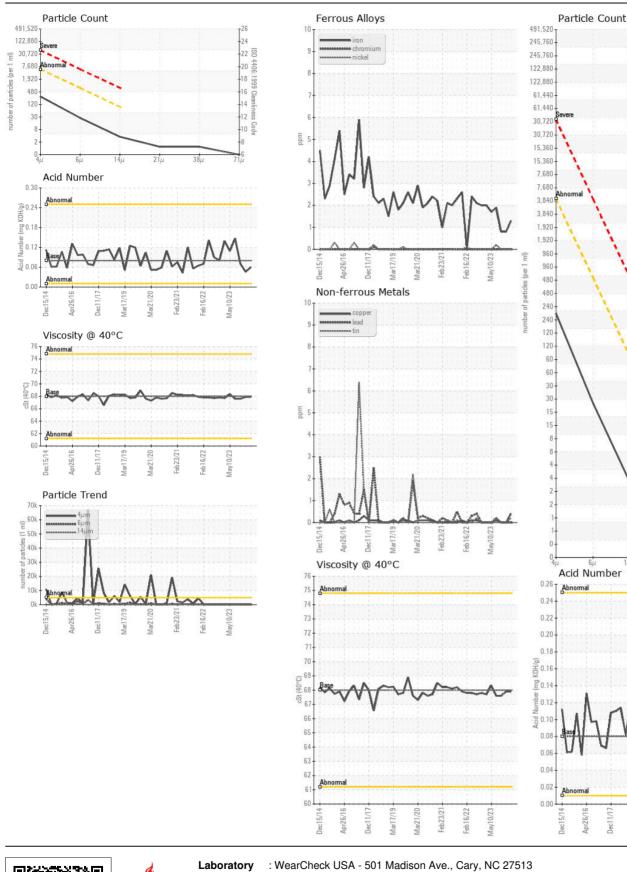

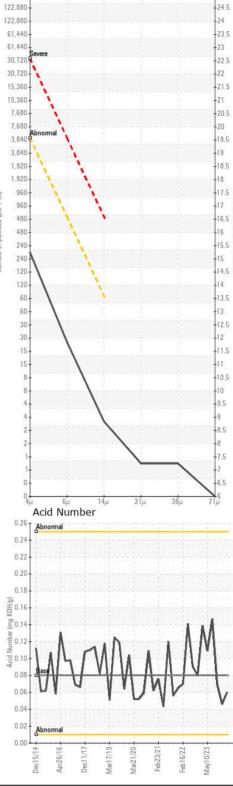

-26

25 5

25

ENERGY KEEPERS INC Sample No. : WC0897725 110 MAIN ST, SUITE 304 Received : 22 May 2024 Lab Number Tested POLSON, MT : 06187641 : 24 May 2024 Unique Number : 11044393 : 24 May 2024 - Don Baldridge US 59860 Diagnosed Test Package : PLANT (Additional Tests: FilterPatch) Contact: GARY PETERSON Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. gary.peterson@energykeepersinc.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (406)872-0229 F: (406)883-1183 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: GARY PETERSON - ENEPOL Page 2 of 2