



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**46S**  
Machine Id  
**4473X52 - FT LORAMIE**  
Component  
**Compressor**

## RECOMMENDATION

Resample at the next service interval to monitor.

## WEAR

All component wear rates are normal.

## CONTAMINATION

There is no indication of any contamination in the oil.

## FLUID CONDITION







The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>UCH06187792</b>	UCH06123862	UCS05952859
Sample Date		Client Info		<b>14 Apr 2024</b>	19 Dec 2023	10 Aug 2023
Machine Age	hrs	Client Info		<b>53515</b>	53128	52703
Oil Age	hrs	Client Info		<b>5315</b>	5128	4703
Filter Age	hrs	Client Info		<b>0</b>	1128	1703
Oil Changed		Client Info		<b>N/A</b>	Changed	N/A
Filter Changed		Client Info		<b>N/A</b>	Changed	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	0	<1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

Silicon	ppm	ASTM D5185m	>25	<b>2</b>	2	2
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	1
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

Sodium	ppm	ASTM D5185m		<b>0</b>	0	0
Boron	ppm	ASTM D5185m	0.9	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0.1	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0.2	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	0.9	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	0	<b>3</b>	0	0
Phosphorus	ppm	ASTM D5185m	224	<b>273</b>	283	291
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	273	<b>235</b>	303	348
Acid Number (AN)	mg KOH/g	ASTM D8045	0.103	<b>0.082</b>	0.085	0.082
Visc @ 40°C	cSt	ASTM D445	41.61	<b>46.9</b>	46.4	46.8

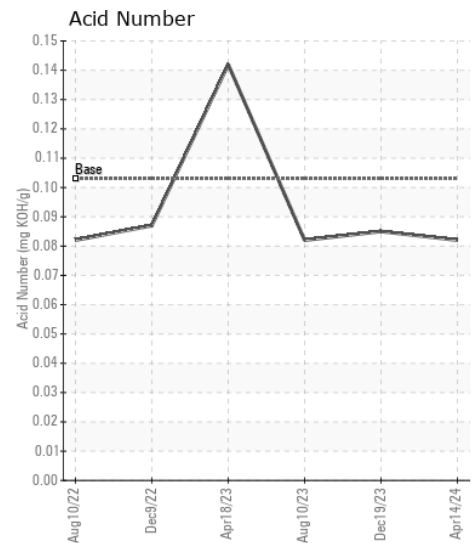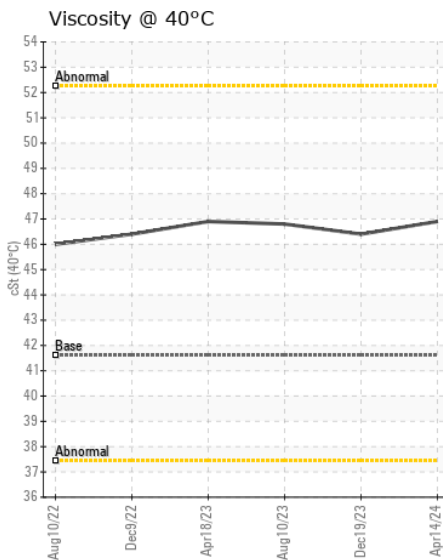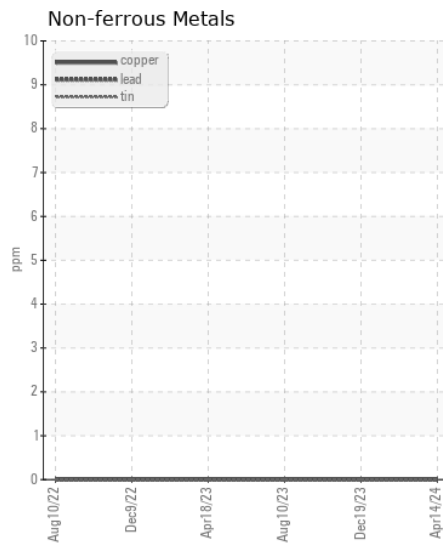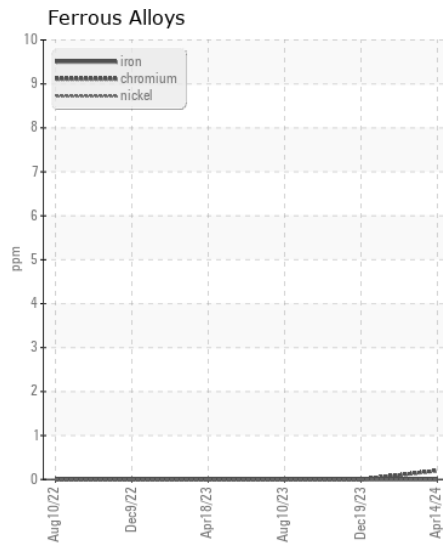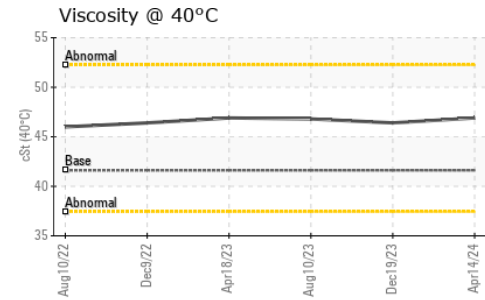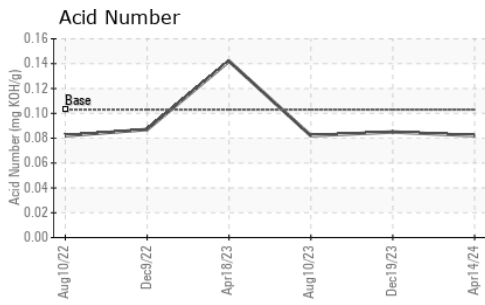

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : UCH06187792

**Lab Number** : 06187792

**Unique Number** : 11044544

**Test Package** : IND 2

**Received** : 22 May 2024

**Tested** : 23 May 2024

**Diagnosed** : 23 May 2024 - Wes Davis

**CROWN BATTERY MFG**

1445 MAJESTIC DR

FREMONT, OH

US 43420

Contact: DOUG CRABILL

DCRABILL@CROWNBATTER.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: