



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**JOHN F SECREST**  
Machine Id  
[JOHN F SECREST] 007 565425-7  
Component  
**Port Genset**  
Fluid  
**CHEVRON DELO 400 LE 15W40 (6 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>MW0068751</b>	MW0065920	MW0061641
Sample Date		Client Info		<b>13 May 2024</b>	13 Mar 2024	06 Jan 2024
Machine Age	hrs	Client Info		<b>11061</b>	10252	9458
Oil Age	hrs	Client Info		<b>410</b>	458	394
Filter Age	hrs	Client Info		<b>410</b>	458	394
Oil Changed		Client Info		<b>Changed</b>	Changed	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>8</b>	7	6
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	0	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>1</b>	<1	4
Silver	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185m	>12	<b>2</b>	4	1
Lead	ppm	ASTM D5185m	>17	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m	>70	<b>&lt;1</b>	2	<1
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**








There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>6</b>	6	7
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	2
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.8</b>	7.4	7.3
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>21.4</b>	22.7	21.8
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>0</b>	1	0
Boron	ppm	ASTM D5185m		<b>419</b>	345	325
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>100</b>	123	103
Manganese	ppm	ASTM D5185m		<b>2</b>	2	2
Magnesium	ppm	ASTM D5185m		<b>469</b>	713	609
Calcium	ppm	ASTM D5185m		<b>1474</b>	1622	1416
Phosphorus	ppm	ASTM D5185m	1200	<b>843</b>	776	746
Zinc	ppm	ASTM D5185m	1300	<b>1080</b>	900	827
Sulfur	ppm	ASTM D5185m	3200	<b>3174</b>	3135	3059
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>16.1</b>	17.1	16.2
Base Number (BN)	mg KOH/g	ASTM D2896	9.6	<b>7.7</b>	8.8	8.3
Visc @ 100°C	cSt	ASTM D445	15.7	<b>12.5</b>	12.4	12.4

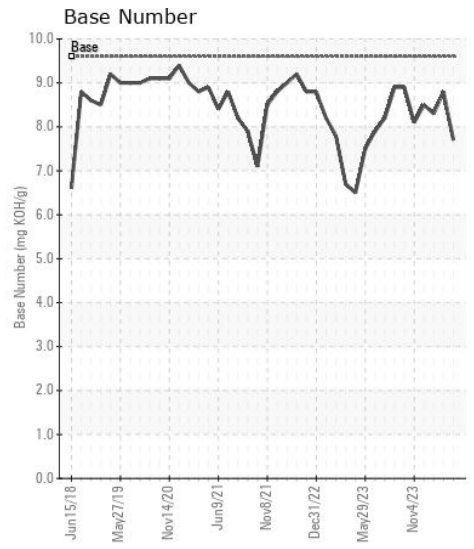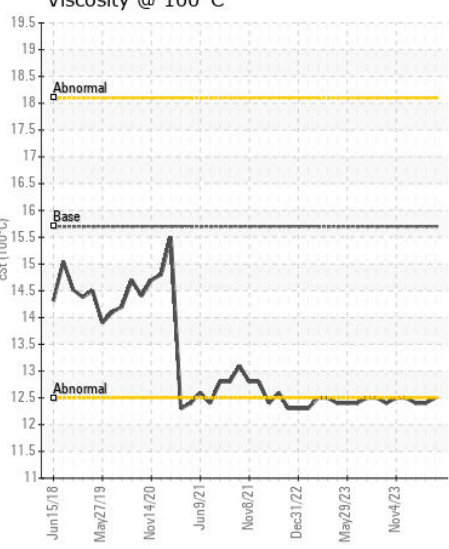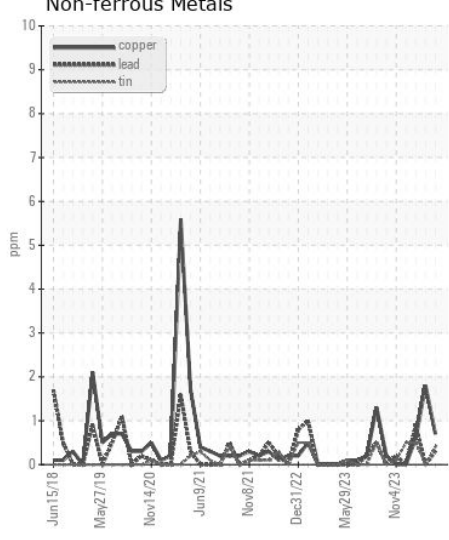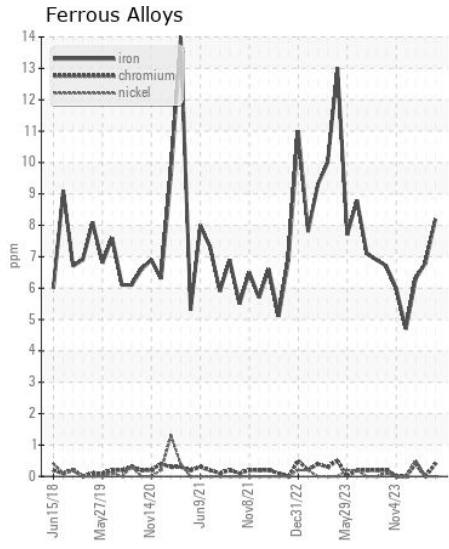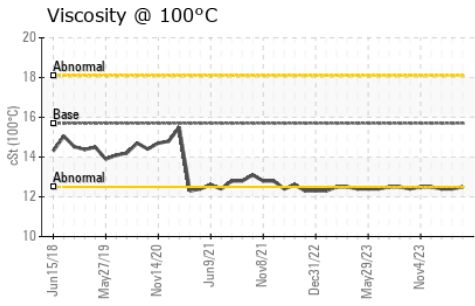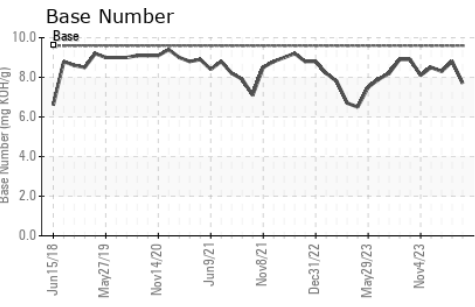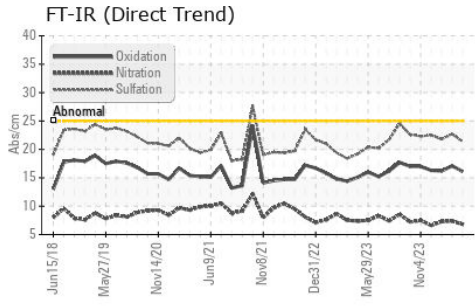

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MW0068751  
**Lab Number** : 06188561  
**Unique Number** : 11045313  
**Test Package** : MAR 2

**Received** : 22 May 2024  
**Tested** : 24 May 2024  
**Diagnosed** : 28 May 2024 - Don Baldrige

**INGRAM BARGE**  
 900 S 3RD ST  
 PADUCAH, KY  
 US 42003  
 Contact: ANTHONY VAN CURA  
 anthony.vancura@ingrambarga.com  
 T: (270)415-4467  
 F: (615)695-3697

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)