



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
REED
 Component
Propane Engine
 Fluid
SHELL ROTELLA T 15W40 (--- QTS)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0933142	---	---
Sample Date		Client Info		13 May 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	22	---	---
Chromium	ppm	ASTM D5185m	>25	1	---	---
Nickel	ppm	ASTM D5185m	>5	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>5	<1	---	---
Aluminum	ppm	ASTM D5185m	>20	3	---	---
Lead	ppm	ASTM D5185m	>25	<1	---	---
Copper	ppm	ASTM D5185m	>35	7	---	---
Tin	ppm	ASTM D5185m	>8	7	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>50	7	---	---
Potassium	ppm	ASTM D5185m	>20	3	---	---
Water		WC Method	>0.1	NEG	---	---
Soot %	%	*ASTM D7844		0.1	---	---
Nitration	Abs/cm	*ASTM D7624	>20	10.2	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	23.4	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185m		8	---	---
Boron	ppm	ASTM D5185m	316	21	---	---
Barium	ppm	ASTM D5185m	0.0	<1	---	---
Molybdenum	ppm	ASTM D5185m	1.2	86	---	---
Manganese	ppm	ASTM D5185m		1	---	---
Magnesium	ppm	ASTM D5185m	24	1106	---	---
Calcium	ppm	ASTM D5185m	2292	1959	---	---
Phosphorus	ppm	ASTM D5185m	1064	1228	---	---
Zinc	ppm	ASTM D5185m	1160	1624	---	---
Sulfur	ppm	ASTM D5185m	4996	4018	---	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	20.8	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	10.1	7.5	---	---
Visc @ 100°C	cSt	ASTM D445	15.7	16.1	---	---

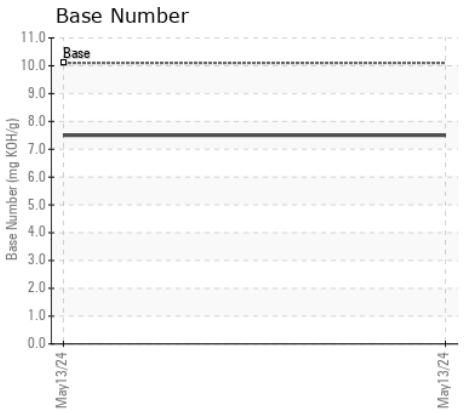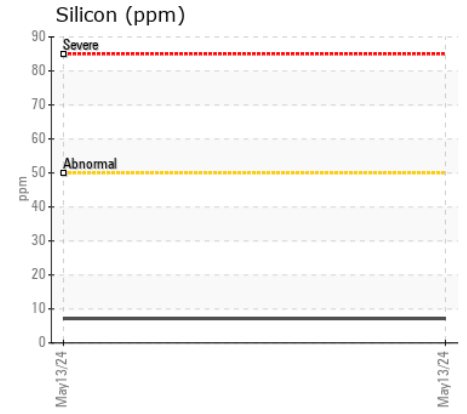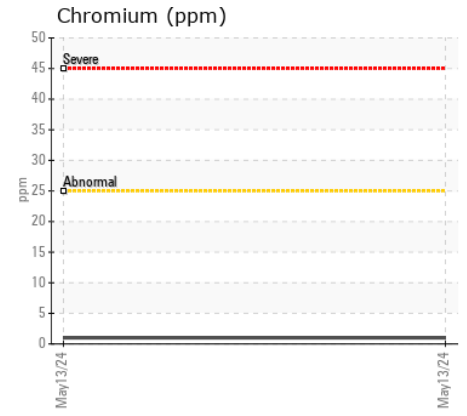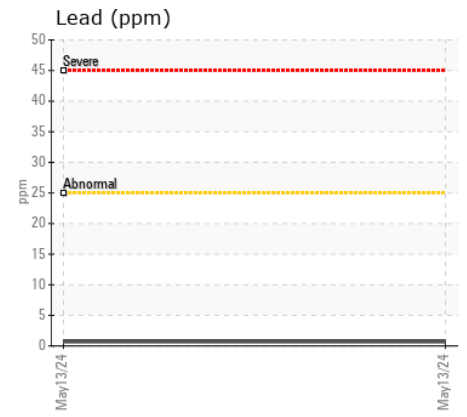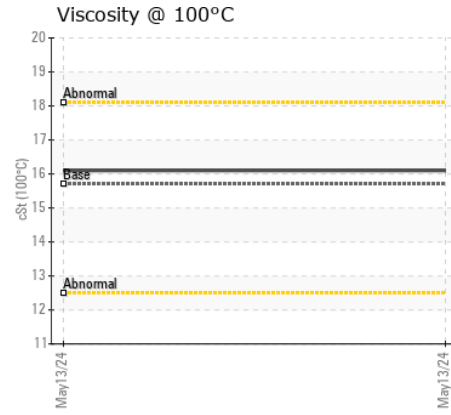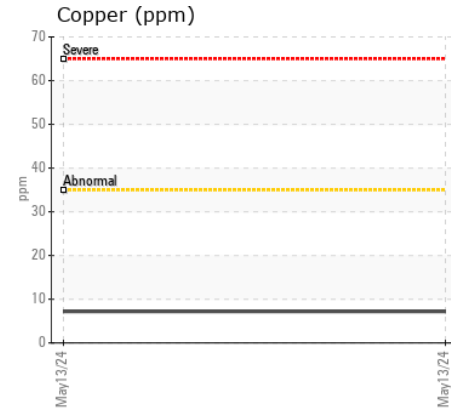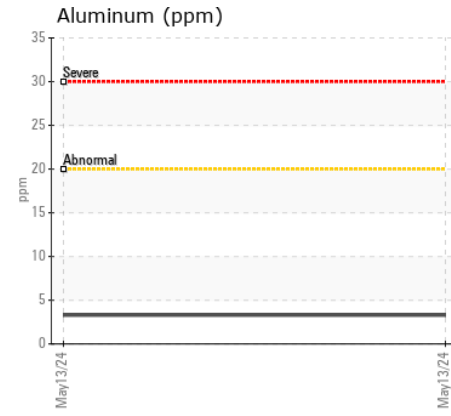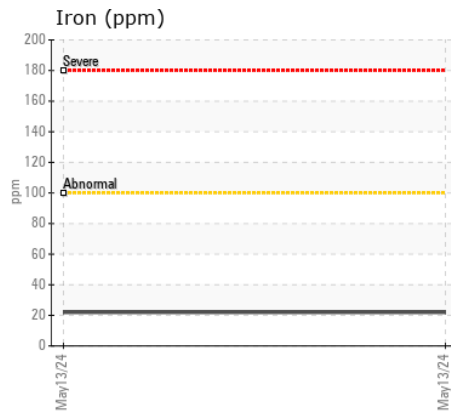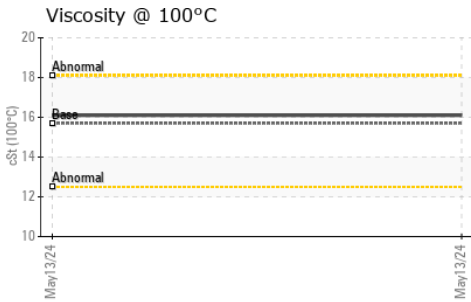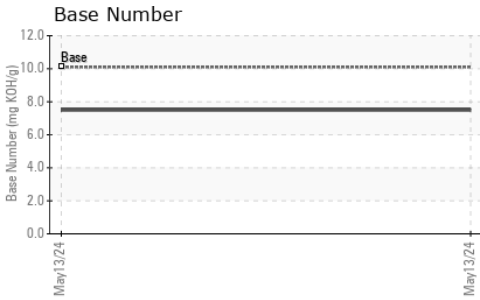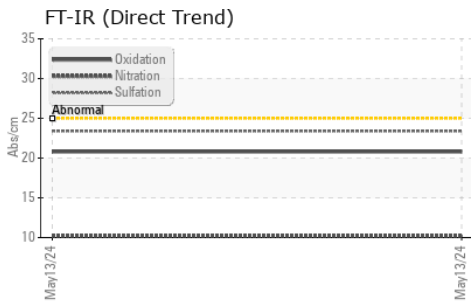

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0933142

Lab Number : 06188852

Unique Number : 11045604

Test Package : MOB 1

Received : 23 May 2024

Tested : 24 May 2024

Diagnosed : 28 May 2024 - Don Baldrige

PIEDMONT GENERATOR

7560 NC HWY 22 NORTH

CLIMAX, NC

US 27233

Contact: TERRY SHEPPARD

terry1pg@bellsouth.net; bill3pg@bellsouth.net

T: (336)685-4859

F: (336)685-5297

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)