



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>ABNORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**QUINCY 3 EAST (S/N UTY201699)**

Component  
**Air Compressor**

Fluid  
**USPI AIR 46 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>USPM36243</b>	USPM30068	USPM31252
Sample Date		Client Info		<b>18 May 2024</b>	12 Feb 2024	04 Nov 2023
Machine Age	hrs	Client Info		<b>50858</b>	50671	49413
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m	>40	<b>2</b>	2	2
Tin	ppm	ASTM D5185m	>5	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

## CONTAMINATION












There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>25	<b>4</b>	3	3
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	2	<1
Water	%	ASTM D6304	>0.2	<b>▲ 0.219</b>	0.080	0.081
ppm Water	ppm	ASTM D6304	>2000	<b>▲ 2198</b>	810	816.6
Particles >4µm		ASTM D7647	>10000	<b>902</b>	624	820
Particles >6µm		ASTM D7647	>2500	<b>157</b>	70	143
Particles >14µm		ASTM D7647	>320	<b>5</b>	4	10
Particles >21µm		ASTM D7647	>80	<b>1</b>	1	3
Particles >38µm		ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>17/14/10</b>	16/13/9	17/14/10
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG

## FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>2</b>	1	0
Boron	ppm	ASTM D5185m	0	<b>2</b>	2	<1
Barium	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	0	<b>1</b>	0	<1
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	1	<b>15</b>	2	0
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	0	<b>39</b>	<1	0
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	<b>1.35</b>	1.27	1.25
Visc @ 40°C	cSt	ASTM D445	49.7	<b>66.3</b>	67.9	66.7

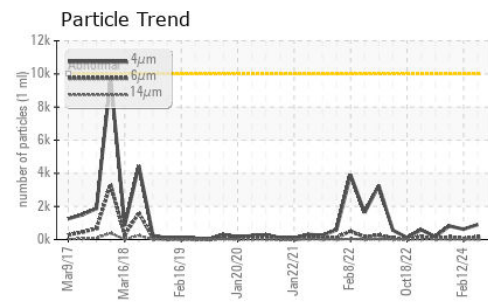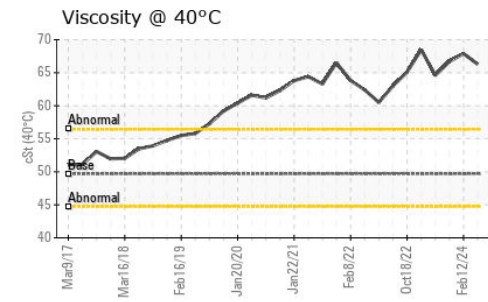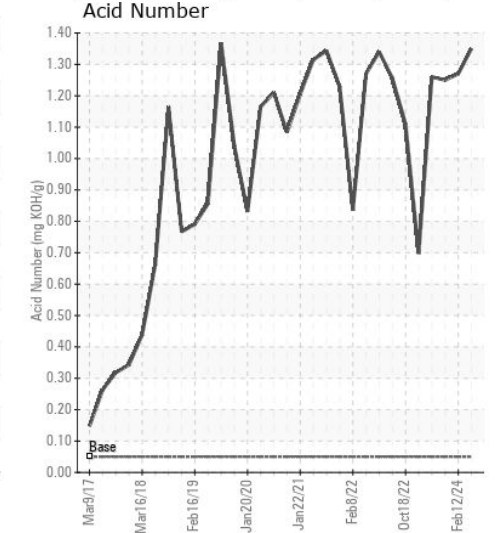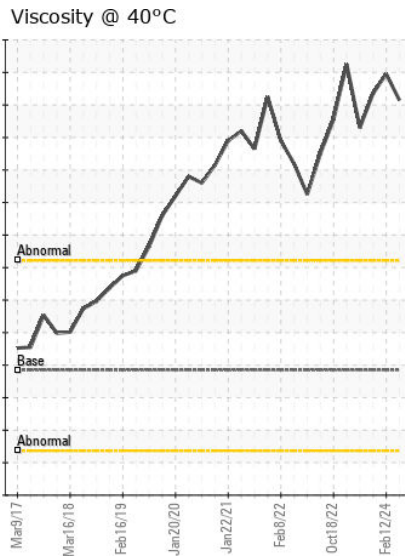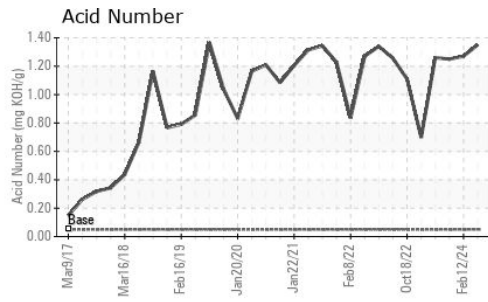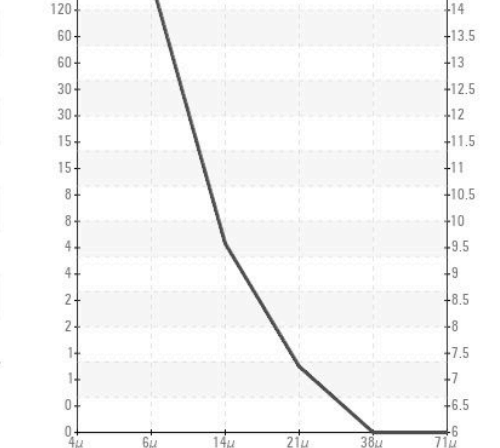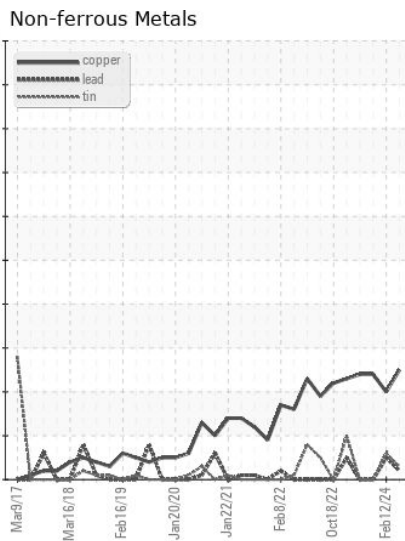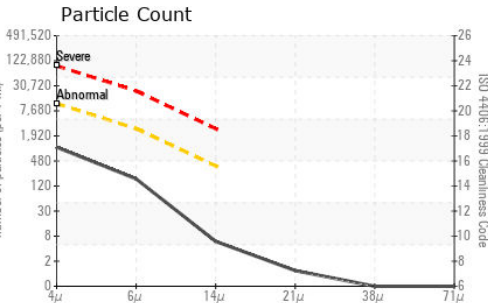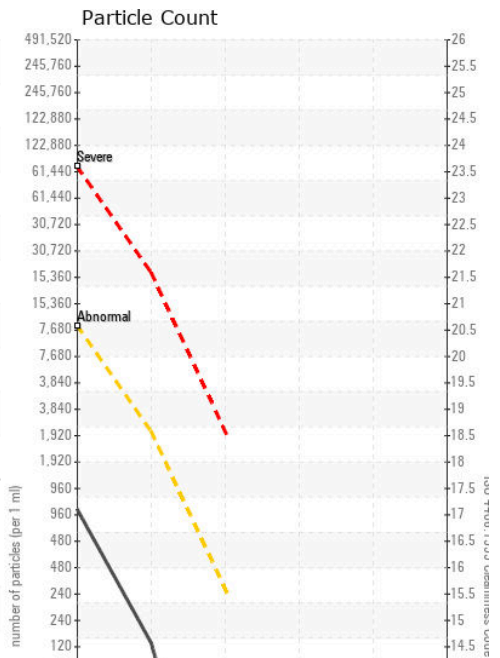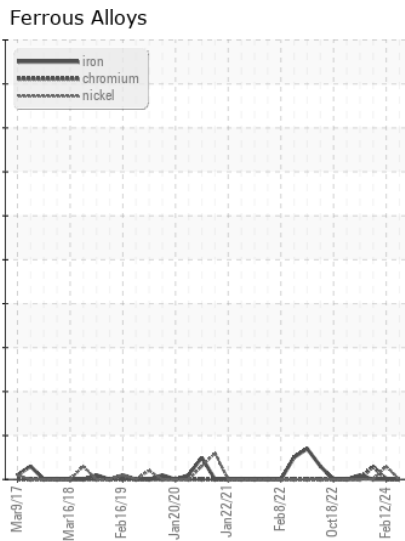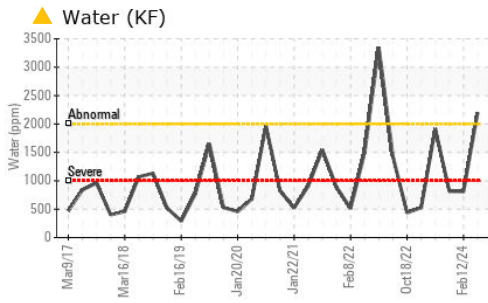

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM36243  
**Lab Number** : 06189210  
**Unique Number** : 11045962  
**Test Package** : IND 2  
**Received** : 23 May 2024  
**Tested** : 24 May 2024  
**Diagnosed** : 29 May 2024 - Jonathan Hester

**TYSON-ROBARDS-USP**

ROBARDS, KY  
 US

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: