WEAR CONTAMINATION FLUID CONDITION

NORMAL MARGINAL NORMAL


BLUE TRITON

BLUE TRITON CHILLER 1 (S/N F03842FMCW1GA11)

Refrigeration Compressor

FRICK COMPRESSOR OIL #11 (-

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		USP0011519		
	Sample Date		Client Info		02 May 2024		
	Machine Age	hrs	Client Info		92037		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				MARGINAL		
WEAR	Iron	ppm	ASTM D5185m	>8	0		
	Chromium	ppm	ASTM D5185m		0		
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m	>2	<1		
	Aluminum	ppm	ASTM D5185m		0		
	Lead	ppm	ASTM D5185m	>2	0		
	Copper	ppm	ASTM D5185m	>8	0		
	Tin	ppm	ASTM D5185m	>4	0		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTABBINATION	Ciliaan		ACTM DE10E	4.5	4		
CONTAMINATION	Silicon	ppm	ASTM D5185m		<1		
here is a trace of moisture present in the oil(confirmed). The amount	Potassium	ppm	ASTM D5185m		0		
and size of particulates present in the system are acceptable.	Water	%	ASTM D6304		▲ 0.011		
	ppm Water	ppm	ASTM D6304		<u>115</u>		
	Particles >4μm Particles >6μm		ASTM D7647 ASTM D7647		1439 320		
	Particles >14µm		ASTM D7647		8		
	Particles >21µm		ASTM D7647		1		
	Particles >38µm		ASTM D7647		0		
	Particles >71µm		ASTM D7647		0		
	Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/15/10		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water		*Visual	>0.01	NEG		
LUID CONDITION	Sodium	ppm	ASTM D5185m		<1		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m		0		
	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m		0		
	Calcium	ppm	ASTM D5185m		0		
	Phosphorus	ppm	ASTM D5185m		0		
	Zinc	ppm	ASTM D5185m		0		
	Sulfur Acid Number (AN)	ppm mg KOH/g	ASTM D5185m ASTM D974		0 0.013		
			4 > 1 N/1 1 19 / A		0.013		

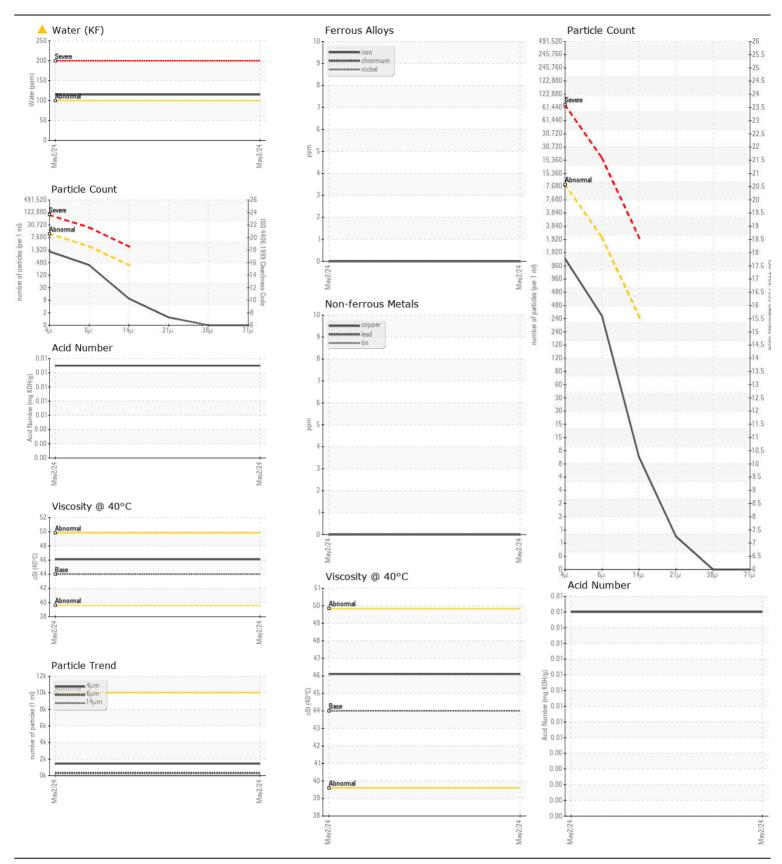



Certificate L2367

Laboratory Sample No. Lab Number

: USP0011519 : 06189271 Unique Number : 11046023 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 23 May 2024 **Tested**

: 29 May 2024 : 29 May 2024 - Jonathan Hester Diagnosed

RACE ENGINEERING CORP 12871 WESTERN AVE, SUITE E GARDEN GROVE, CA

US 92841 Contact: TODD CARTER

tcrace@verizon.net T: (714)895-3488

F: (714)895-5125

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)