



PERFORMANCE
UNDER
PRESSURE

OIL ANALYSIS REPORT

WEAR	MARGINAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
TOLE_U5 TOLE_U5_P5
Component
Non-Drive End Pump
Fluid
ROYAL PURPLE SYNFILM GT 32 (2 QTS)

RECOMMENDATION

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		RP0029081	RP0025894	RP0034029
Sample Date		Client Info		15 May 2024	21 Feb 2024	16 Nov 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				MARGINAL	MARGINAL	ABNORMAL

WEAR

Bearing and/or bushing wear is indicated.

Iron	ppm	ASTM D5185m	>90	5	7	6
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m	>5	<1	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>7	<1	0	0
Lead	ppm	ASTM D5185m	>12	6	5	8
Copper	ppm	ASTM D5185m	>30	▲ 52	▲ 61	▲ 80
Tin	ppm	ASTM D5185m	>9	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION









The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>60	2	<1	<1
Potassium	ppm	ASTM D5185m	>20	<1	0	<1
Water	%	ASTM D6304	>.1	0.006	0.003	0.006
ppm Water	ppm	ASTM D6304	>1000	63	36	69
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		2	<1	1
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		6	14	2
Calcium	ppm	ASTM D5185m		0	0	<1
Phosphorus	ppm	ASTM D5185m		0	4	4
Zinc	ppm	ASTM D5185m		<1	1	0
Acid Number (AN)	mg KOH/g	ASTM D8045		0.596	0.47	0.548
Visc @ 40°C	cSt	ASTM D445	32	32.0	32.9	32.2

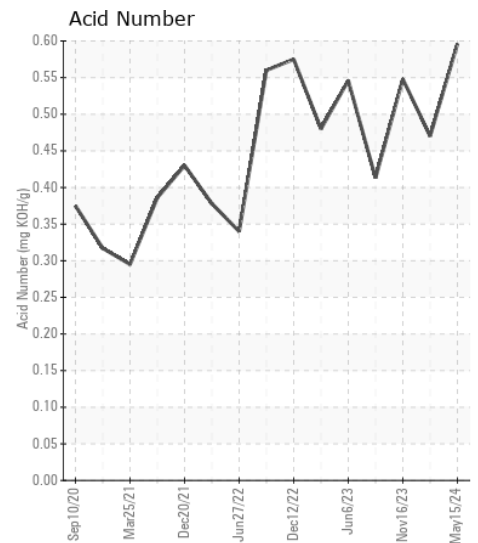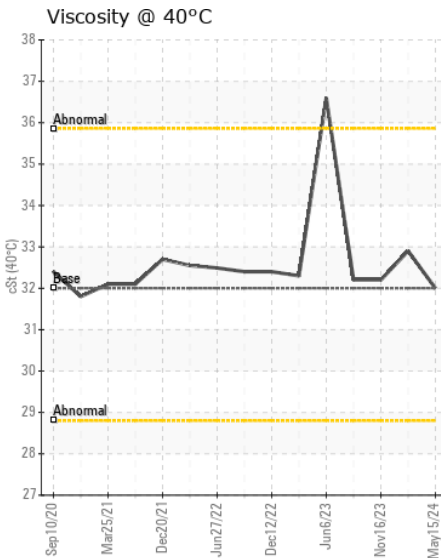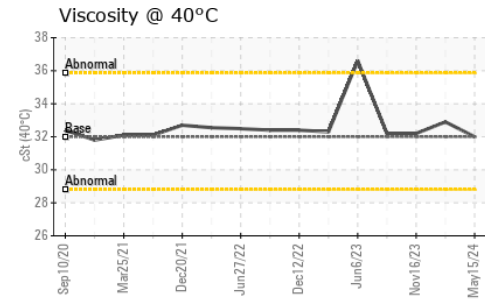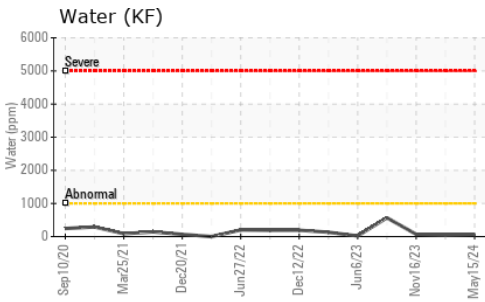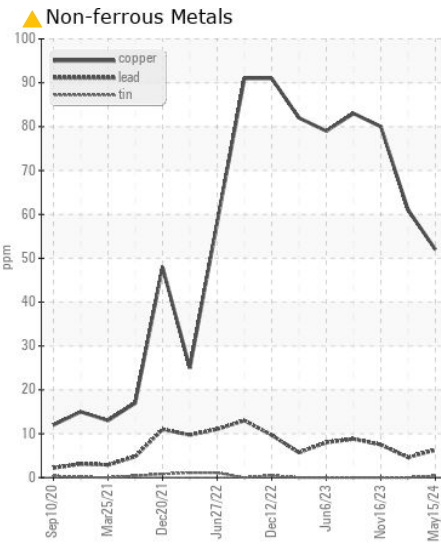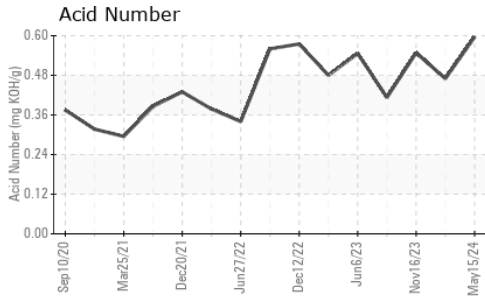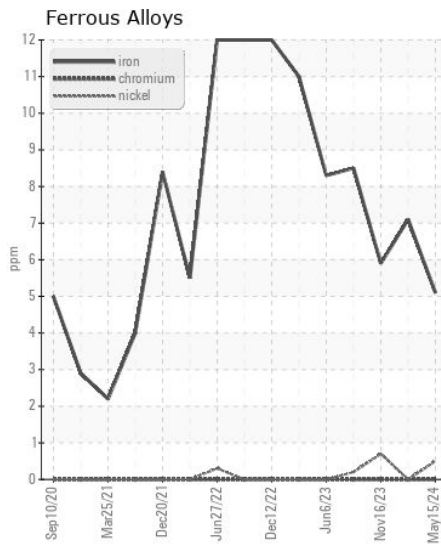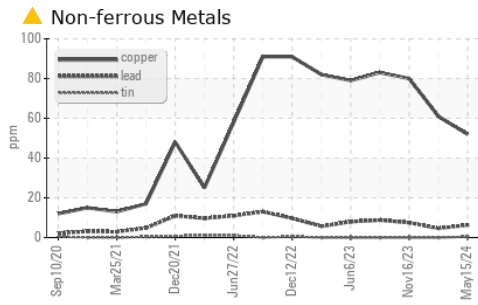

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0029081
Lab Number : 06189338
Unique Number : 11046090
Test Package : PLANT

ENERGY TRANSFER - TOLEDO
 2549 BROWN ROAD
 OREGON, OH
 US 43616
 Contact: DARREN GRANT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (419)389-7403

F: