



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
21312
 Component
Compressor
 Fluid
INGERSOLL-RAND TECHTROL GOLD (30 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CCSI2013599	CCSI2012154	CCSI2012174
Sample Date		Client Info		21 May 2024	01 Mar 2024	27 Nov 2023
Machine Age	hrs	Client Info		14083	12945	11955
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	Not Changed
Filter Changed		Client Info		Not Changed	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	<1
Nickel	ppm	ASTM D5185m		0	<1	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	<1
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	0	0	0
Tin	ppm	ASTM D5185m	>15	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION









There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>25	1	0	1
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water		WC Method	>0.1	NEG	NEG	NEG
Particles >4µm		ASTM D7647	>10000	1704	243	▲ 30632
Particles >6µm		ASTM D7647	>2500	289	40	▲ 16103
Particles >14µm		ASTM D7647	>320	12	5	▲ 3424
Particles >21µm		ASTM D7647	>80	3	1	▲ 1090
Particles >38µm		ASTM D7647	>20	0	0	▲ 49
Particles >71µm		ASTM D7647	>4	0	0	1
Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/15/11	15/12/10	▲ 22/21/19
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<1	0	0
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	2	0
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		0	2	<1
Calcium	ppm	ASTM D5185m		0	2	3
Phosphorus	ppm	ASTM D5185m		145	118	136
Zinc	ppm	ASTM D5185m		0	12	0
Sulfur	ppm	ASTM D5185m		0	0	0
Acid Number (AN)	mg KOH/g	ASTM D8045	0.10	1.02	0.96	0.74
Visc @ 40°C	cSt	ASTM D445	24.6	38.8	39.1	38.5

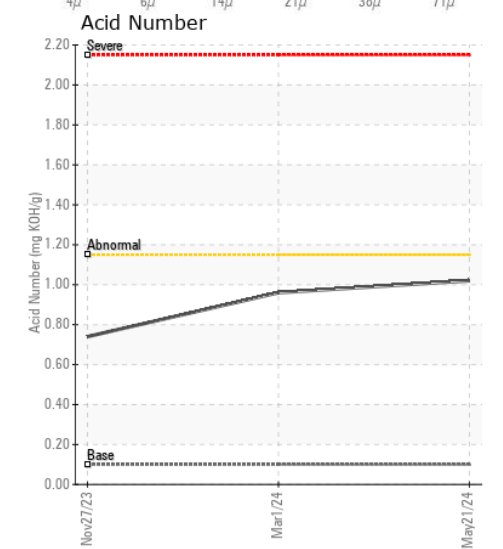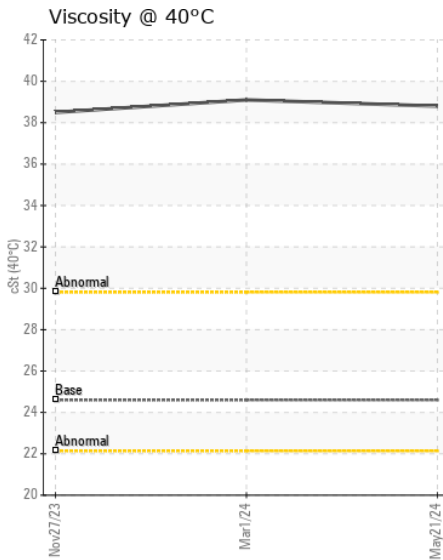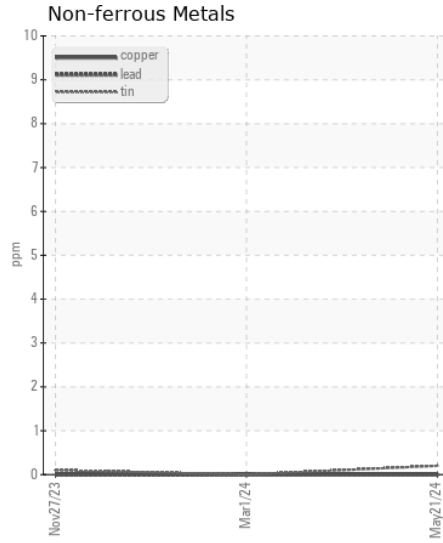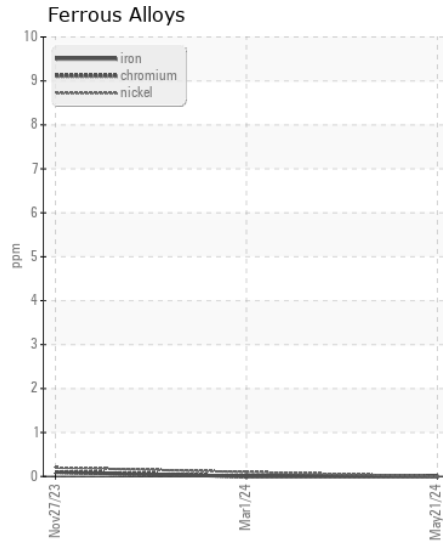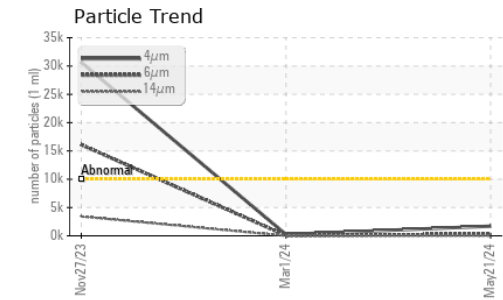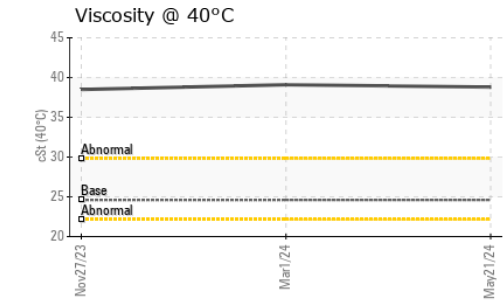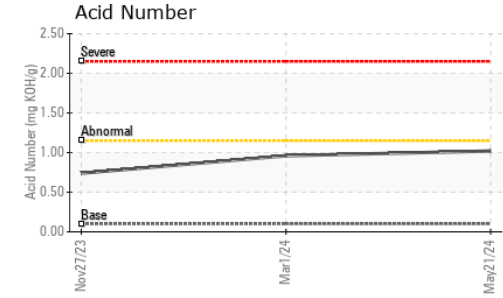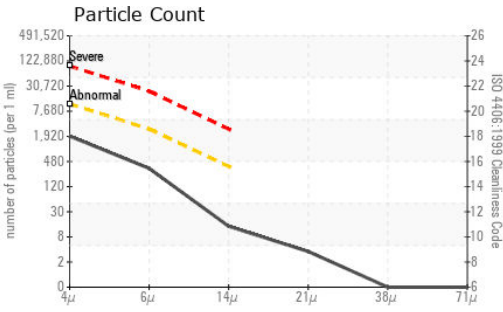

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : CCSI2013599 **Received** : 24 May 2024
Lab Number : 06191007 **Tested** : 29 May 2024
Unique Number : 11047759 **Diagnosed** : 29 May 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: PrtCount)

WOLFSPEED
 5757 MARCY-SUNY PKWY
 MARCY, NY
 US 13403
 Contact: PAUL GOTTE
 paul.gotte@wolfspeed.com
 T: (315)404-7019
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)