



OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**21314**  
 Component  
**Compressor**  
 Fluid  
**INGERSOLL-RAND TECHTROL GOLD TL (30 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>CCSI2013612</b>	CCSI2012146	CCSI2012165
Sample Date		Client Info		<b>21 May 2024</b>	01 Mar 2024	27 Nov 2023
Machine Age	hrs	Client Info		<b>17448</b>	15649	13636
Oil Age	hrs	Client Info		<b>0</b>	0	13636
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Not Changd</b>	Not Changd	Not Changd
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	ATTENTION

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**










There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>25	<b>2</b>	<1	2
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Particles >4µm		ASTM D7647	>10000	<b>468</b>	498	8613
Particles >6µm		ASTM D7647	>2500	<b>77</b>	165	3679
Particles >14µm		ASTM D7647	>320	<b>8</b>	19	593
Particles >21µm		ASTM D7647	>80	<b>2</b>	6	180
Particles >38µm		ASTM D7647	>20	<b>0</b>	0	8
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	2
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>16/13/10</b>	16/15/11	20/19/16
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	1	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	1	<1
Calcium	ppm	ASTM D5185m		<b>0</b>	<1	1
Phosphorus	ppm	ASTM D5185m		<b>139</b>	144	133
Zinc	ppm	ASTM D5185m		<b>0</b>	10	0
Sulfur	ppm	ASTM D5185m		<b>0</b>	0	0
Acid Number (AN)	mg KOH/g	ASTM D8045	0.25	<b>1.05</b>	0.90	0.83
Visc @ 40°C	cSt	ASTM D445	37	<b>39.41</b>	39.1	39.1

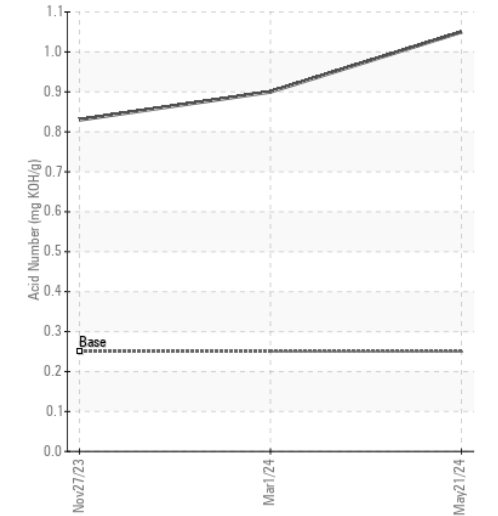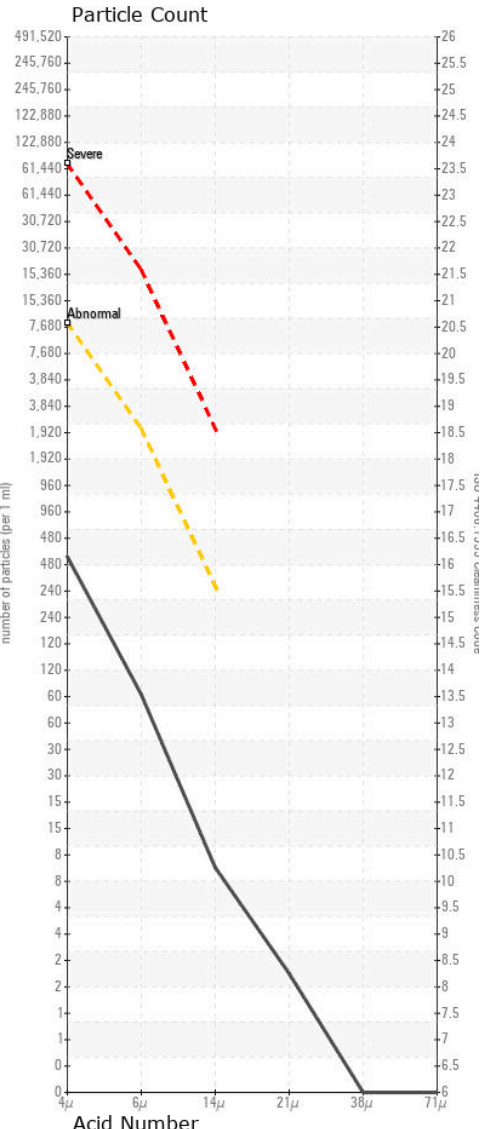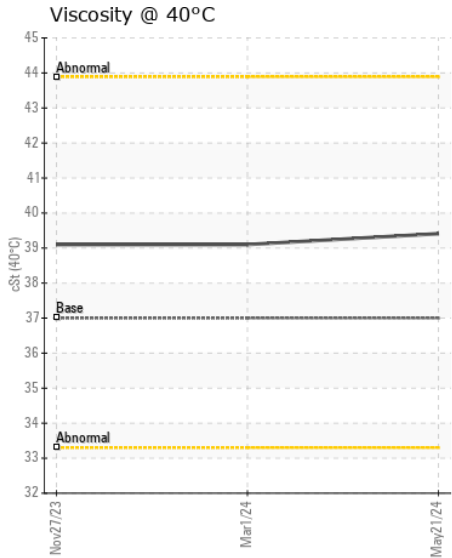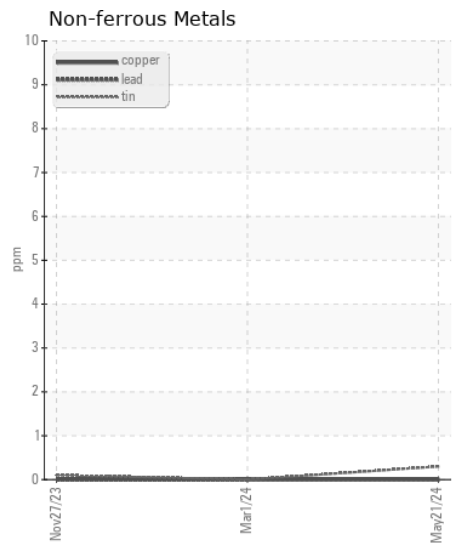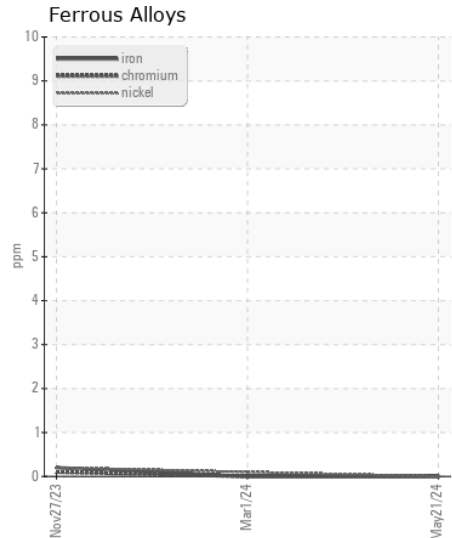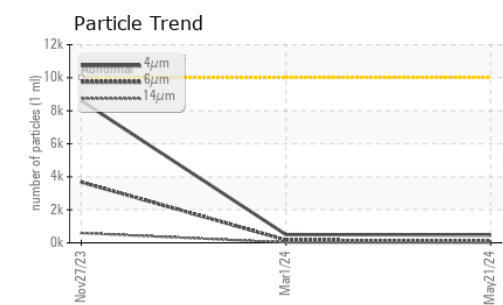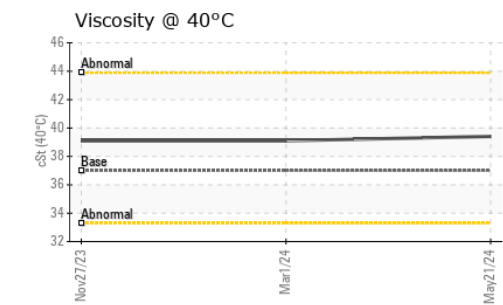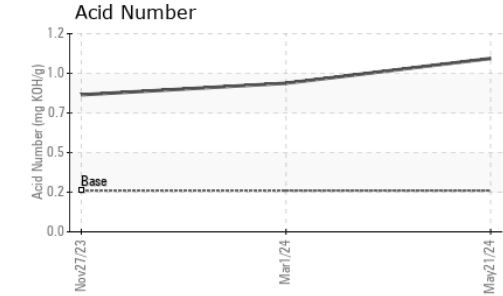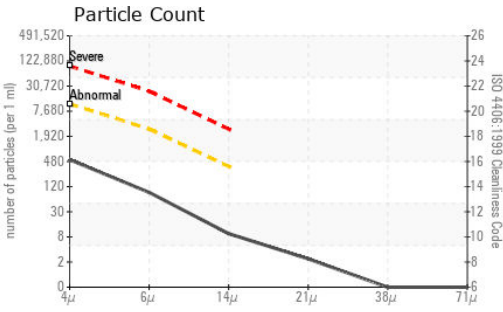

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : CCSI2013612 **Received** : 24 May 2024  
**Lab Number** : 06191008 **Tested** : 03 Jun 2024  
**Unique Number** : 11047760 **Diagnosed** : 03 Jun 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**WOLFSPEED**  
 5757 MARCY-SUNY PKWY  
 MARCY, NY  
 US 13403  
 Contact: PAUL GOTTE  
 paul.gotte@wolfspeed.com  
 T: (315)404-7019  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)