



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	ABNORMAL



Area  
**RIG 2**  
Machine Id  
**CATERPILLAR 3512 R2-G-02-NKL**  
Component  
**Diesel Engine**  
Fluid  
**CHEVRON 15W40 (--- GAL)**

## RECOMMENDATION

We advise that you check the fuel injection system. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>KL0014262</b>	KL0014242	KL0013902
Sample Date		Client Info		<b>14 May 2024</b>	03 Apr 2024	15 Feb 2024
Machine Age	days	Client Info		<b>45416</b>	45375	45337
Oil Age	days	Client Info		<b>0</b>	0	0
Filter Age	days	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	<b>4</b>	3	1
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	>2	<b>4</b>	11	0
Silver	ppm	ASTM D5185m	>2	<b>1</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	1	4
Lead	ppm	ASTM D5185m	>40	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m	>330	<b>1</b>	1	<1
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

## CONTAMINATION











There is a moderate amount of particulates present in the oil. There is a moderate amount of fuel present in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>6</b>	8	11
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	3	2
Fuel	%	ASTM D3524	>5	<b>▲ 5.9</b>	<1.0	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844	>3	<b>0.2</b>	0.2	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.7</b>	7.3	6.8
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>20.2</b>	17.6	23.5
Particles >4µm		ASTM D7647	>20000	<b>8873</b>	3132	2584
Particles >6µm		ASTM D7647	>5000	<b>4834</b>	1706	1407
Particles >14µm		ASTM D7647	>640	<b>● 823</b>	290	240
Particles >21µm		ASTM D7647	>160	<b>● 277</b>	98	81
Particles >38µm		ASTM D7647	>40	<b>● 43</b>	15	12
Particles >71µm		ASTM D7647	>10	<b>4</b>	2	1
Oil Cleanliness		ISO 4406 (c)	>21/19/16	<b>● 20/19/17</b>	19/18/15	19/18/15
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. Fuel is present in the oil and is lowering the viscosity.

Sodium	ppm	ASTM D5185m	>50	<b>2</b>	2	<1
Boron	ppm	ASTM D5185m		<b>353</b>	128	331
Barium	ppm	ASTM D5185m		<b>1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>69</b>	37	121
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>440</b>	672	664
Calcium	ppm	ASTM D5185m		<b>1310</b>	1416	1446
Phosphorus	ppm	ASTM D5185m		<b>835</b>	680	702
Zinc	ppm	ASTM D5185m		<b>1051</b>	744	851
Sulfur	ppm	ASTM D5185m		<b>3069</b>	3253	2430
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>14.4</b>	12.4	17.4
Base Number (BN)	mg KOH/g	ASTM D2896		<b>8.12</b>	8.80	10.22
Visc @ 100°C	cSt	ASTM D445	14.4	<b>▲ 11.9</b>	13.2	13.3

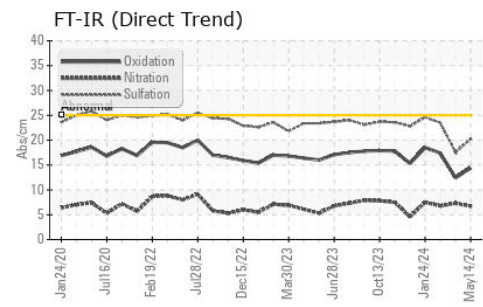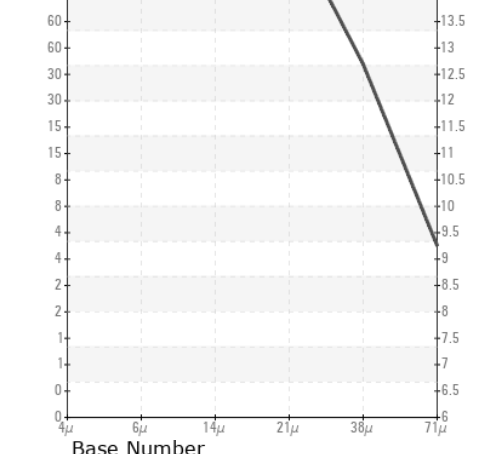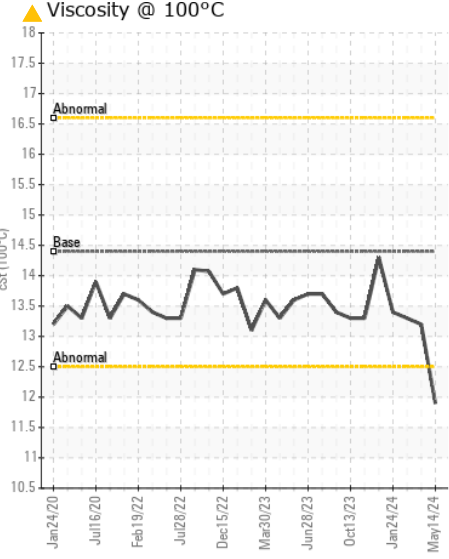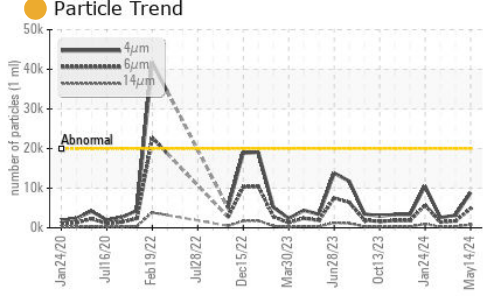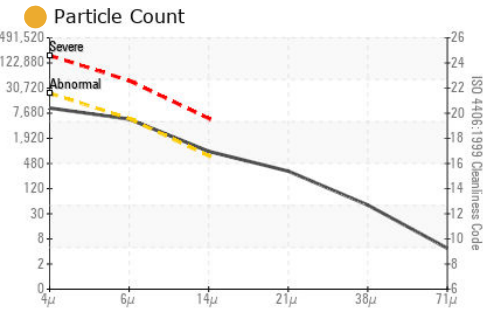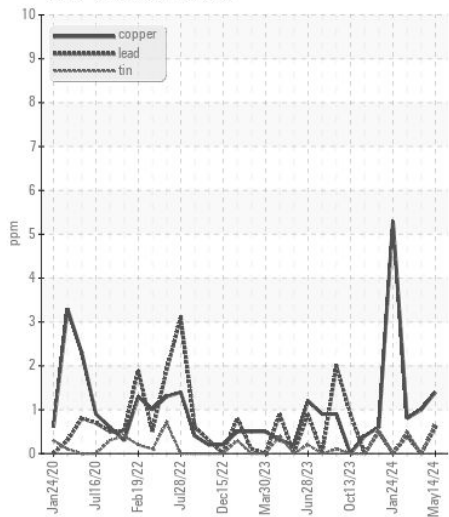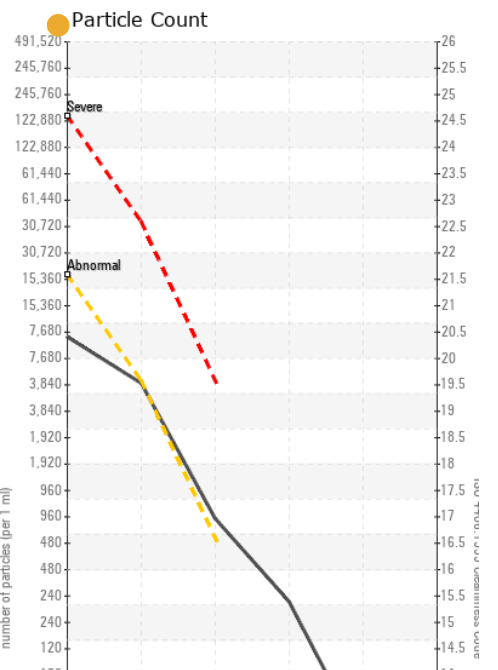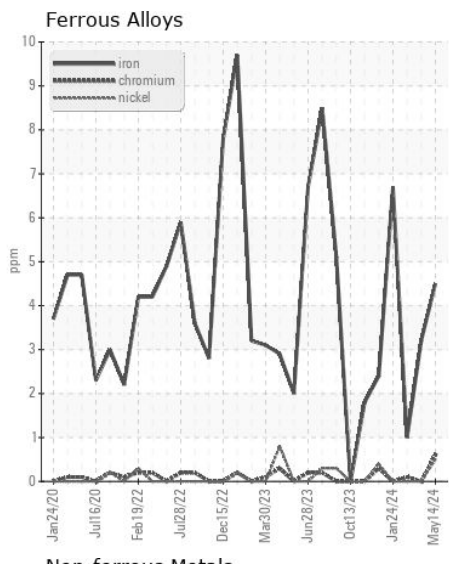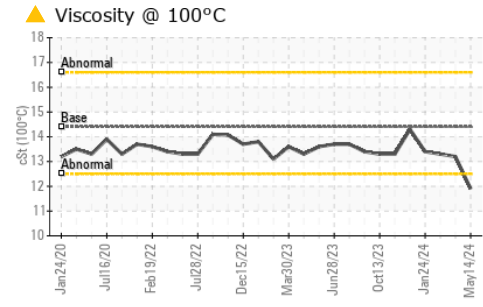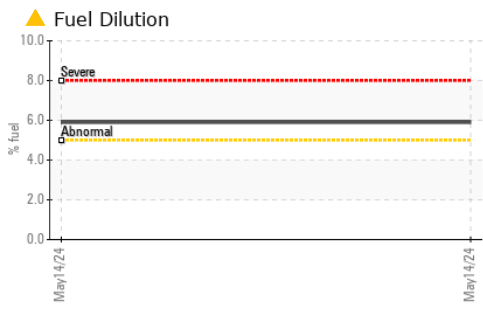

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KL0014262  
**Lab Number** : 06191206  
**Unique Number** : 11047958  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel, PrtCount )

**CITADEL DRILLING**  
 7550 W 120  
 ODESSA, TX  
 US 79763  
 Contact: MIKE COMBDEN  
 mcombden@citadelldrilling.com  
 T: (780)955-5509  
 F:

Received : 24 May 2024  
 Tested : 30 May 2024  
 Diagnosed : 30 May 2024 - Don Baldrige  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)