

Area PALASYN 45 SULLIVAN PALATEK 24CE005072 - PROFAB omponen Compressor


RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		UCS06192348		
	Sample Date		Client Info		15 May 2024		
	Machine Age	hrs	Client Info		130		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
WEAR	Iron	ppm	ASTM D5185m	>50	0		
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>10	0		
	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m		<1		
	Aluminum	ppm	ASTM D5185m	>25	0		
	Lead	ppm	ASTM D5185m	>25	0		
	Copper	ppm	ASTM D5185m	>50	0		
	Tin	ppm	ASTM D5185m	>15	0		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	2		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m		0		
	Water	ppm	WC Method	>0.1	NEG		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m		0		
	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m		0		
	Calcium	ppm	ASTM D5185m		0		
			AOTH DELOF				
	Phosphorus	ppm	ASTM D5185m		678		
	Phosphorus Zinc	ppm	ASTM D5185m	0	0		
	Phosphorus		ASTM D5185m ASTM D5185m	0 1309			


Visc @ 40°C cSt

Contact/Location: SCOTT HARPER - UCAPPLAK

41.8

ASTM D445 39.9

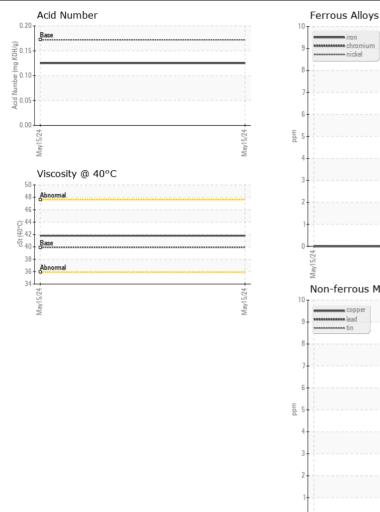

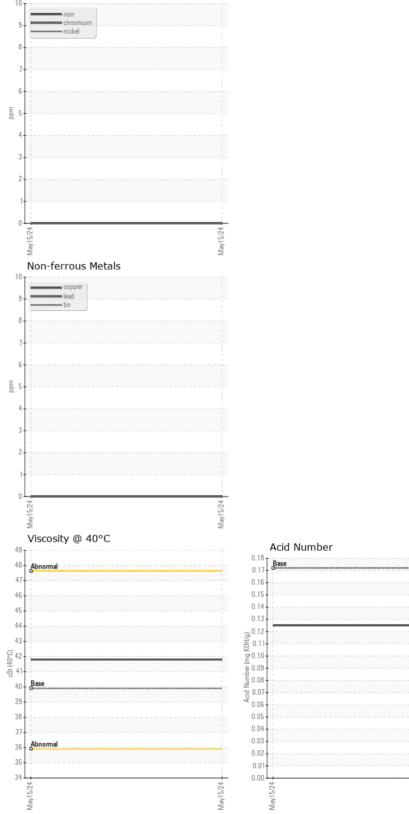



: WearCheck USA - 501 Madison Ave., Cary, NC 27513 **APPLIED AIR SYSTEMS** Laboratory Sample No. : UCS06192348 Received : 28 May 2024 Lab Number : 06192348 Tested : 29 May 2024 LAKEVILLE, MN Unique Number : 11049100 Diagnosed : 29 May 2024 - Wes Davis US 55044 Test Package : IND 2 Contact: SCOTT HARPER Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. sc@appliedairsystems.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (952)388-3122 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F:

Contact/Location: SCOTT HARPER - UCAPPLAK Page 2 of 2

Mav15/24