



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
Co-Gen - Utilities
Machine Id
40-2020 - MILL AC 3
Component
Air Compressor
Fluid
PENNZOIL DEXRON MERCON ATF FLUID (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PE0002221	PE0001551	PE0001465
Sample Date		Client Info		08 May 2024	25 Mar 2024	29 Dec 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	2000	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

PQ	UOM	Method	Limit/Abn	Current	History1	History2
PQ		ASTM D8184		13	15	11
Iron	ppm	ASTM D5185m	>50	0	1	0
Chromium	ppm	ASTM D5185m	>4	0	<1	0
Nickel	ppm	ASTM D5185m	>4	1	0	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		<1	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	2	0
Lead	ppm	ASTM D5185m	>20	<1	0	0
Copper	ppm	ASTM D5185m	>40	10	25	12
Tin	ppm	ASTM D5185m	>5	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION











There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>25	2	0	0
Potassium	ppm	ASTM D5185m	>20	4	2	<1
Water		WC Method	>0.6	NEG	NEG	NEG
Particles >4µm		ASTM D7647	>10000	1877	914	440
Particles >6µm		ASTM D7647	>2500	135	241	124
Particles >14µm		ASTM D7647	>320	16	18	13
Particles >21µm		ASTM D7647	>80	5	3	4
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/14/11	17/15/11	16/14/11
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		11	7	15
Boron	ppm	ASTM D5185m		10	0	0
Barium	ppm	ASTM D5185m		0	<1	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		3	4	0
Calcium	ppm	ASTM D5185m		110	204	99
Phosphorus	ppm	ASTM D5185m		225	269	215
Zinc	ppm	ASTM D5185m		8	37	0
Sulfur	ppm	ASTM D5185m		921	640	237
Acid Number (AN)	mg KOH/g	ASTM D8045		0.77	0.78	0.84
Visc @ 40°C	cSt	ASTM D445	34.35	26.4	26.5	27.8

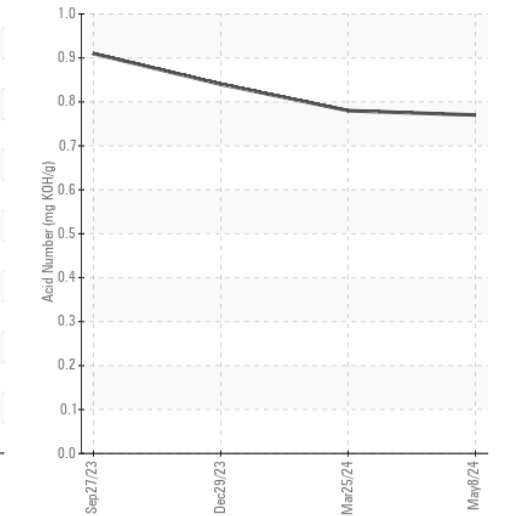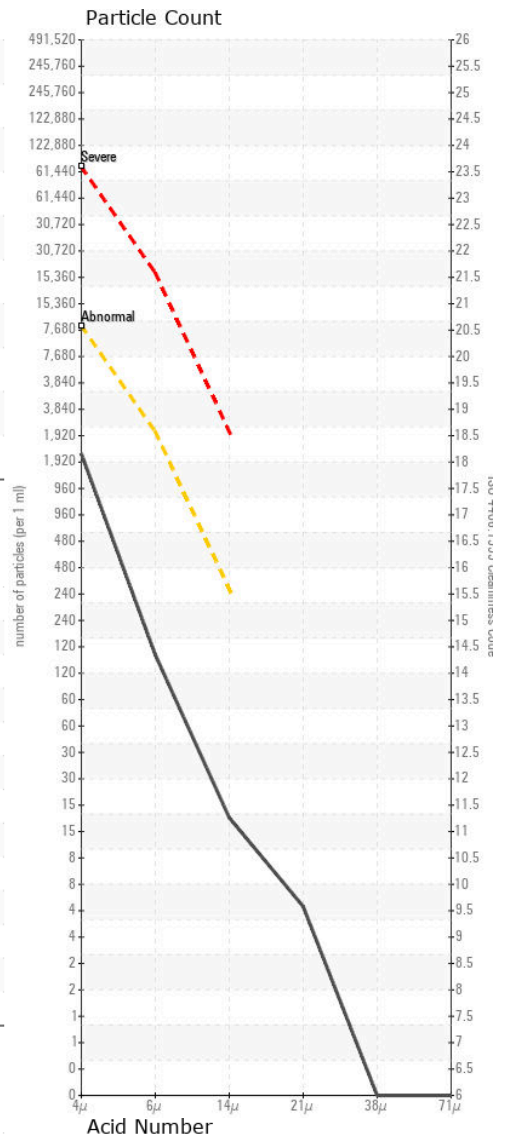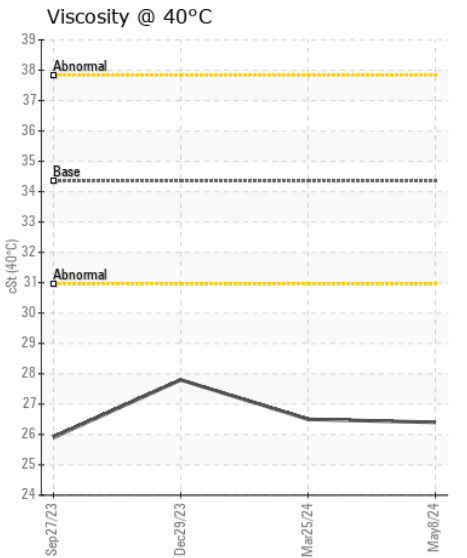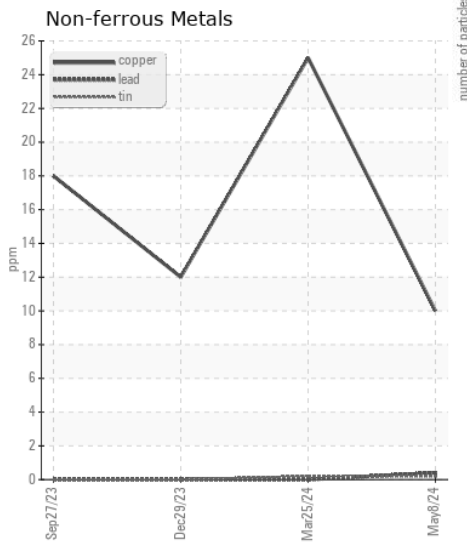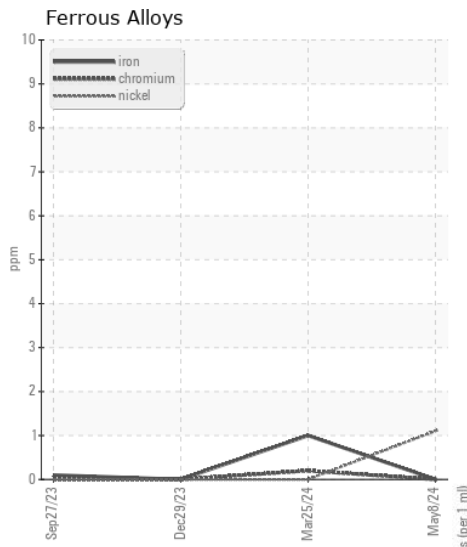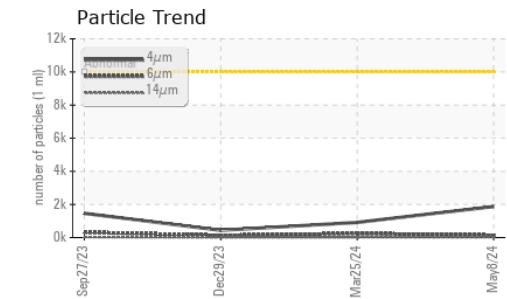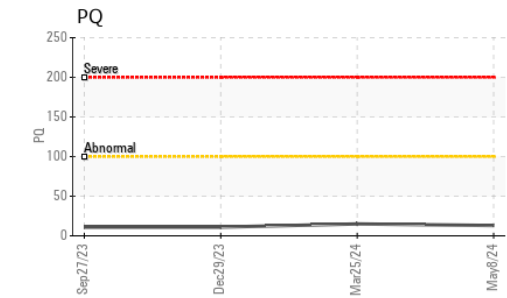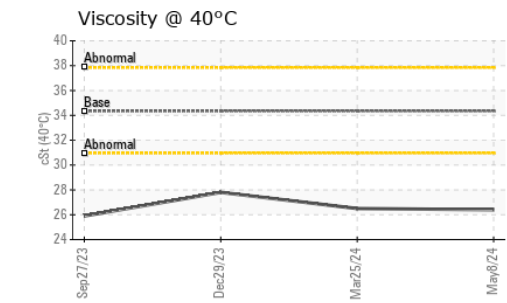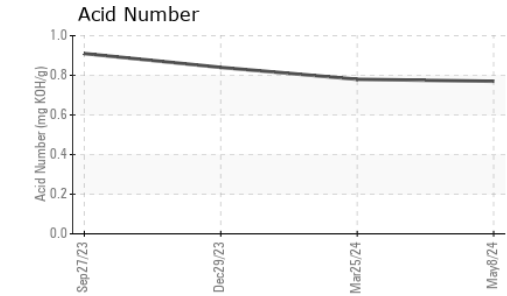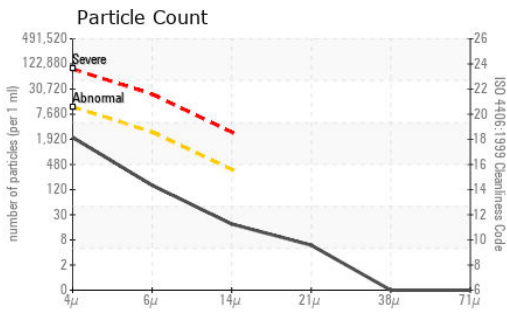

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PE0002221 **Received** : 28 May 2024
Lab Number : 06192750 **Tested** : 30 May 2024
Unique Number : 11049502 **Diagnosed** : 30 May 2024 - Don Baldrige
Test Package : CONST (Additional Tests: ICP, KV40, PQ, PrtCount, SCREEN)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MCKINLEY PAPER COMPANY
 1902 MARINE DR
 PORT ANGELES, WA
 US 98363
 Contact: JOSHUA HALL
 joshua.hall@biopappel.com
 T: (360)457-4474
 F: