



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
SULLIVAN PALATEK 19GE000297 - COLOR COAT INC

Component
Compressor
Fluid
PALASYN 45 (2 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		AN24036	---	---
Sample Date		Client Info		22 May 2024	---	---
Machine Age	hrs	Client Info		19133	---	---
Oil Age	hrs	Client Info		537	---	---
Filter Age	hrs	Client Info		537	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		<1	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	<1	---	---
Lead	ppm	ASTM D5185m	>25	<1	---	---
Copper	ppm	ASTM D5185m	>50	1	---	---
Tin	ppm	ASTM D5185m	>15	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION








The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	3	---	---
Potassium	ppm	ASTM D5185m	>20	3	---	---
Water	%	ASTM D6304	>0.1	0.010	---	---
ppm Water	ppm	ASTM D6304	>1000	106	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		5	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		<1	---	---
Calcium	ppm	ASTM D5185m		0	---	---
Phosphorus	ppm	ASTM D5185m		639	---	---
Zinc	ppm	ASTM D5185m		10	---	---
Sulfur	ppm	ASTM D5185m		333	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.73	---	---
Visc @ 40°C	cSt	ASTM D445		42.1	---	---

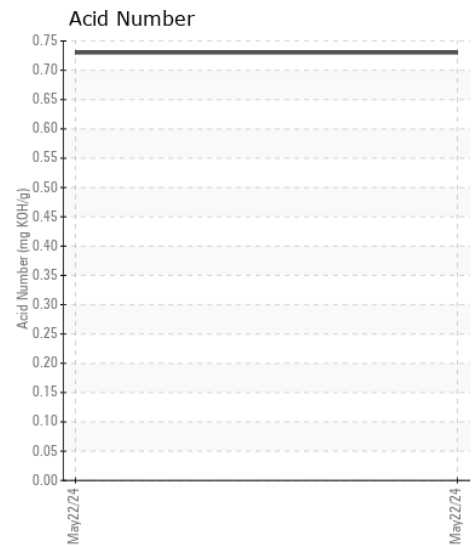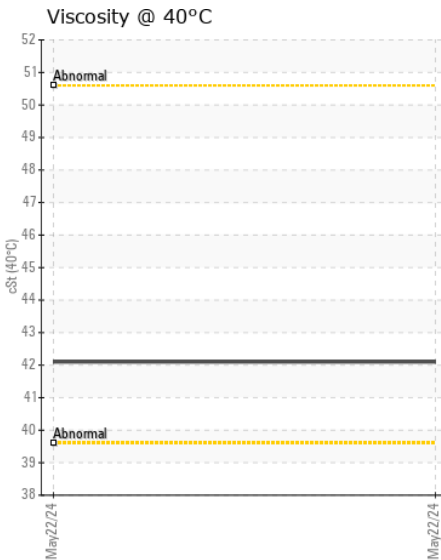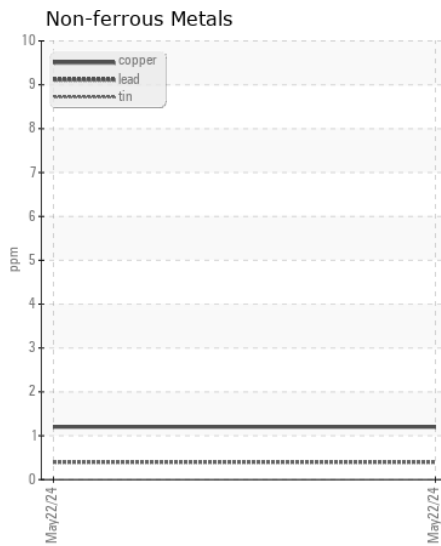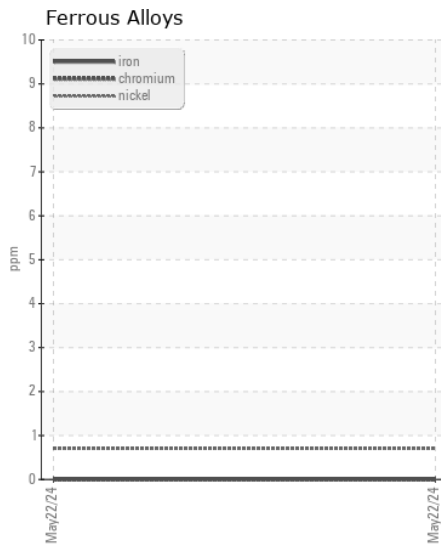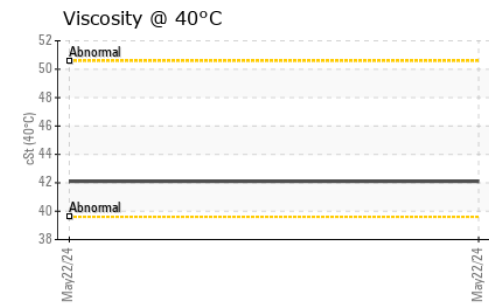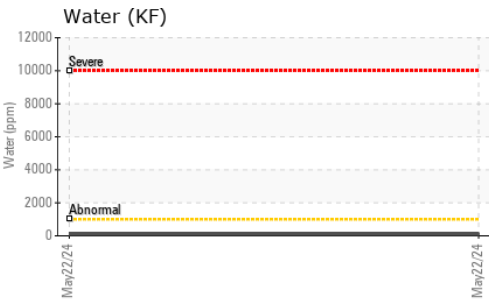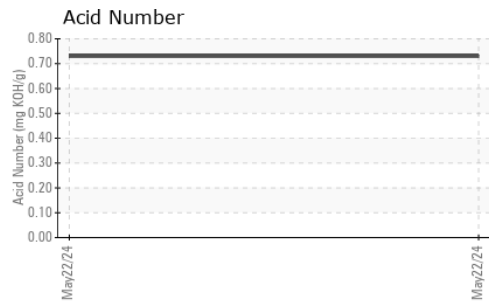

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : AN24036

Lab Number : 06192915

Unique Number : 11049667

Test Package : IND 2

Received : 28 May 2024

Tested : 31 May 2024

Diagnosed : 31 May 2024 - Jonathan Hester

MATTEI COMPRESSORS--OEM

9635 LIBERTY ROAD, SUITE E

RANDALLSTOWN, MD

US 21133

Contact: MARTY WARD

jward@matteicomp.com

T: (410)521-7020

F: (410)521-7024

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)