
WEAR CONTAMINATION FLUID CONDITION

NORMAL NORMAL

Machine Id **55884**

Component Diesel Engine

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
	Sample Number		Client Info		DC0036014	DC0032899	DC003162
Resample at the next service interval to monitor. Please specify the component make and model with your next sample.	Sample Date		Client Info		09 May 2024	19 Jan 2024	18 Sep 202
	Machine Age	hrs	Client Info		6683	6459	6235
	Oil Age	hrs	Client Info		200	200	0
	Filter Age	hrs	Client Info		200	200	0
	Oil Changed		Client Info		Changed	Changed	Changed
	Filter Changed		Client Info		Changed	Changed	Changed
	Sample Status				NORMAL	NORMAL	NORMAL
VEAR	Iron	ppm	ASTM D5185m	>100	8	5	5
	Chromium	ppm	ASTM D5185m	>20	0	0	0
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		<1	<1	0
	Titanium	ppm	ASTM D5185m		0	0	0
	Silver	ppm	ASTM D5185m	>3	0	0	0
	Aluminum	ppm	ASTM D5185m		2	2	2
	Lead	ppm	ASTM D5185m	>40	<1	0	0
	Copper	ppm	ASTM D5185m	>330	<1	0	<1
	Tin	ppm	ASTM D5185m	>15	<1	0	0
	Vanadium	ppm	ASTM D5185m		0	<1	0
	White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	4	3	3
SONTAMINATION	Potassium	ppm	ASTM D5185m		3	1	2
There is no indication of any contamination in the oil.	Fuel	ррпп	WC Method		<1.0	<1.0	<1.0
	Water		WC Method		NEG	NEG	NEG
	Glycol		WC Method	7 0.2	NEG	NEG	NEG
	Soot %	%	*ASTM D7844	>3	0.1	0.1	0.1
	Nitration	Abs/cm	*ASTM D7624		6.6	6.3	5.9
	Sulfation	Abs/.1mm	*ASTM D7415		16.4	16.0	15.6
	Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Debris	scalar	*Visual	NONE	NONE	NONE	NONE
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
	Appearance	scalar	*Visual	NORML	NORML	NORML	NORM
	Odor	scalar	*Visual	NORML	NORML	NORML	NORM
	Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
FLUID CONDITION	Sodium	ppm	ASTM D5185m	<158	1	1	<1
LOID CONDITION	Boron	ppm	ASTM D5185m		2	2	0
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		0	0	0
	Molybdenum	ppm	ASTM D5185m		3	2	3
	Manganese	ppm	ASTM D5185m	.00	<1	<1	0
	Magnesium	ppm	ASTM D5185m	450	55	56	40
	Calcium	ppm	ASTM D5185m		2362	2224	2270
	Phosphorus	ppm	ASTM D5185m		934	918	876
	Zinc	ppm	ASTM D5185m		1082	1096	1050
	Sulfur	ppm	ASTM D5185m		4259	3750	4178
	Oxidation	Abs/.1mm	*ASTM D7414		9.5	9.5	9.3
	Base Number (BN)		ASTM D2896		7.1	7.3	7.6

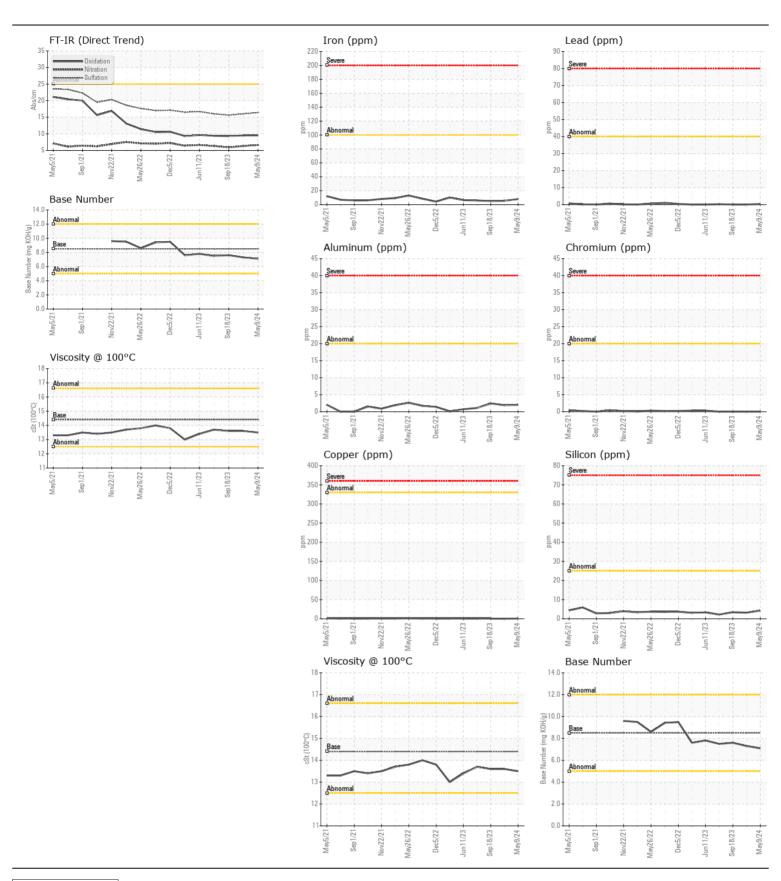



Certificate L2367

Laboratory Sample No.

: DC0036014 Lab Number : 06193416

Unique Number : 11050168

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received **Tested**

Diagnosed Test Package : MOB 1 (Additional Tests: TBN)

: 28 May 2024 : 30 May 2024

: 30 May 2024 - Wes Davis

FRANCIS O DAY 14900 SOUTHLAWN LN ROCKVILLE, MD US 20850

Contact: JAMIE FORESTER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: