



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**COGEN 1 DAY TANK 1 - MOBIL PEGASUS 805 ULTRA**

Component  
**New (Unused) Oil**  
Fluid  
**{not provided} (--- GAL)**

**RECOMMENDATION**

This is a baseline read-out on the submitted sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		JIC0001235	---	---
Sample Date		Client Info		01 May 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

**WEAR**









Iron	ppm	ASTM D5185m	>5	0	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m	>5	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>5	0	---	---
Aluminum	ppm	ASTM D5185m	>5	2	---	---
Lead	ppm	ASTM D5185m	>5	<1	---	---
Copper	ppm	ASTM D5185m	>5	0	---	---
Tin	ppm	ASTM D5185m	>5	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

**CONTAMINATION**

Silicon	ppm	ASTM D5185m	>15	4	---	---
Potassium	ppm	ASTM D5185m	>20	1	---	---
Water		WC Method		NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual		NEG	---	---

**FLUID CONDITION**

Sodium	ppm	ASTM D5185m		2	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		6	---	---
Calcium	ppm	ASTM D5185m		1347	---	---
Phosphorus	ppm	ASTM D5185m		295	---	---
Zinc	ppm	ASTM D5185m		320	---	---
Sulfur	ppm	ASTM D5185m		2338	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.722	---	---
Base Number (BN)	mg KOH/g	ASTM D2896		6.01	---	---
Visc @ 40°C	cSt	ASTM D445		130.4	---	---
Visc @ 100°C	cSt	ASTM D445		13.58	---	---
Viscosity Index (VI)	Scale	ASTM D2270		99	---	---

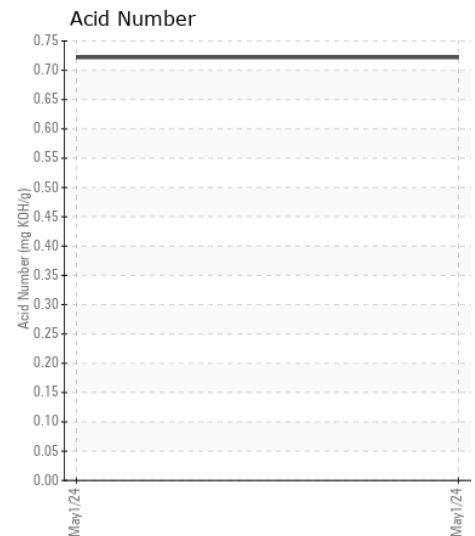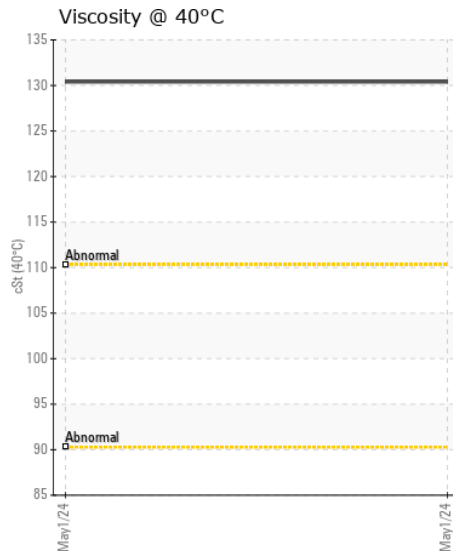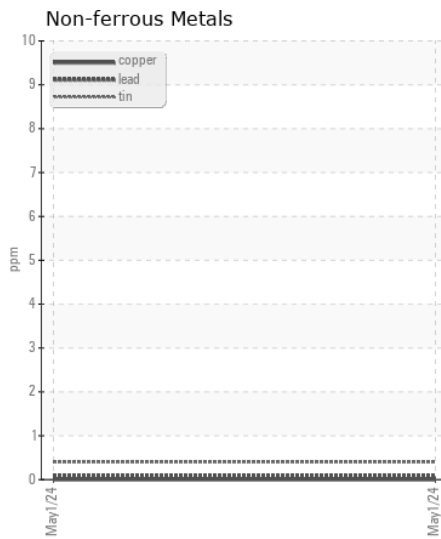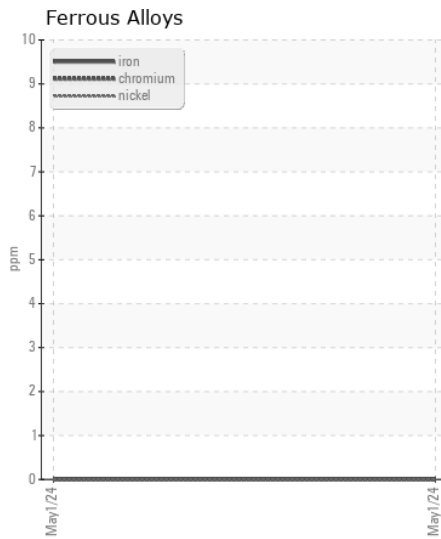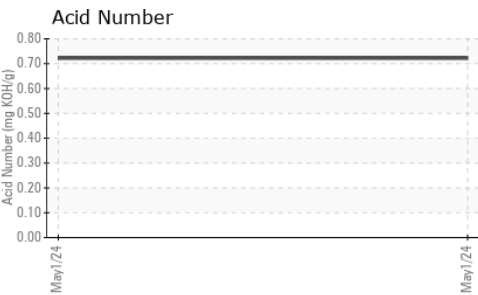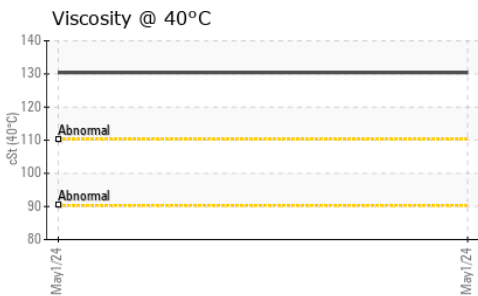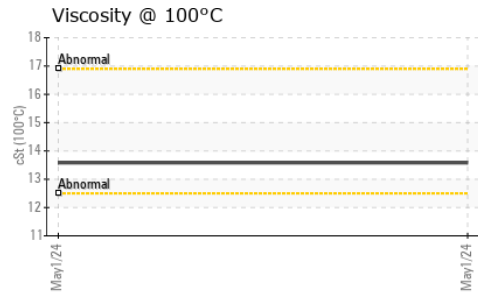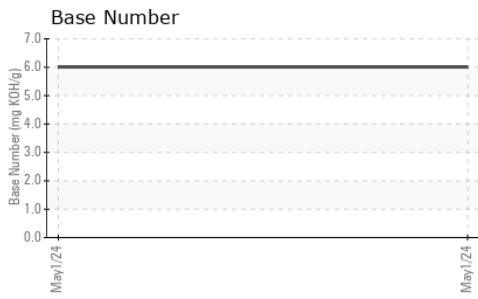

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : JIC0001235

**Lab Number** : 06193465

**Unique Number** : 11050217

**Test Package** : MOB 2 ( Additional Tests: FT-IR, ICP-NewOil, KV100, PrtCount, TBN, VI )

**Received** : 28 May 2024

**Tested** : 05 Jun 2024

**Diagnosed** : 05 Jun 2024 - Jonathan Hester

**ABBVIE LTD UTILITES DIVISION**

ROAD NO 2 KM M59.2

BARCELONETA, PR

PR 00617

Contact: NOEL VALENTIN

noel.valentin@abbvie.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: