



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
AC-1
Machine Id
SULLIVAN PALATEK 03J048 - MSUM
Component
Compressor

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

WEAR

All component wear rates are normal.







CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCS06194161	---	---
Sample Date		Client Info		20 May 2024	---	---
Machine Age	hrs	Client Info		40085	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---
Iron	ppm	ASTM D5185m	>50	<1	---	---
Chromium	ppm	ASTM D5185m	>10	<1	---	---
Nickel	ppm	ASTM D5185m		<1	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m		1	---	---
Aluminum	ppm	ASTM D5185m	>25	1	---	---
Lead	ppm	ASTM D5185m	>25	<1	---	---
Copper	ppm	ASTM D5185m	>50	1	---	---
Tin	ppm	ASTM D5185m	>15	<1	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Silicon	ppm	ASTM D5185m	>25	2	---	---
Potassium	ppm	ASTM D5185m	>20	2	---	---
Water		WC Method	>0.1	NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Sodium	ppm	ASTM D5185m		17	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		<1	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		<1	---	---
Calcium	ppm	ASTM D5185m		15	---	---
Phosphorus	ppm	ASTM D5185m		1070	---	---
Zinc	ppm	ASTM D5185m		1290	---	---
Sulfur	ppm	ASTM D5185m		2471	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		1.44	---	---
Visc @ 40°C	cSt	ASTM D445		43.1	---	---

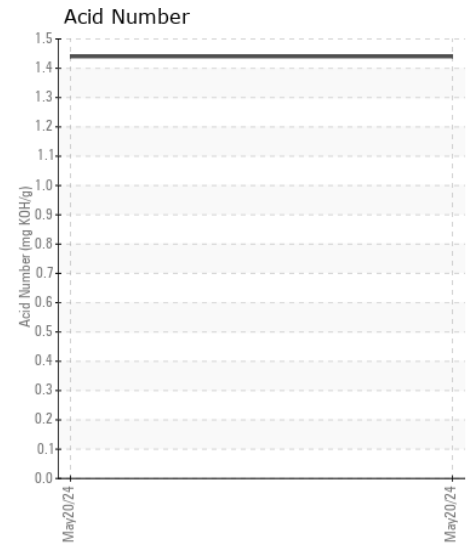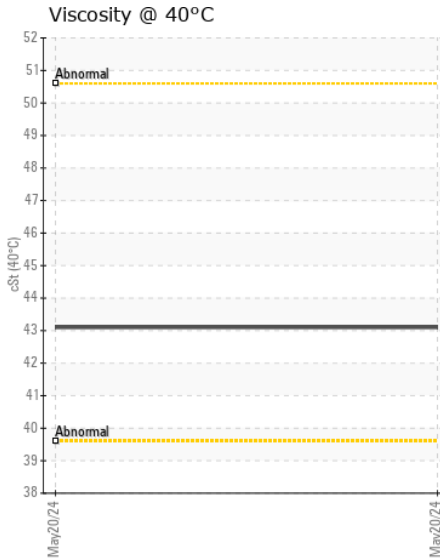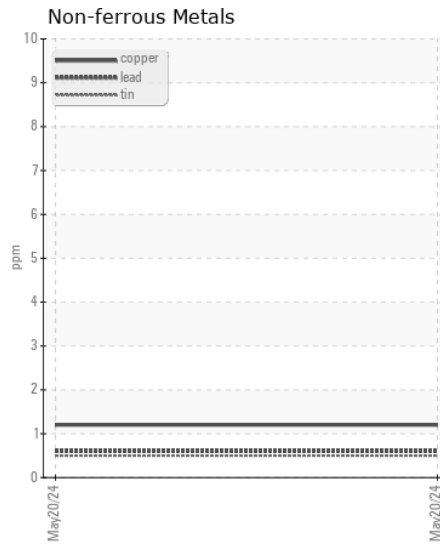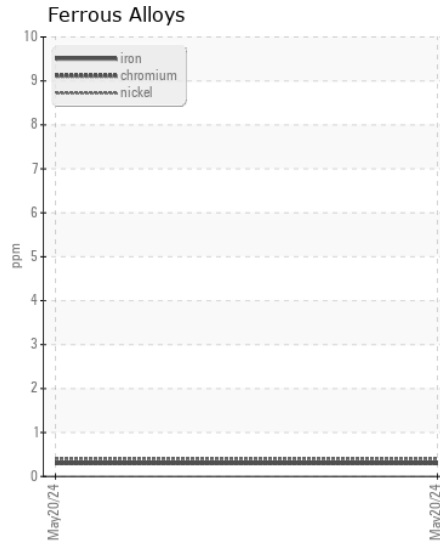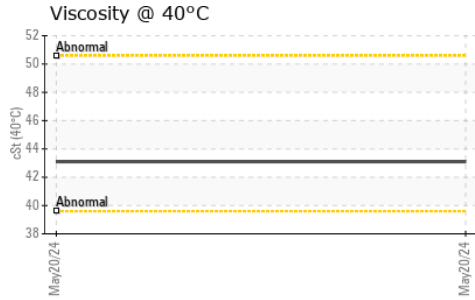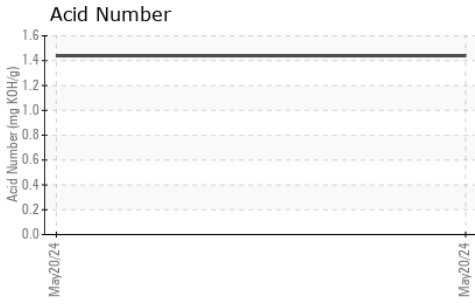

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : UCS06194161

Lab Number : 06194161

Unique Number : 11056284

Test Package : IND 2

Received : 29 May 2024

Tested : 30 May 2024

Diagnosed : 30 May 2024 - Wes Davis

JEMCO-MAXAIR

WEST FARGO, ND
US 58078

Contact: DALE K
dalek@jemco-maxair.com

T: (701)281-0362

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)