



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
F/V ARCTIC FURY
 Component
Port Genset
 Fluid
MOBIL DELVAC MX 15W40 (--- QTS)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PE0001372	PE0001208	PE0001209
Sample Date		Client Info		13 May 2024	01 Aug 2023	01 Aug 2023
Machine Age	hrs	Client Info		13870	13230	25360
Oil Age	hrs	Client Info		537	855	540
Filter Age	hrs	Client Info		537	855	540
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	2	3	4
Chromium	ppm	ASTM D5185m	>4	<1	<1	0
Nickel	ppm	ASTM D5185m	>2	0	<1	0
Titanium	ppm	ASTM D5185m		<1	0	<1
Silver	ppm	ASTM D5185m	>5	<1	0	0
Aluminum	ppm	ASTM D5185m	>12	<1	1	0
Lead	ppm	ASTM D5185m	>17	1	0	<1
Copper	ppm	ASTM D5185m	>70	5	<1	<1
Tin	ppm	ASTM D5185m	>15	<1	<1	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION








There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	4	5	6
Potassium	ppm	ASTM D5185m	>20	5	5	4
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844		0.1	0.1	0.3
Nitration	Abs/cm	*ASTM D7624	>20	7.2	7.6	7.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	19.5	19.0	18.8
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		2	<1	2
Boron	ppm	ASTM D5185m		121	119	113
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		6	11	11
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		251	477	595
Calcium	ppm	ASTM D5185m		2106	1622	1814
Phosphorus	ppm	ASTM D5185m		943	789	856
Zinc	ppm	ASTM D5185m		1035	950	1069
Sulfur	ppm	ASTM D5185m		3805	3360	4042
Oxidation	Abs/.1mm	*ASTM D7414	>25	14.9	14.8	14.4
Base Number (BN)	mg KOH/g	ASTM D2896	12	7.9	8.1	8.2
Visc @ 100°C	cSt	ASTM D445	14.4	13.6	13.7	14.3

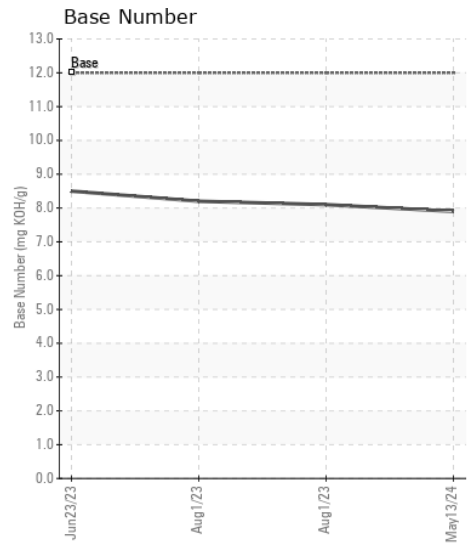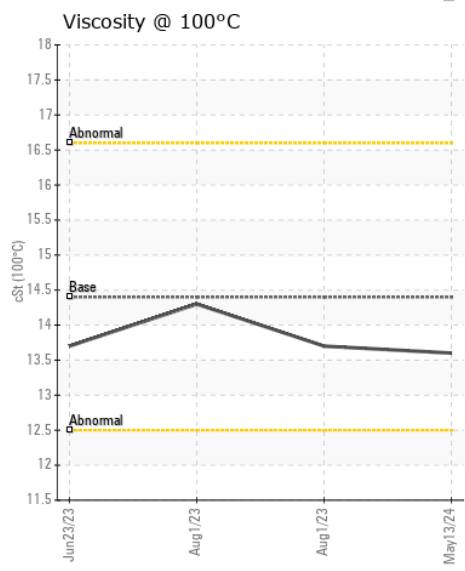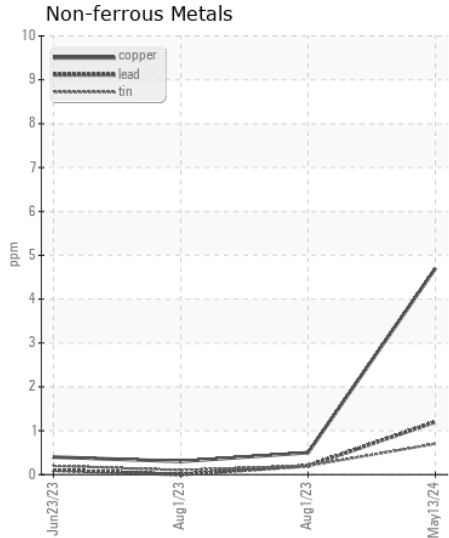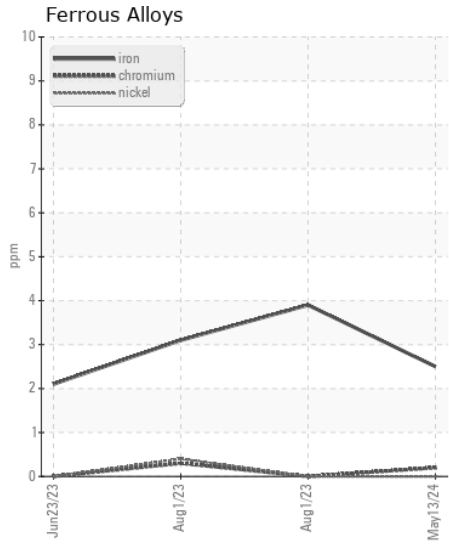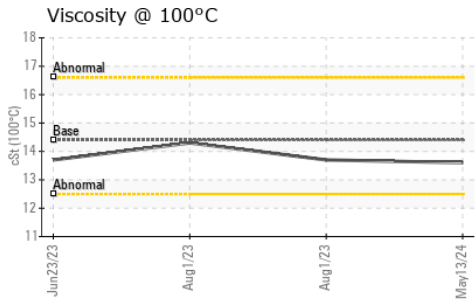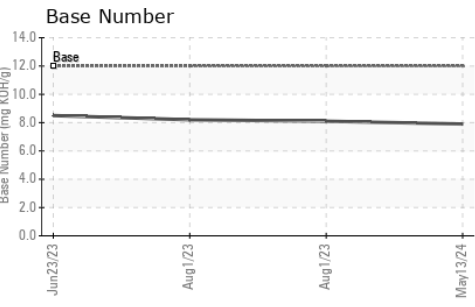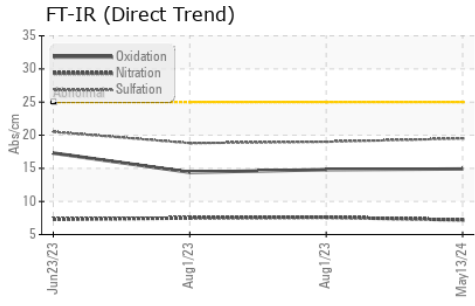

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PE0001372 **Received** : 29 May 2024
Lab Number : 06194867 **Tested** : 30 May 2024
Unique Number : 11056990 **Diagnosed** : 31 May 2024 - Don Baldrige
Test Package : CONST (Additional Tests: FT-IR, ICP, KV100, SCREEN, TBN)

THE FURY GROUP
 4005 20TH AVE W
 SEATTLE, WA
 US 98199
 Contact: Service Manager
 OFFICE@FURYGROUP.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)