

[PMI442946248] Machine Id CUMMINS 250DFAC K960623458 Component Diesel Fuel

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

RECOMMENDATION

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

CORROSION

All metal levels are normal indicating no corrosion in the system.

CONTAMINANTS


The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel.

.....


Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0035902		
Sample Date		Client Info		22 May 2024		
Machine Age	hrs	Client Info		1136		
Sample Status				NORMAL		
Aluminum	ppm	ASTM D5185m	<0.1	0		
Nickel	ppm	ASTM D5185m	<0.1	0		
Lead	ppm	ASTM D5185m	<0.1	0		
Vanadium	ppm	ASTM D5185m	<0.1	0		
Iron	ppm	ASTM D5185m	<0.1	0		
Silicon		ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	< 0.1	0 <1		
Potassium	ppm	ASTM D5185m	< 0.1	<1 0		
Water	ppm %	ASTM D5165m	< 0.05	0.003		
		ASTM D6304				
ppm Water % Gasoline	ppm %	*In-House	<500 <0.50	34		
% Biodiesel	%	*In-House	<0.50	0.0 0.0		
Calcium		ASTM D5185m	<0.1	3		
Magnesium	ppm	ASTM D5185m	<0.1	0		
Phosphorus	ppm ppm	ASTM D5185m	<0.1	2		
Zinc		ASTM D5185m	<0.1	0		
200	ppm		<0.1	•		
ASTM Color	scalar	*ASTM D1500		L4.5		
Visc @ 40°C	cSt	ASTM D445	3.0	2.4		
Sulfur	ppm	ASTM D5185m	10	16		
Sulfur (UVF)	ppm	ASTM D5453		8		
API Gravity		ASTM D7777	37.7	37.1		


FUEL CONDITION

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

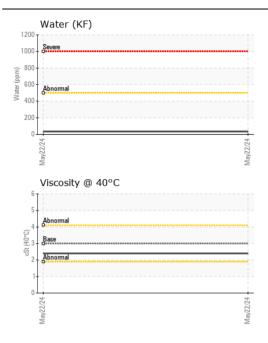

Pensky-Martens Flash Point (°C)



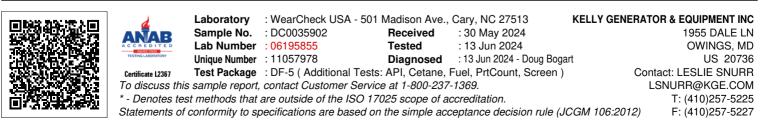

Contact/Location: LESLIE SNURR - KELOWI Page 2 of 2