



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**LGS00181**  
 Component  
**Middle Biogas Engine**  
 Fluid  
**CITGO PACEMAKER GAS ENGINE LFG LA 40 (--- GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0803468</b>	WC0803464	WC0803472
Sample Date		Client Info		<b>29 May 2024</b>	06 May 2024	29 Apr 2024
Machine Age	hrs	Client Info		<b>67257</b>	67215	67130
Oil Age	hrs	Client Info		<b>15</b>	65	234
Filter Age	hrs	Client Info		<b>15</b>	65	234
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	SEVERE

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>45	<b>2</b>	2	5
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>1</b>	3	<1
Lead	ppm	ASTM D5185m	>5	<b>&lt;1</b>	▲ 7	▲ 69
Copper	ppm	ASTM D5185m	>14	<b>&lt;1</b>	2	6
Tin	ppm	ASTM D5185m	>13	<b>&lt;1</b>	1	5
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**













There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>200	<b>17</b>	46	150
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	0
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>3.0</b>	4.8	3.3
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>14.4</b>	16.9	17.0
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	11	96
Boron	ppm	ASTM D5185m		<b>3</b>	77	5
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>4</b>	<1	6
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>27</b>	8	23
Calcium	ppm	ASTM D5185m		<b>1491</b>	1496	1478
Phosphorus	ppm	ASTM D5185m		<b>306</b>	307	298
Zinc	ppm	ASTM D5185m		<b>405</b>	332	352
Sulfur	ppm	ASTM D5185m		<b>3003</b>	3209	3312
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>6.8</b>	9.9	7.3
Acid Number (AN)	mg KOH/g	ASTM D8045	1.16	<b>1.29</b>	0.77	0.98
Base Number (BN)	mg KOH/g	ASTM D2896	5	<b>4.30</b>	4.81	3.54
Visc @ 100°C	cSt	ASTM D445	13.5	<b>12.6</b>	12.8	12.4

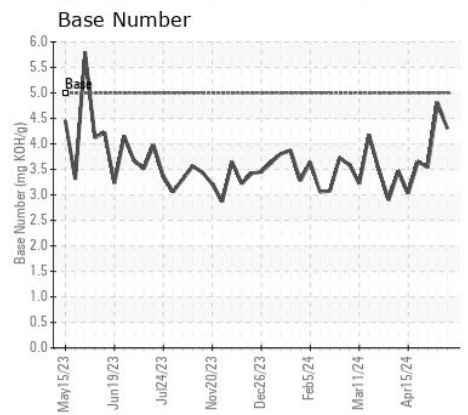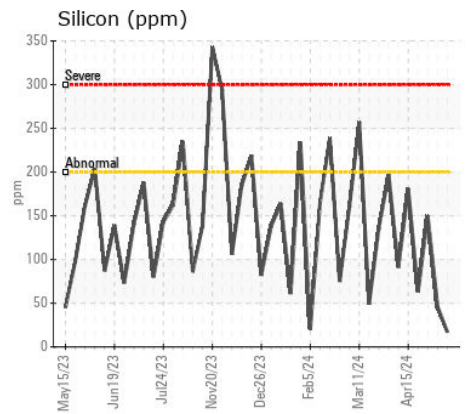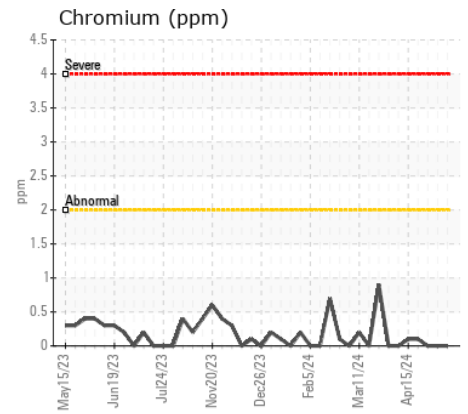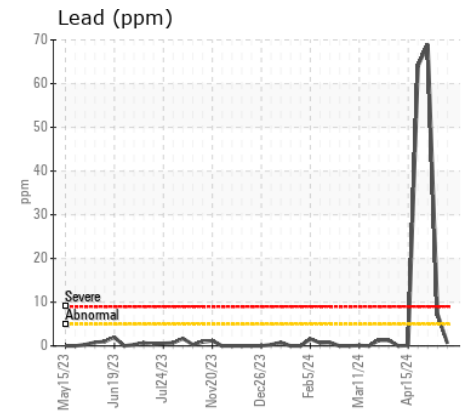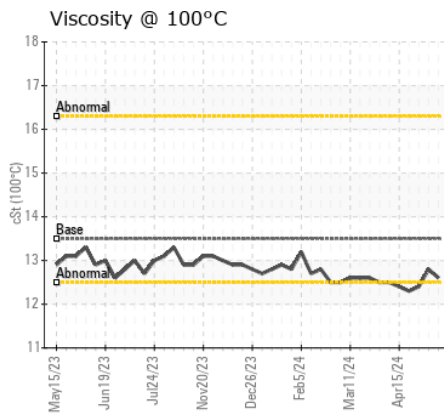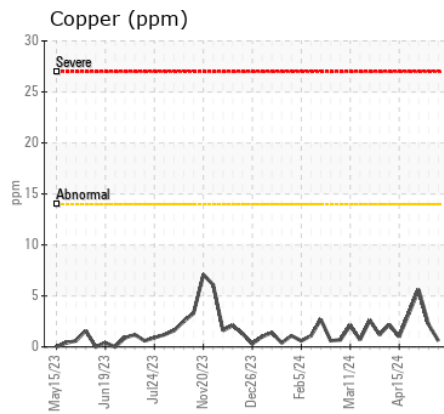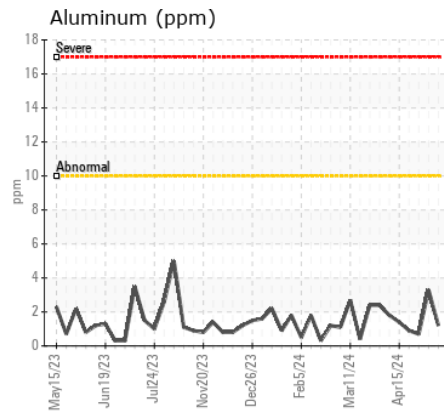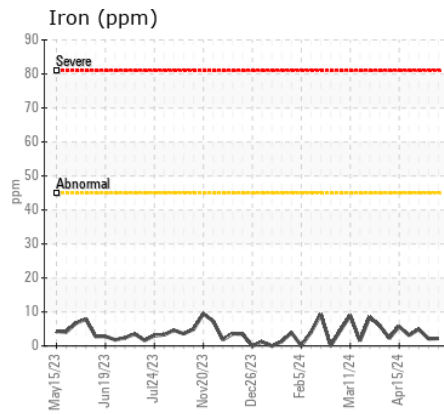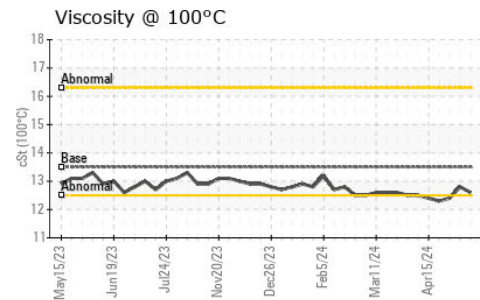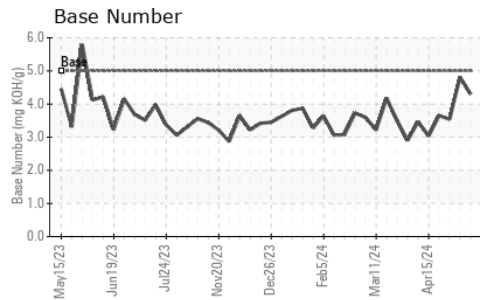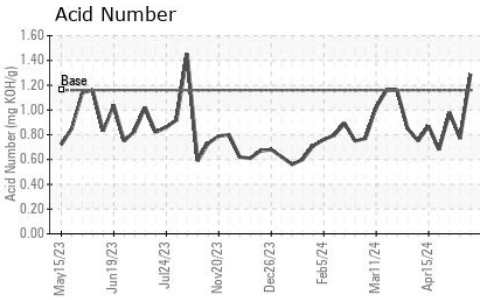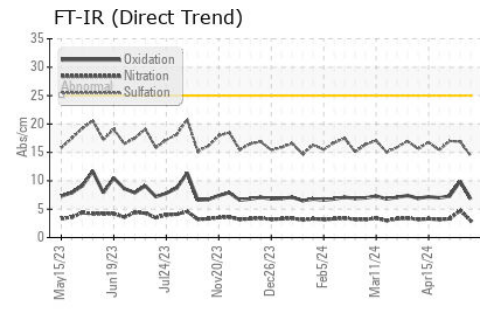

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0803468  
**Lab Number** : 06196018  
**Unique Number** : 11058141  
**Test Package** : MOB 2  
**Received** : 30 May 2024  
**Tested** : 02 Jun 2024  
**Diagnosed** : 02 Jun 2024 - Don Baldrige

**BLACK OAK**  
 5054 HWY HH  
 HARTVILLE, MO  
 US 65667

**Certificate L2367**  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)  
 Contact: CHIP MATHEWS  
 chip.matthews@cubedistrictenergy.com  
 T:  
 F: