

Limit/Abn Current

Toet

Mathad

History

History?

## Machine Id **20582** Component **Diesel Engine** Fluid **DIESEL ENGINE OIL SAE 15W40 (--- QTS)**

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

## **WEAR**

Metal levels are typical for a new component breaking in.

## CONTAMINATION


**FLUID CONDITION** 

Elevated aluminum (AI) and/or lead (Pb) and potassium (K) levels in your metals analysis are likely a result of solder flux release into the lubricant and is common on new equipment/components. There is no indication of any contamination in the oil.

The BN result indicates that there is suitable alkalinity remaining in the

oil. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0875934	WC0875740	
Sample Date		Client Info		23 May 2024	10 Jan 2024	
Machine Age	mls	Client Info		11862	8607	
Oil Age	mls	Client Info		3255	0	
Filter Age	mls	Client Info		3255	0	
Oil Changed		Client Info		Changed	Changed	
Filter Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
Iron	ppm	ASTM D5185m	>100	18	22	
Chromium	ppm	ASTM D5185m	>20	0	<1	
Nickel	ppm	ASTM D5185m	>4	0	<1	
Titanium	ppm	ASTM D5185m		6	0	
Silver	ppm	ASTM D5185m	>3	0	0	
Aluminum	ppm	ASTM D5185m	>20	11	17	
Lead	ppm	ASTM D5185m	>40	0	1	
Copper	ppm	ASTM D5185m	>330	4	48	
Tin	ppm	ASTM D5185m	>15	<1	3	
Vanadium	ppm	ASTM D5185m		0	<1	
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Silicon		ASTM D5185m	>25	9	18	
Potassium	ppm	ASTM D5185m	>20	28	58	
Fuel	ppm	WC Method	>20	20 <1.0	0.5	
Water		WC Method	>0.2	NEG	NEG	
Glycol		WC Method	>0.2	NEG	NEG	
Soot %	%	*ASTM D7844	>3	0.1	0.2	
Nitration	Abs/cm	*ASTM D7624	>20	5.7	5.7	
Sulfation	Abs/.1mm	*ASTM D7415	>30	18.8	19.5	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water		*Visual	>0.2	NEG	NEG	
Sodium	ppm	ASTM D5185m	>158	2	3	
Boron	ppm	ASTM D5185m	250	256	102	
Barium	ppm	ASTM D5185m	10	0	2	
Molybdenum	ppm	ASTM D5185m	100	53	62	
Manganese	ppm	ASTM D5185m		1	3	
Magnesium	ppm	ASTM D5185m	450	537	406	
Calcium	ppm	ASTM D5185m	3000	1373	1790	
Phosphorus	ppm	ASTM D5185m	1150	887	1027	
Zinc	ppm	ASTM D5185m	1350	998	1259	
Sulfur	ppm	ASTM D5185m	4250	3474	3328	
Oxidation	Abs/.1mm	*ASTM D7414	>25	13.4	15.1	
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	8.3	9.0	
Visc @ 100°C	cSt	ASTM D445	14.4	13.5	11.3	

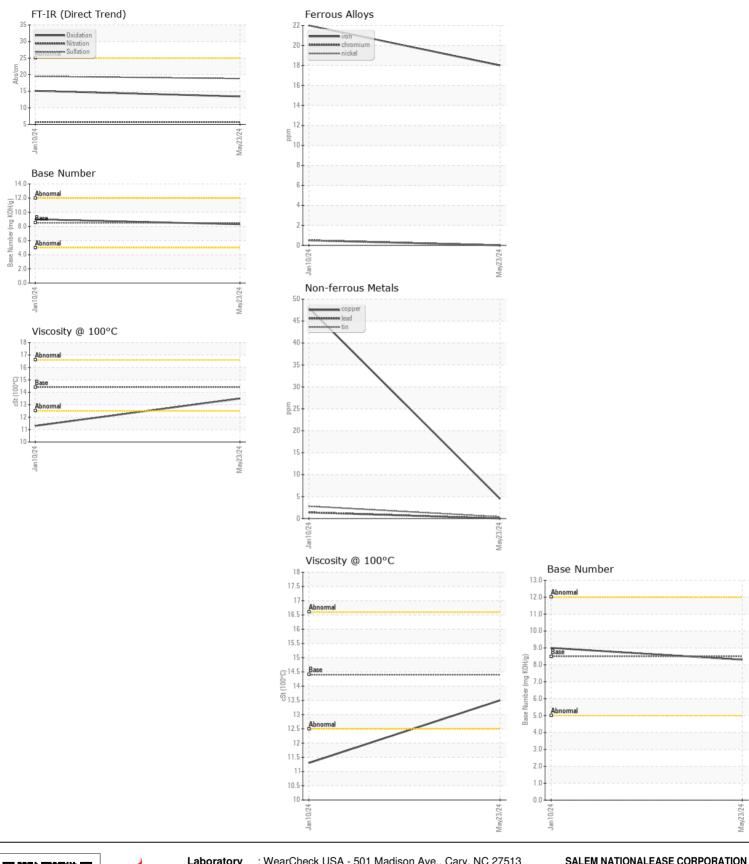

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 SALEM NATIONALEASE CORPORATION ∎nj . Sample No. Received 198 PARK PLAZA DRIVE : WC0875934 : 31 May 2024 Lab Number : 06196524 Tested WINSTON SALEM, NC : 03 Jun 2024 Diagnosed Unique Number : 11058647 : 03 Jun 2024 - Wes Davis US 27105 Test Package : FLEET **Contact: Audrey Hopkins** Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. Audrey.Hopkins@salemcorp.com \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (336)767-9642 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: x:

Contact/Location: Audrey Hopkins - SALWIN Page 2 of 2