

WEAR
CONTAMINATION
FLUID CONDITION

NORMAL NORMAL


Machine Id

T2-CH4 (S/N 10241H19727554Z)

Screw Compressor

ISEL ESTER GAS COMPRESSOR 6029-68 (--- GAL)

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
No corrective action is recommended at this time. Resample at the next service interval to monitor.	Sample Number		Client Info		TO10003439		
	Sample Date		Client Info		30 May 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
WEAR	Iron	ppm	ASTM D5185m	>60	<1		
	Chromium	ppm	ASTM D5185m	>4	<1		
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m		<1		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	>5	2		
	Lead	ppm	ASTM D5185m		- <1		
	Copper	ppm	ASTM D5185m		<1		
	Tin	ppm	ASTM D5185m		<1		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m		4		
	Potassium	ppm	ASTM D5185m		1		
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.	Water	%	ASTM D6304		0.010		
	ppm Water	ppm	ASTM D6304	>1000	103		
	Particles >4μm		ASTM D7647		5166		
	Particles >6µm		ASTM D7647	>2500	840		
	Particles >14μm		ASTM D7647		22		
	Particles >21μm		ASTM D7647		6		
	Particles >38µm		ASTM D7647		1		
	Particles >71μm		ASTM D7647		0		
	Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/17/12		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
LUID CONDITION	Sodium	ppm	ASTM D5185m		0		
	Boron	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		<1		
	Molybdenum	ppm	ASTM D5185m		<1		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m		<1		
	Calcium	ppm	ASTM D5185m		0		
	Phosphorus	ppm	ASTM D5185m		370		
	Zinc	ppm	ASTM D5185m		0		
	Sulfur	ppm	ASTM D5185m		14		
	Acid Number (AN)	mg KOH/g	ASTM D8045		0.13		
	Visc @ 40°C	cSt	ASTM D445		68.4		
	Visc @ 100°C	cSt	ASTM D445		8.9		
	Viscosity Index (VI)	Soolo	ASTM D2270		103		

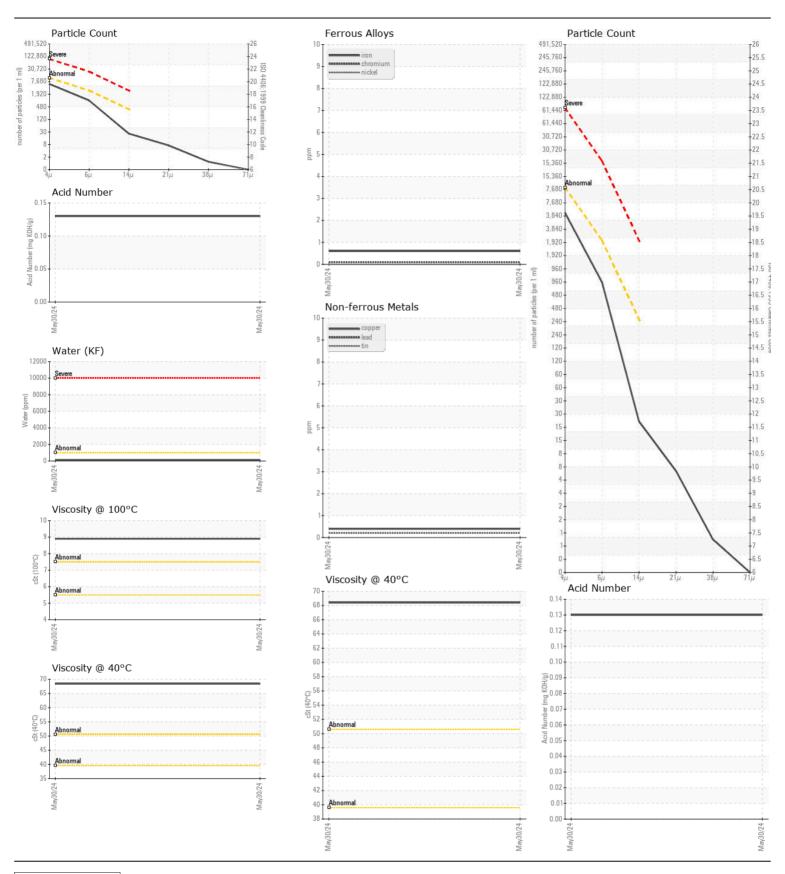



Laboratory Sample No.

: TO10003439 Lab Number : 06196753

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 31 May 2024 **Tested** : 03 Jun 2024 : 03 Jun 2024 - Doug Bogart Unique Number: 11058876 Diagnosed

Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

DALLAS, TX

Contact: Service Manager

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: