



PERFORMANCE
UNDER
PRESSURE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ABNORMAL

Area
UTILITIES
Machine Id
CRW COMPRESSOR # 2 (2 - COURTYARD) (S/N 16-6200)

Component
Air Compressor
Fluid
QUINCY QUINSYN PG (55 GAL)

RECOMMENDATION

The oil is near the end of its useful service life, recommend schedule an oil change. We recommend an early resample to monitor this condition.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		RP0044253	RP0044050	RP0038519
Sample Date		Client Info		30 May 2024	23 May 2024	12 Jan 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	NORMAL

WEAR

All component wear rates are normal.

PQ		ASTM D8184		18	16	15
Iron	ppm	ASTM D5185m	>50	2	3	2
Chromium	ppm	ASTM D5185m	>4	<1	<1	0
Nickel	ppm	ASTM D5185m	>4	0	<1	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m		0	1	0
Aluminum	ppm	ASTM D5185m	>10	2	1	1
Lead	ppm	ASTM D5185m	>20	<1	<1	0
Copper	ppm	ASTM D5185m	>40	23	21	13
Tin	ppm	ASTM D5185m	>5	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION










The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<1	2	<1
Potassium	ppm	ASTM D5185m	>20	2	3	1
Water	%	ASTM D6304	>0.6	0.007	0.007	0.006
ppm Water	ppm	ASTM D6304	>6000	79	79	68
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG	NEG

FLUID CONDITION

The AN level is at the top-end of the recommended limit.

Sodium	ppm	ASTM D5185m		4	6	4
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	<1	0
Molybdenum	ppm	ASTM D5185m		<1	<1	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		<1	<1	0
Calcium	ppm	ASTM D5185m		<1	0	<1
Phosphorus	ppm	ASTM D5185m		64	72	106
Zinc	ppm	ASTM D5185m		11	15	0
Acid Number (AN)	mg KOH/g	ASTM D8045		▲ 3.04	▲ 2.98	2.00
Visc @ 40°C	cSt	ASTM D445	41.9	55.2	54.9	55.0

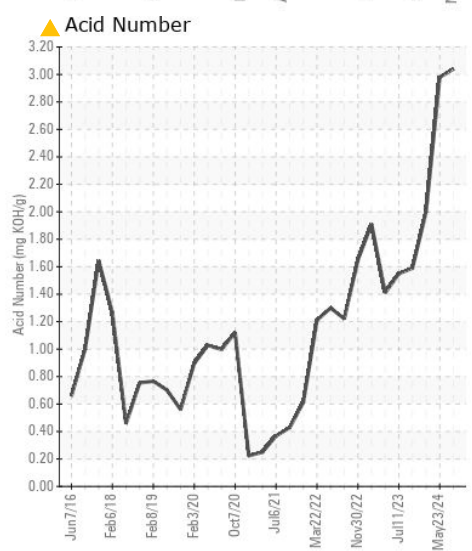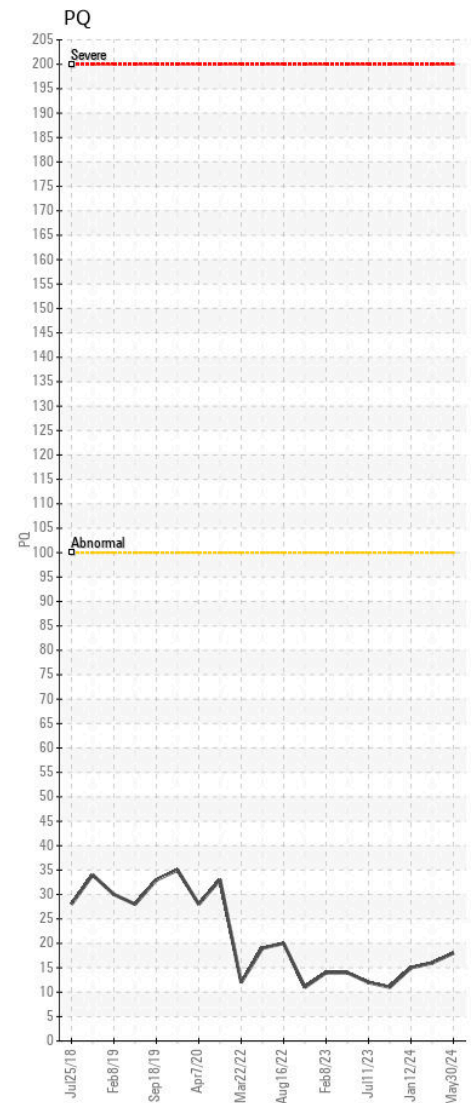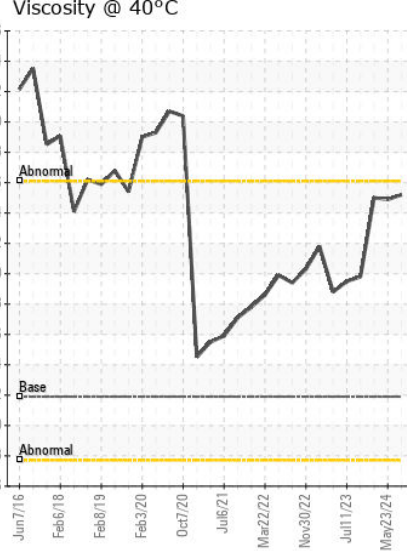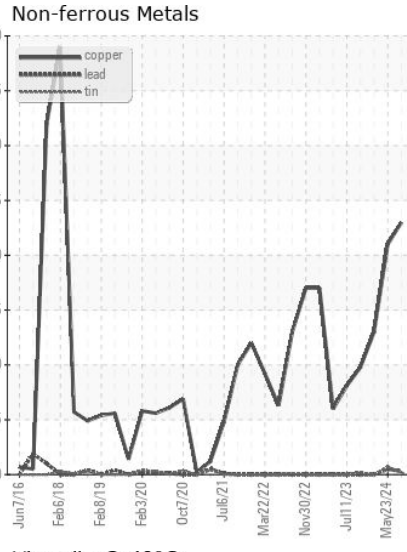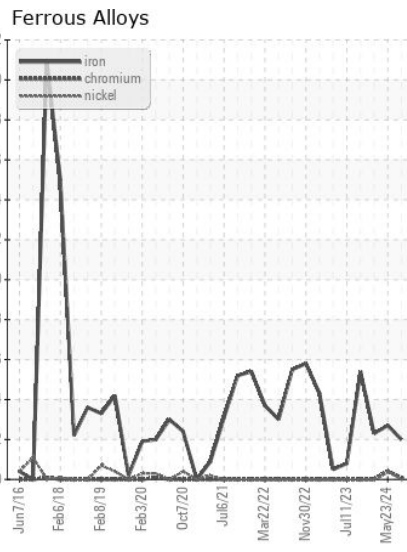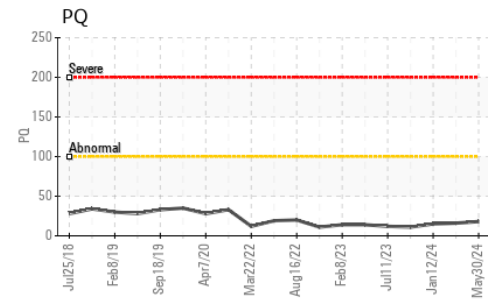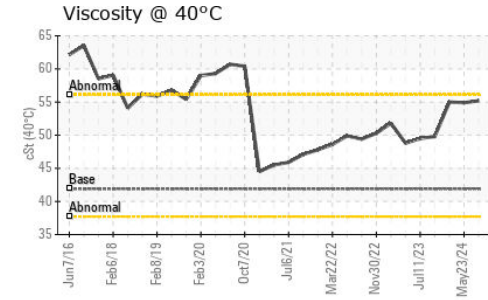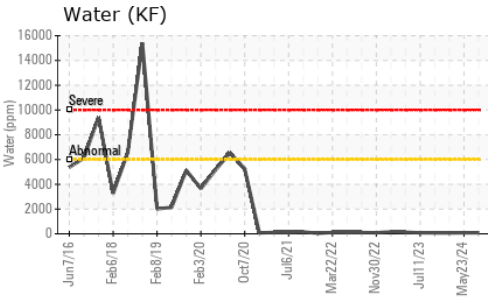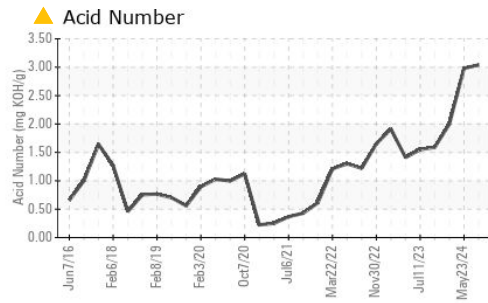

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0044253
Lab Number : 06196759
Unique Number : 11058882
Test Package : IND 2 (Additional Tests: PQ)

Received : 31 May 2024
Tested : 04 Jun 2024
Diagnosed : 04 Jun 2024 - Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

OUTOKUMPU STAINLESS USA
 HWY 43 N
 CALVERT, AL
 US 36513
 Contact: MARIO JOHNSON
 Mario.johnson@outokumpu.com
 T: (251)321-4105
 F: x: