



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
ISEL ESTER GAS COMPRESSOR 6029-68 TOTE

Component
New (Unused) Oil
Fluid
{not provided} (--- GAL)

RECOMMENDATION

This is a baseline read-out on the submitted sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TO10003442	---	---
Sample Date		Client Info		30 May 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				ABNORMAL	---	---

WEAR

Iron	ppm	ASTM D5185m	>5	0	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m	>5	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>5	0	---	---
Aluminum	ppm	ASTM D5185m	>5	0	---	---
Lead	ppm	ASTM D5185m	>5	0	---	---
Copper	ppm	ASTM D5185m	>5	<1	---	---
Tin	ppm	ASTM D5185m	>5	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---










CONTAMINATION

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Silicon	ppm	ASTM D5185m	>15	<1	---	---
Potassium	ppm	ASTM D5185m	>20	1	---	---
Water	%	ASTM D6304		0.010	---	---
ppm Water	ppm	ASTM D6304		104	---	---
Particles >4µm		ASTM D7647	>5000	▲ 10175	---	---
Particles >6µm		ASTM D7647	>1300	▲ 3062	---	---
Particles >14µm		ASTM D7647	>160	101	---	---
Particles >21µm		ASTM D7647	>40	19	---	---
Particles >38µm		ASTM D7647	>10	0	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ 21/19/14	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual		NEG	---	---

FLUID CONDITION

Sodium	ppm	ASTM D5185m		<1	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		0	---	---
Calcium	ppm	ASTM D5185m		13	---	---
Phosphorus	ppm	ASTM D5185m		416	---	---
Zinc	ppm	ASTM D5185m		0	---	---
Sulfur	ppm	ASTM D5185m		165	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.31	---	---
Visc @ 40°C	cSt	ASTM D445		67.58	---	---
Visc @ 100°C	cSt	ASTM D445		8.95	---	---
Viscosity Index (VI)	Scale	ASTM D2270		106	---	---

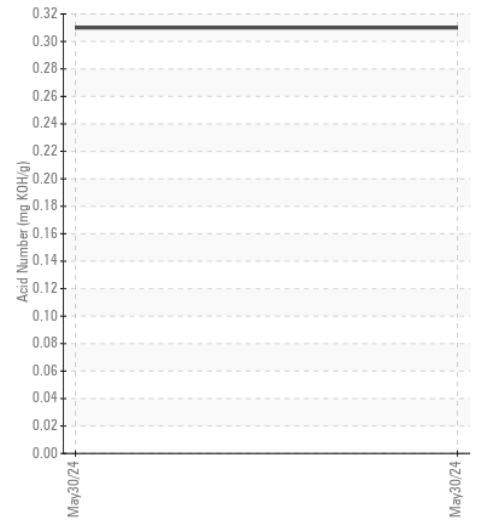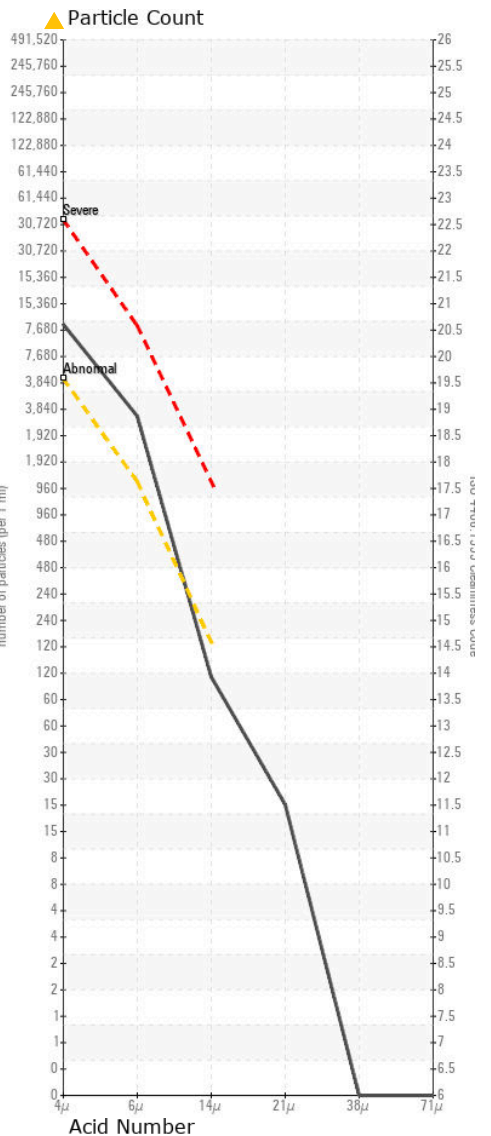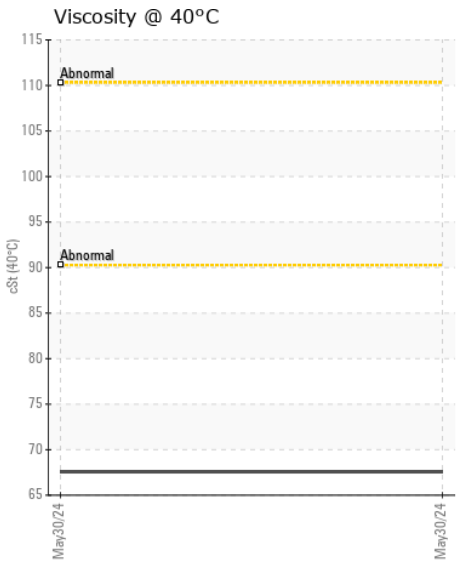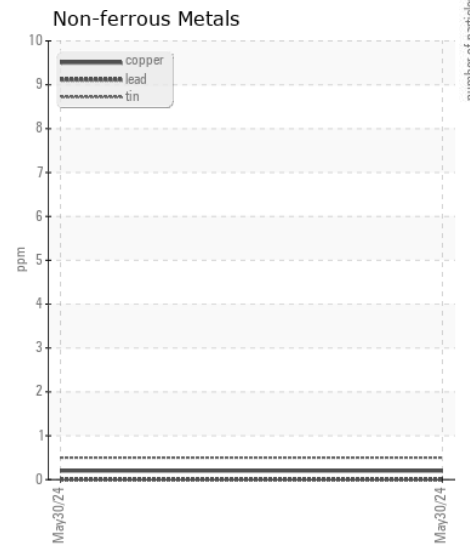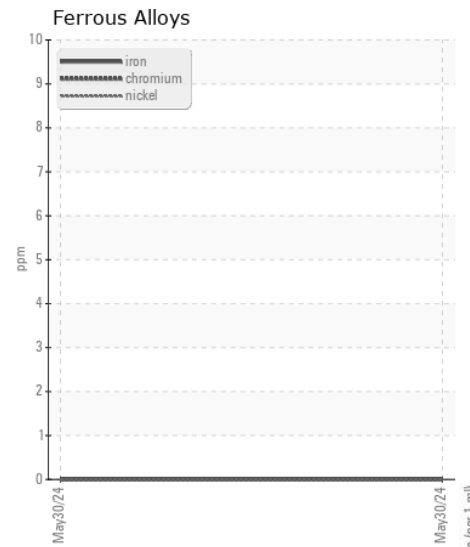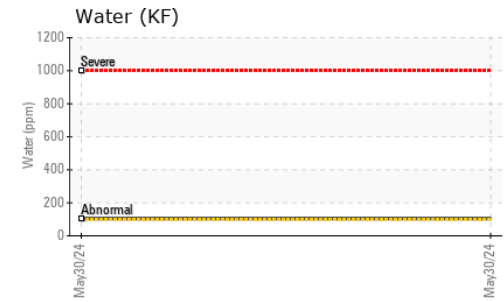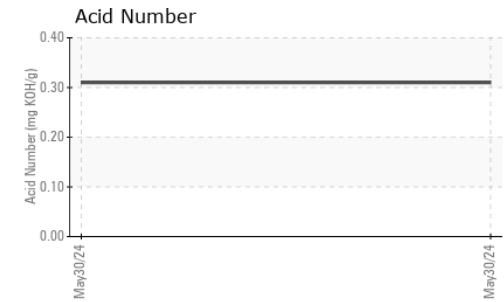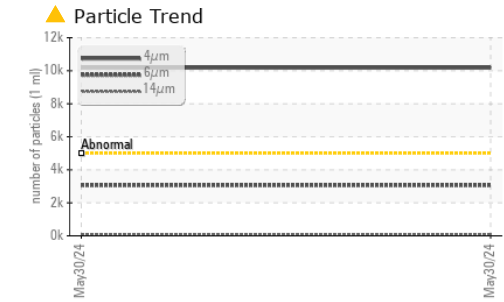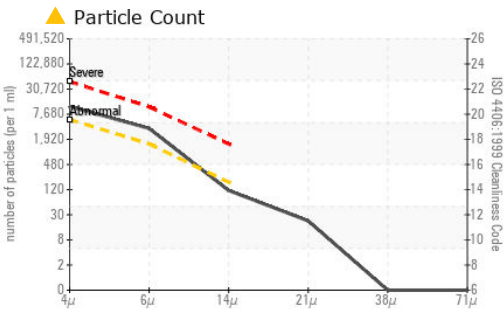

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO10003442
Lab Number : 06197177
Unique Number : 11059300
Test Package : IND 2 (Additional Tests: FT-IR, ICP-NewOil, KF, KV100, PrtCount, VI)

Received : 31 May 2024
Tested : 04 Jun 2024
Diagnosed : 04 Jun 2024 - Jonathan Hester

NEXT ERA - MCCOMMAS BLUFF

DALLAS, TX
 US

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: