



Area
PALEXTRA 44
Machine Id
SULLIVAN PALATEK 23KE004613
Component
Compressor

RECOMMENDATION

We advise that you follow the water drain-off procedure for this component. We recommend an early resample to monitor this condition.

WEAR

All component wear rates are normal.








CONTAMINATION

There is a light concentration of water present in the oil. Excessive free water present.

FLUID CONDITION

The AN level is acceptable for this fluid.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCS06210258	---	---
Sample Date		Client Info		06 Mar 2024	---	---
Machine Age	hrs	Client Info		199	---	---
Oil Age	hrs	Client Info		199	---	---
Filter Age	hrs	Client Info		199	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		Not Changd	---	---
Sample Status				ATTENTION	---	---
Iron	ppm	ASTM D5185m	>50	<1	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	<1	---	---
Lead	ppm	ASTM D5185m	>25	0	---	---
Copper	ppm	ASTM D5185m	>50	2	---	---
Tin	ppm	ASTM D5185m	>15	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	LIGHT	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Silicon	ppm	ASTM D5185m	>25	5	---	---
Potassium	ppm	ASTM D5185m	>20	3	---	---
Water	%	ASTM D6304	>0.1	0.127	---	---
ppm Water	ppm	ASTM D6304	>1000	1270	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	0.2%	---	---
Sodium	ppm	ASTM D5185m		<1	---	---
Boron	ppm	ASTM D5185m	0	<1	---	---
Barium	ppm	ASTM D5185m	0.3	0	---	---
Molybdenum	ppm	ASTM D5185m	0	<1	---	---
Manganese	ppm	ASTM D5185m	0.3	<1	---	---
Magnesium	ppm	ASTM D5185m	0.4	0	---	---
Calcium	ppm	ASTM D5185m	0	0	---	---
Phosphorus	ppm	ASTM D5185m	689	655	---	---
Zinc	ppm	ASTM D5185m	0	0	---	---
Sulfur	ppm	ASTM D5185m	1237	1372	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.135	0.088	---	---
Visc @ 40°C	cSt	ASTM D445	44.62	42.2	---	---

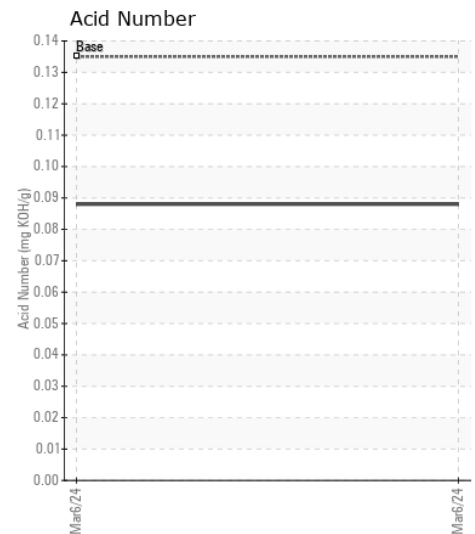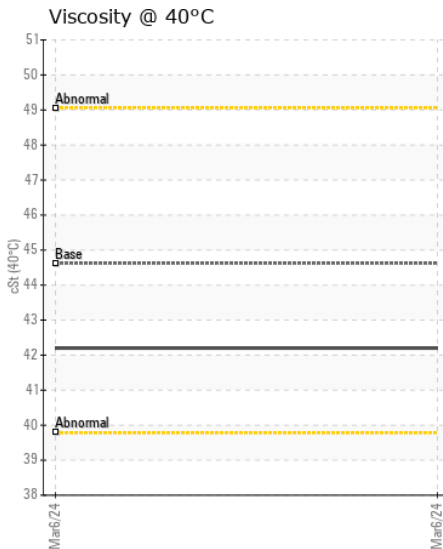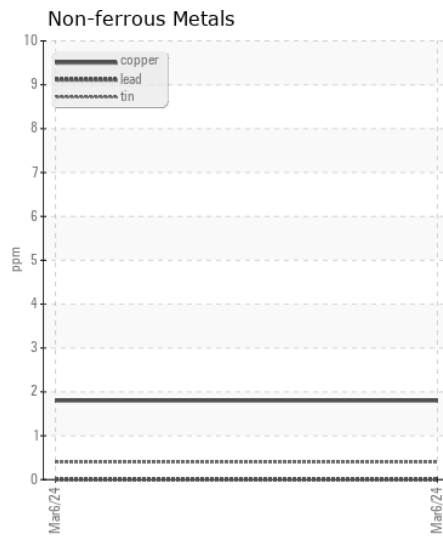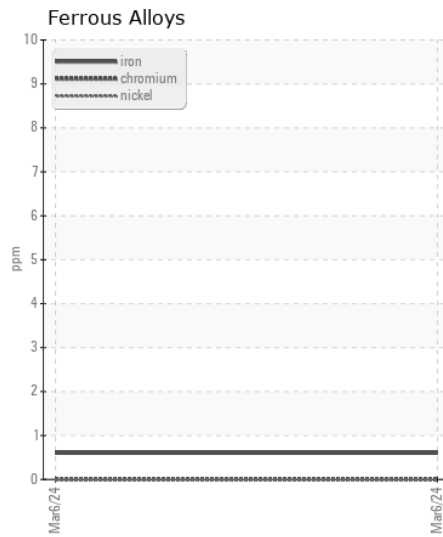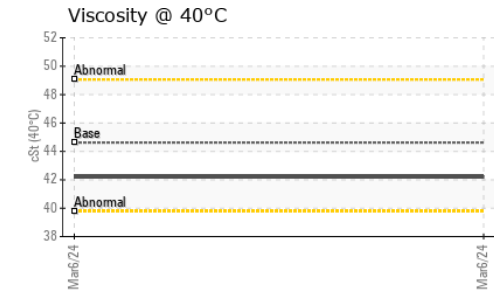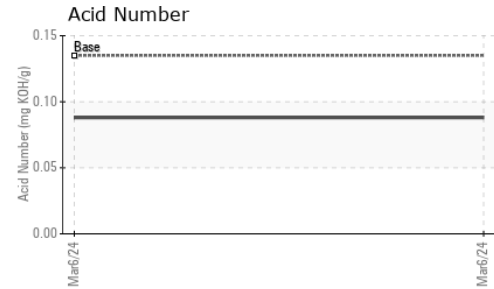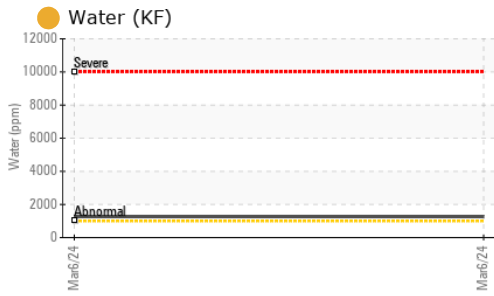

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCS06210258 **Received** : 14 Jun 2024
Lab Number : 06210258 **Tested** : 18 Jun 2024
Unique Number : 11083122 **Diagnosed** : 19 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF)

NORTHWEST COMPRESSOR
 29897 HWY 34 SW
 ALBANY, OR
 US 97321
 Contact: CRAIG WORLEY
 service@nwcompressor.com
 T: (541)752-5366
 F: (541)752-4716

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)