



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
GARDNER DENVER MARC 16
 Component
Air Compressor
 Fluid
DURALENE 600 20 ISO 68 (--- QTS)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0036706	DC0034579	DC0030036
Sample Date		Client Info		12 Jun 2024	07 Mar 2024	13 Dec 2023
Machine Age	mls	Client Info		0	0	0
Oil Age	mls	Client Info		0	0	0
Filter Age	mls	Client Info		0	0	0
Oil Changed		Client Info		Not Changed	Changed	Not Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	0	3
Chromium	ppm	ASTM D5185m	>4	<1	0	0
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	0	<1
Lead	ppm	ASTM D5185m	>20	<1	0	<1
Copper	ppm	ASTM D5185m	>40	2	3	3
Tin	ppm	ASTM D5185m	>5	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	0	<1	1
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water		WC Method	>0.6	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185m		0	2	1
Boron	ppm	ASTM D5185m		<1	0	<1
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		1	0	0
Calcium	ppm	ASTM D5185m		18	0	1
Phosphorus	ppm	ASTM D5185m		173	136	135
Zinc	ppm	ASTM D5185m		14	0	5
Sulfur	ppm	ASTM D5185m		7973	9000	7582
Visc @ 40°C	cSt	ASTM D445	65	64.3	67.7	67.4

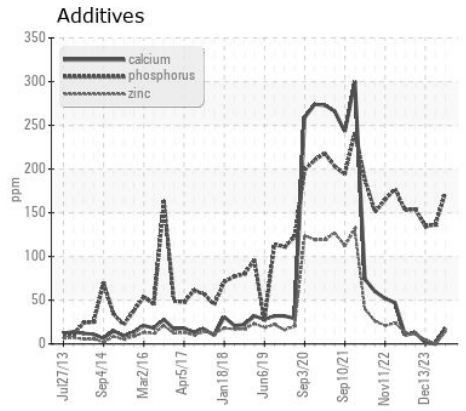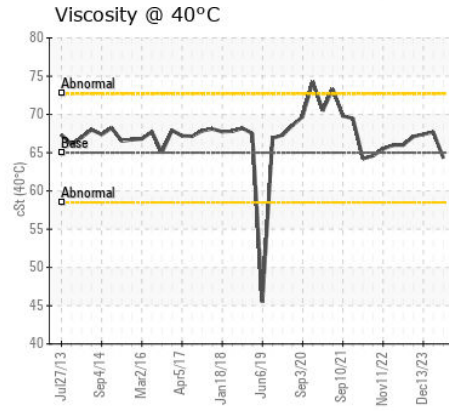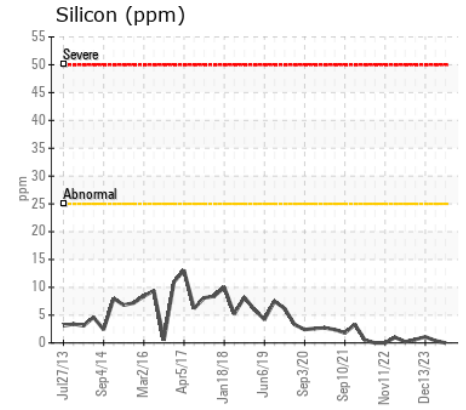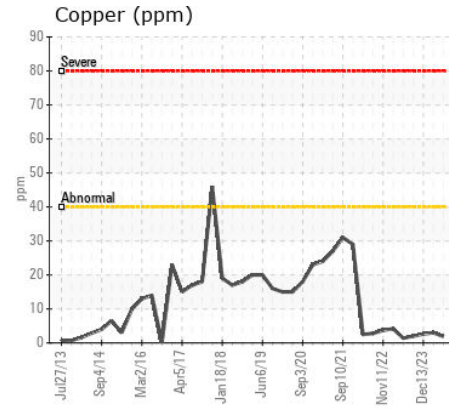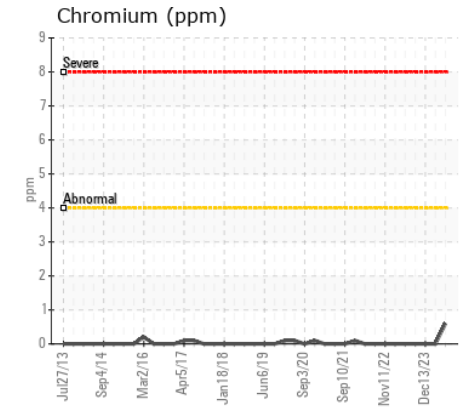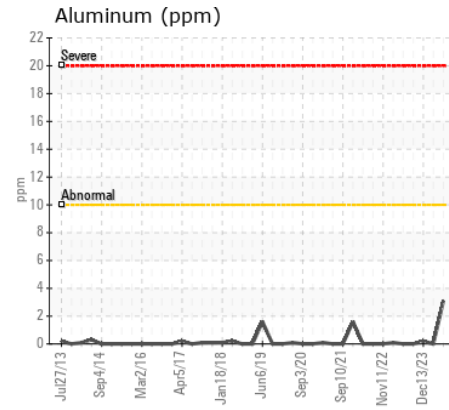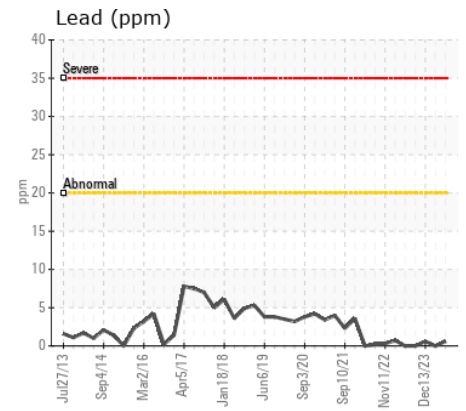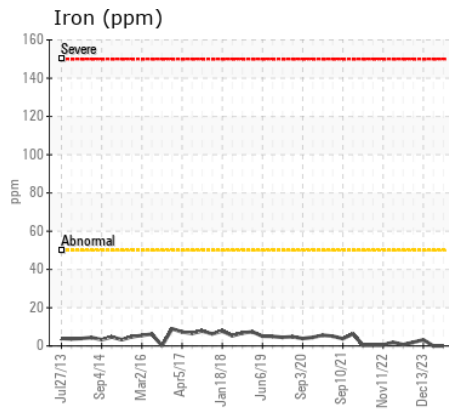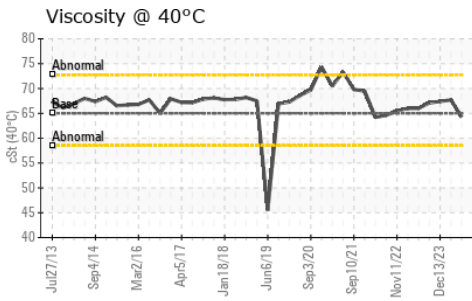

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0036706
Lab Number : 06210620
Unique Number : 11083484
Test Package : MOB 1

Received : 14 Jun 2024
Tested : 17 Jun 2024
Diagnosed : 17 Jun 2024 - Wes Davis

ALSTOM - BALTIMORE
 1600 LUDLOW ST
 BALTIMORE, MD
 US 21230

Contact: SEAN MCCARTY
 sean.mccarty@rail.bombardier.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: (443)220-0469