



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**PML-AB07-102**  
Machine Id  
**PML-AB07-102 (S/N ATL)**  
Component  
**Air Compressor**  
Fluid  
**ATLAS COPCO ROTO Z FLUID (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

## WEAR

All component wear rates are normal.







## CONTAMINATION

There is no indication of any contamination in the oil.

## FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>JIC0001147</b>	JIC0001140	JIC0001130
Sample Date		Client Info		<b>01 Jun 2024</b>	01 May 2024	02 Apr 2024
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL
Iron	ppm	ASTM D5185m	>70	<b>2</b>	2	<1
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>6	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	<1	0
Lead	ppm	ASTM D5185m	>20	<b>6</b>	6	<1
Copper	ppm	ASTM D5185m	>80	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silicon	ppm	ASTM D5185m	>12	<b>&lt;1</b>	2	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Sodium	ppm	ASTM D5185m		<b>0</b>	0	2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>&lt;1</b>	0	2
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m		<b>0</b>	4	2
Phosphorus	ppm	ASTM D5185m		<b>516</b>	439	433
Zinc	ppm	ASTM D5185m		<b>14</b>	9	2
Sulfur	ppm	ASTM D5185m		<b>622</b>	610	656
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.28</b>	0.30	0.27
Visc @ 40°C	cSt	ASTM D445		<b>66.8</b>	66.5	67.1

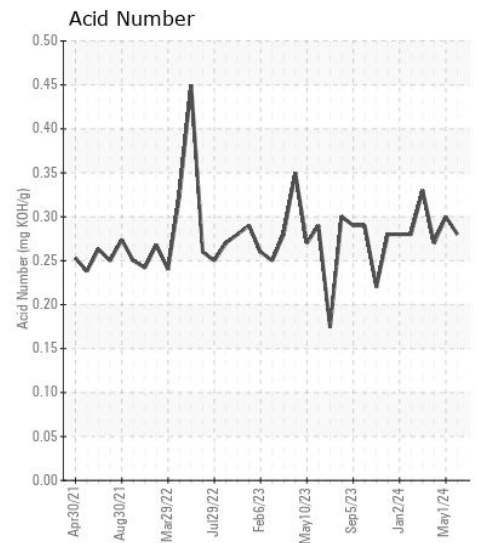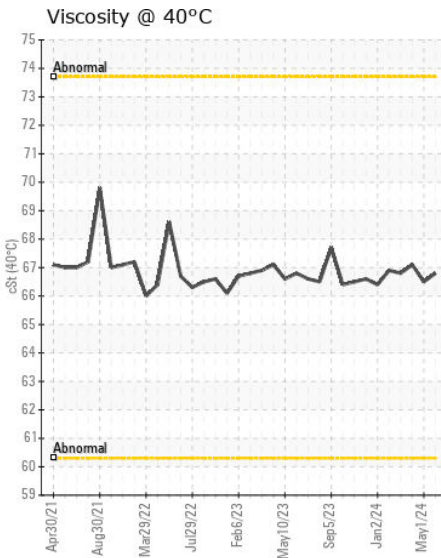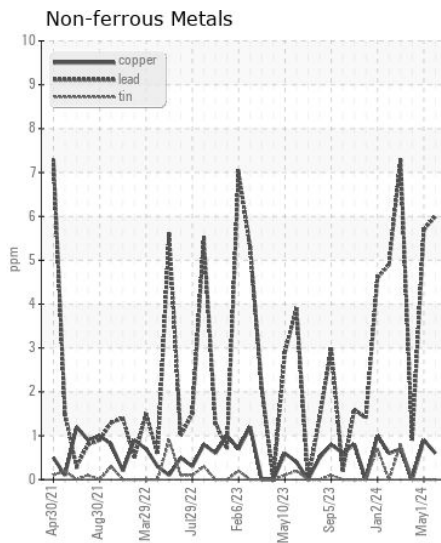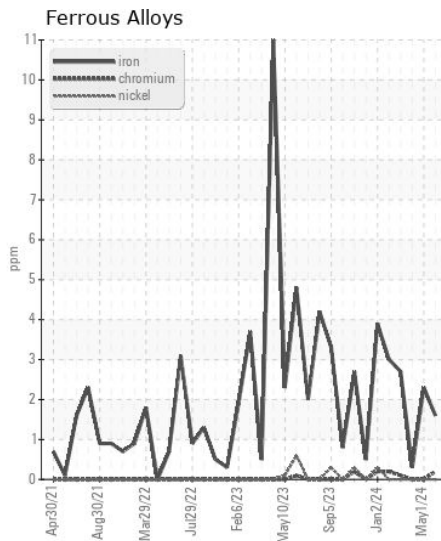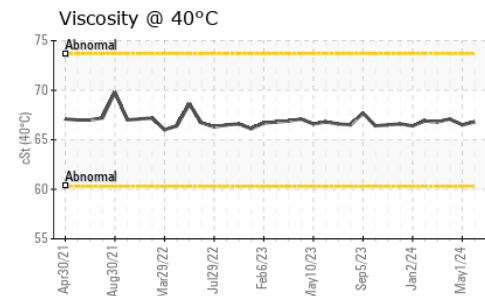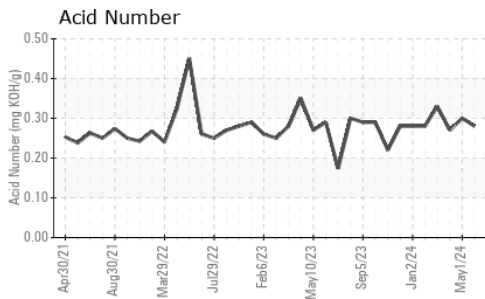

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : JIC0001147

**Lab Number** : 06210844

**Unique Number** : 11083708

**Test Package** : IND 2

**Received** : 14 Jun 2024

**Tested** : 18 Jun 2024

**Diagnosed** : 18 Jun 2024 - Sean Felton

**ABBVIE LTD UTILITES DIVISION**

ROAD NO 2 KM M59.2

BARCELONETA, PR

PR 00617

Contact: NOEL VALENTIN

noel.valentin@abbvie.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)