WEAR CONTAMINATION FLUID CONDITION

NORMAL NORMAL NORMAL


[20241449]


Cummins 1775 Wiehle Ave 100kw

Radiator Coolant

CONVENTIONAL COOLANT (10 GAL)

CONVENTIONAL COOLANT (10 GAL)							
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
The fluid is suitable for further service.	Sample Number		Client Info		DC0030638		
	Sample Date		Client Info		28 May 2024		
	Machine Age	yrs	Client Info		0		
	Oil Age	yrs	Client Info		0		
	Filter Age	yrs	Client Info		0		
	Oil Changed		Client Info		Not Changd		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
WEAR	Total Dissolved Solids				197.0		
	Coolant Appearance		*Visual	Clear	normal		
CONTAMINATION	Water		WC Method		NEG		
FLUID CONDITION nation in the coolant.	Boiling Point	°C	WC Method		226		
Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.	Specific Gravity		*ASTM D1298		1.070		
	рН	Scale 0-14	ASTM D1287		8.66		
	Nitrites	ppm	AP-053:2009		1124		
	Reserve Alkalinity	Scale 0-20	*ASTM D1121				
	Percentage Glycol	%	ASTM D3321		52.1		
	Freezing Point	°F	ASTM D3321		-40		
	Carboxylate				n/a		
	Coolant Color		*Visual		Pink		



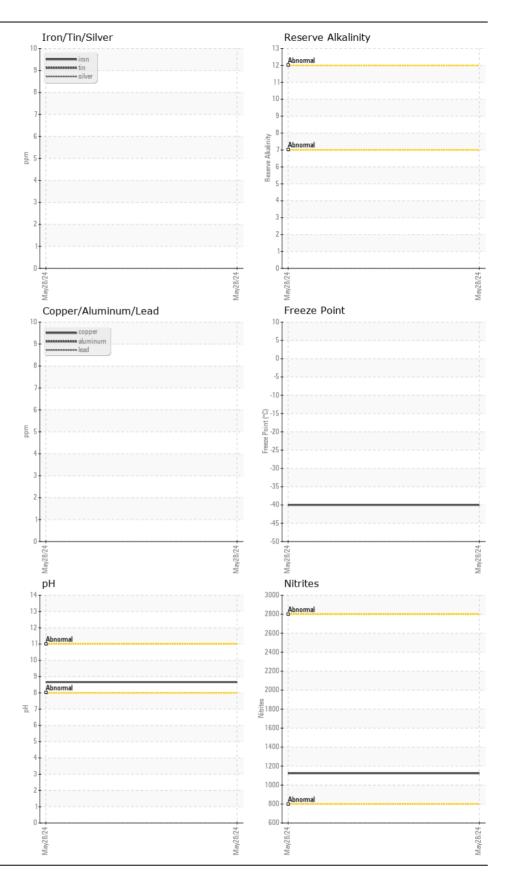



Certificate L2367

Laboratory Sample No.

: DC0030638 Lab Number : 06211196 Unique Number : 11084060

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 14 Jun 2024 **Tested**

Diagnosed

: 20 Jun 2024 : 20 Jun 2024 - Jonathan Hester Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

US 20706 Contact: E. NOEL enoel@phalconusa.com T: (240)623-4398

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F:

4600 HARGROVE DR

JE RICHARDS

LANHAM, MD