



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id  
**NOT GIVEN PE0004553**

Component  
**Bull Gear**

Fluid  
**{not provided} (--- GAL)**

**RECOMMENDATION**

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. We were unable to perform a particle count due to a high concentration of particles present in this sample.

**WEAR**

All component wear rates are normal.








**CONTAMINATION**

There is a moderate amount of visible silt present in the sample.

**FLUID CONDITION**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>PE0004553</b>	---	---
Sample Date		Client Info		<b>16 Jun 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Filter Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed		Client Info		<b>N/A</b>	---	---
Filter Changed		Client Info		<b>N/A</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---
PQ		ASTM D8184		<b>100</b>	---	---
Iron	ppm	ASTM D5185m	>150	<b>63</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>100	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>1</b>	---	---
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silicon	ppm	ASTM D5185m	>50	<b>7</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Water		WC Method	>0.1	<b>NEG</b>	---	---
Silt	scalar	*Visual	NONE	<b>▲ MODER</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	---	---
Sodium	ppm	ASTM D5185m		<b>2</b>	---	---
Boron	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>2</b>	---	---
Calcium	ppm	ASTM D5185m		<b>113</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>301</b>	---	---
Zinc	ppm	ASTM D5185m		<b>13</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>681</b>	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.46</b>	---	---
Visc @ 40°C	cSt	ASTM D445		<b>207</b>	---	---

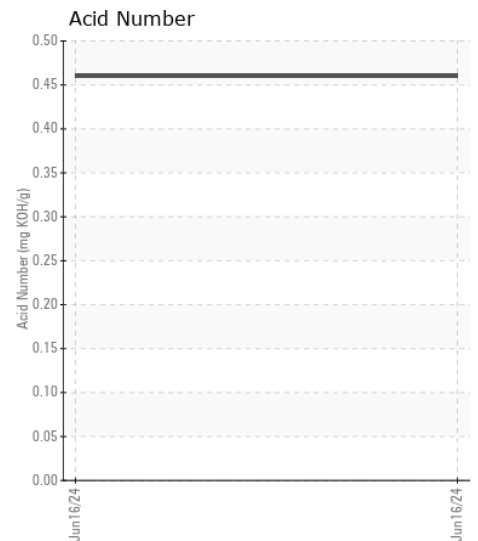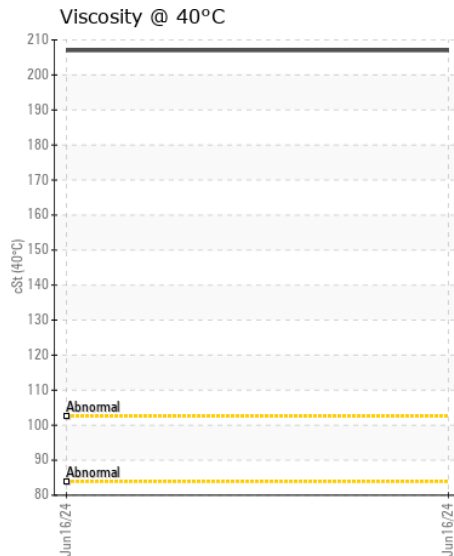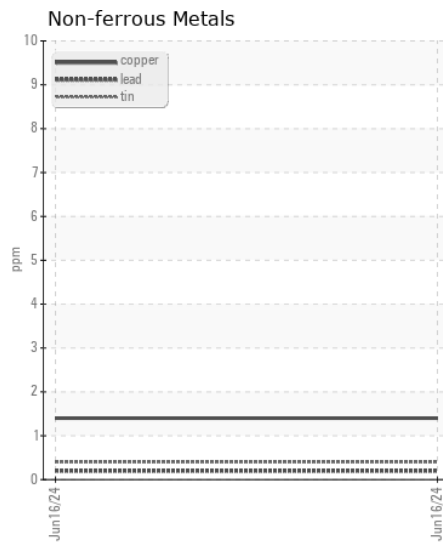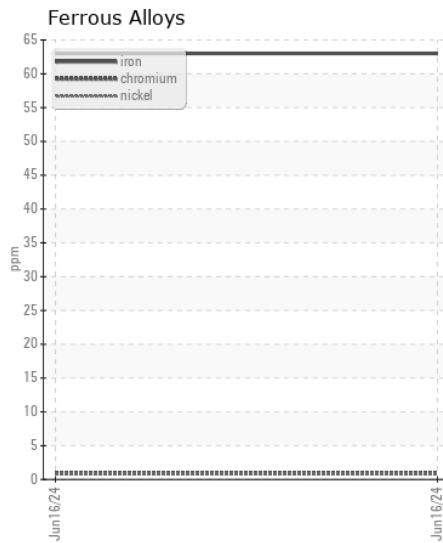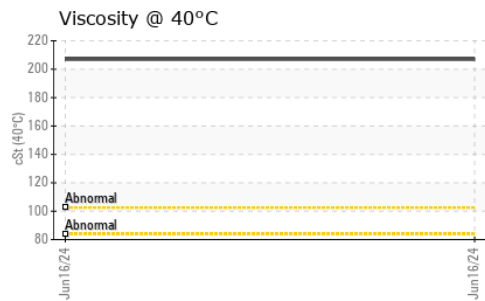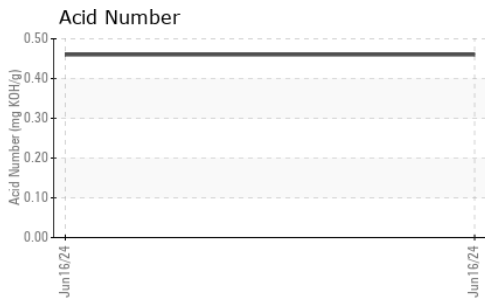

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PE0004553  
**Lab Number** : 06211480  
**Unique Number** : 11084344  
**Test Package** : PLANT ( Additional Tests: ICP, KV40, PQ, PrtCount, SCREEN )

**Received** : 17 Jun 2024  
**Tested** : 20 Jun 2024  
**Diagnosed** : 20 Jun 2024 - Jonathan Hester

**MCKINLEY PAPER COMPANY**  
 1902 MARINE DR  
 PORT ANGELES, WA  
 US 98363  
 Contact: JOSHUA HALL  
 joshua.hall@biopappel.com  
 T: (360)457-4474  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)