



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**PALEXTRA 44**  
Machine Id  
**SULLIVAN PALATEK 21CE001976 - KEN TOOL**  
Component  
**Compressor**

### RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>UCS06211806</b>	UCS05936790	---
Sample Date		Client Info		<b>06 Jun 2024</b>	17 Aug 2023	---
Machine Age	hrs	Client Info		<b>31465</b>	24407	---
Oil Age	hrs	Client Info		<b>2907</b>	5398	---
Filter Age	hrs	Client Info		<b>2907</b>	1751	---
Oil Changed		Client Info		<b>Not Changed</b>	Not Changed	---
Filter Changed		Client Info		<b>Changed</b>	Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

### WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>2</b>	0	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---

### CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>5</b>	4	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Water		WC Method	>0.1	<b>NEG</b>	NEG	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---

### FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>1</b>	0	---
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	0.3	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	0.3	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m	0.4	<b>&lt;1</b>	<1	---
Calcium	ppm	ASTM D5185m	0	<b>0</b>	<1	---
Phosphorus	ppm	ASTM D5185m	689	<b>537</b>	466	---
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m	1237	<b>891</b>	642	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.135	<b>0.21</b>	0.28	---
Visc @ 40°C	cSt	ASTM D445	44.62	<b>43.3</b>	44.6	---

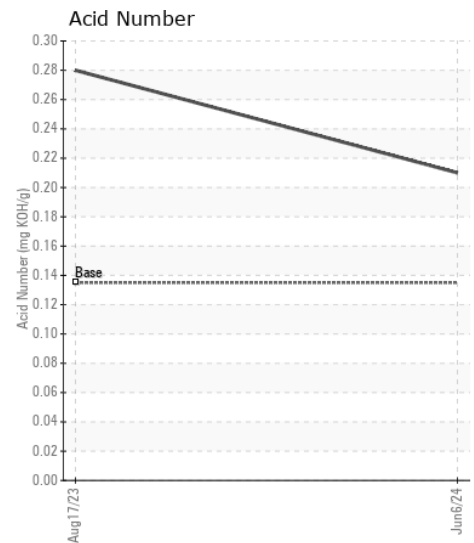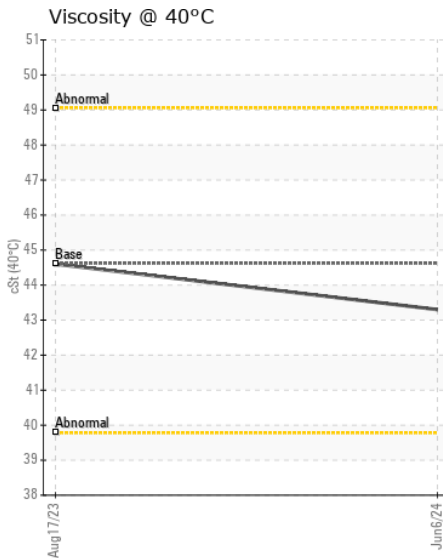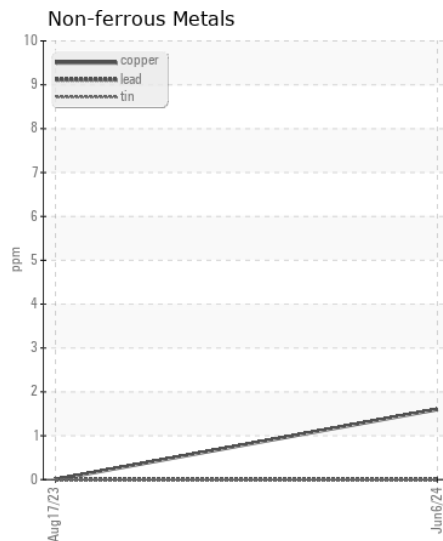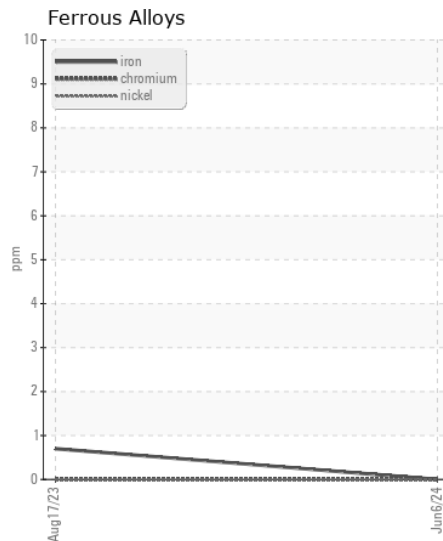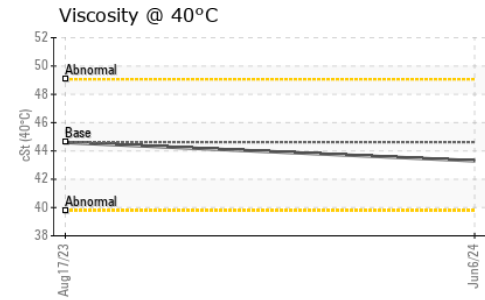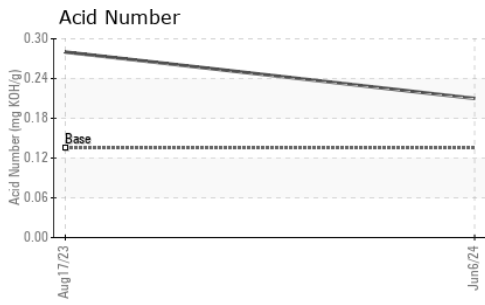

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06211806  
**Lab Number** : 06211806  
**Unique Number** : 11084670  
**Test Package** : IND 2

**Received** : 17 Jun 2024  
**Tested** : 18 Jun 2024  
**Diagnosed** : 18 Jun 2024 - Wes Davis

**TRI-STATE AIR COMPRESSOR**  
 10635 RAPP RD  
 MIDDLETOWN, OH  
 US 44442  
 Contact:  
 tristateaircompressor@gmail.com  
 T: (330)717-6507  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)