



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**A-C02**  
 Component  
**Compressor**  
 Fluid  
**{not provided} (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

## WEAR

All component wear rates are normal.











## CONTAMINATION

There is no indication of any contamination in the oil.

## FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>HPL0004586</b>	HPL0002703	HPL0002722
Sample Date		Client Info		<b>16 Jun 2024</b>	02 Jan 2024	21 Nov 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL
Iron	ppm	ASTM D5185m	>50	<b>4</b>	7	4
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m	>65	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>65	<b>30</b>	17	22
Tin	ppm	ASTM D5185m	>10	<b>3</b>	3	2
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silicon	ppm	ASTM D5185m	>35	<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	8
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Sodium	ppm	ASTM D5185m		<b>2</b>	1	2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>3</b>	<1	0
Calcium	ppm	ASTM D5185m		<b>3</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>162</b>	168	169
Zinc	ppm	ASTM D5185m		<b>8</b>	0	3
Sulfur	ppm	ASTM D5185m		<b>18663</b>	15955	15754
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.59</b>	0.50	0.50
Visc @ 40°C	cSt	ASTM D445		<b>106</b>	110	111

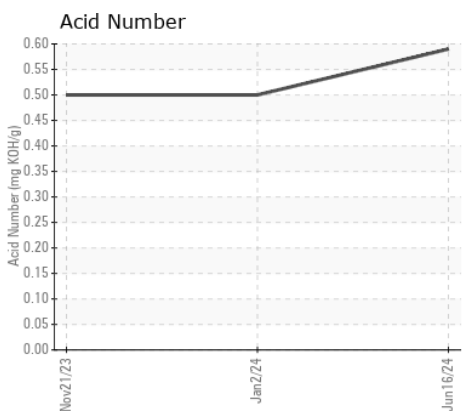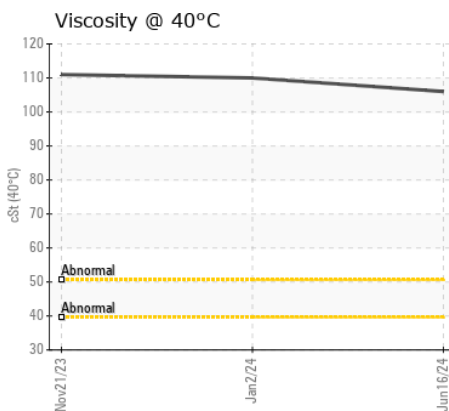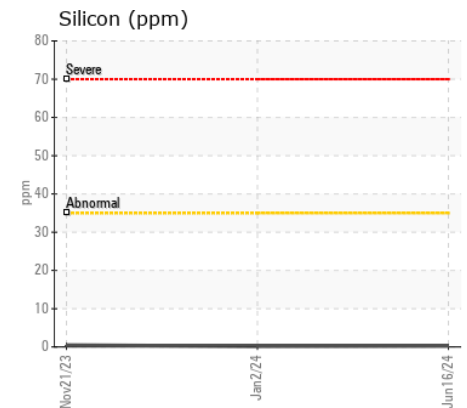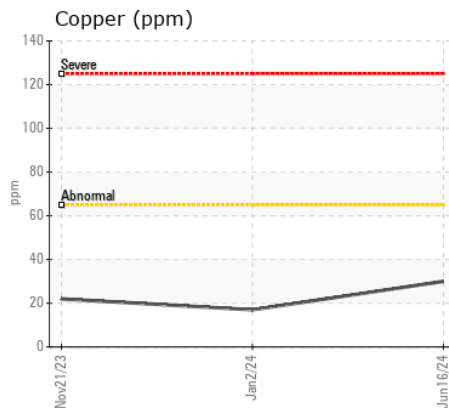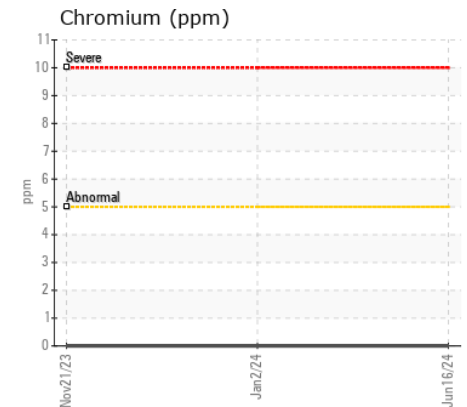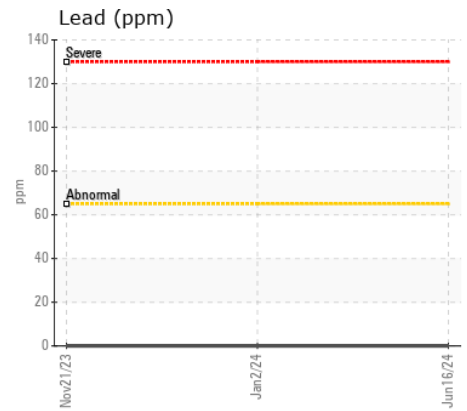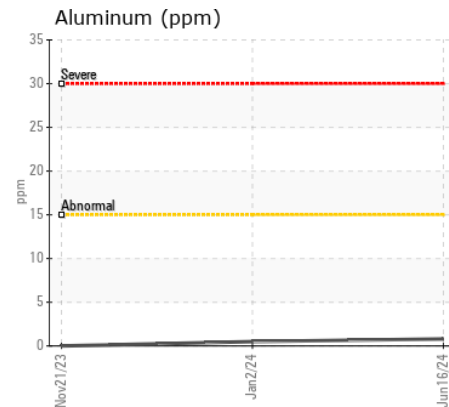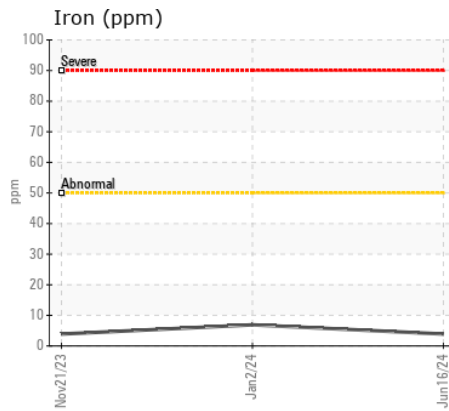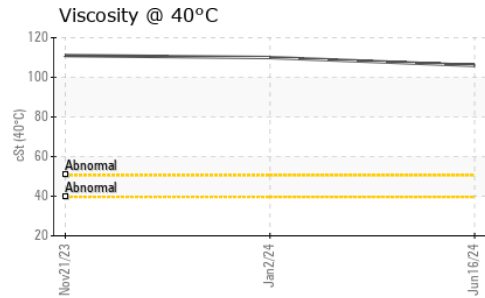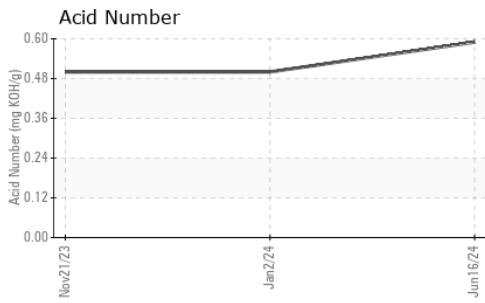

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HPL0004586  
**Lab Number** : 06211902  
**Unique Number** : 11084766  
**Test Package** : MOB 2

**Received** : 17 Jun 2024  
**Tested** : 18 Jun 2024  
**Diagnosed** : 18 Jun 2024 - Wes Davis

**EAST DUBUQUE NITROGEN PRODUCTS**  
 16675 HWY 20 WEST  
 EAST DUBUQUE, IL  
 US 61025  
 Contact: ABDUL QAYYUM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: (815)747-2175