



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
DC02
 Component
Compressor
 Fluid
GEAR OIL LS 80W90 (--- QTS)

RECOMMENDATION

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) GEAR OIL LS 80W90. Please confirm.

WEAR

All component wear rates are normal.











CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		HPL0004583	HPL0004643	HPL0002693
Sample Date		Client Info		16 Jun 2024	05 Mar 2024	29 Jan 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
Iron	ppm	ASTM D5185m	>50	2	3	3
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m		<1	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>15	<1	0	2
Lead	ppm	ASTM D5185m	>65	0	0	0
Copper	ppm	ASTM D5185m	>65	15	10	10
Tin	ppm	ASTM D5185m	>10	3	0	1
Vanadium	ppm	ASTM D5185m		0	0	<1
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185m	>35	<1	<1	<1
Potassium	ppm	ASTM D5185m	>20	2	0	1
Water		WC Method	>0.1	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Sodium	ppm	ASTM D5185m		2	<1	0
Boron	ppm	ASTM D5185m	150	0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	10	<1	0	2
Calcium	ppm	ASTM D5185m	70	17	0	<1
Phosphorus	ppm	ASTM D5185m	2000	154	188	199
Zinc	ppm	ASTM D5185m	50	4	0	0
Sulfur	ppm	ASTM D5185m	20000	18315	15684	16927
Acid Number (AN)	mg KOH/g	ASTM D8045		0.57	0.61	0.58
Visc @ 40°C	cSt	ASTM D445	140	120	105	105

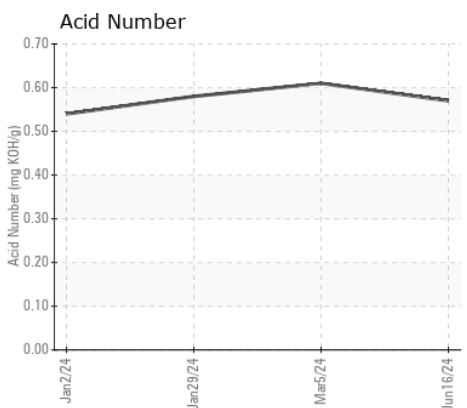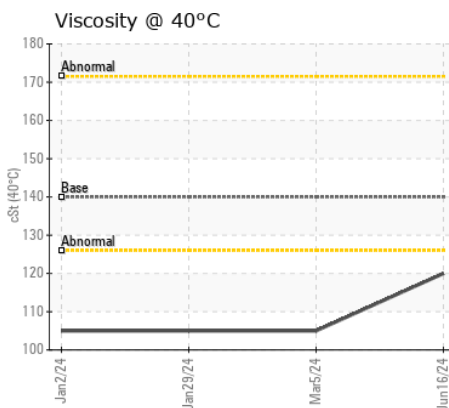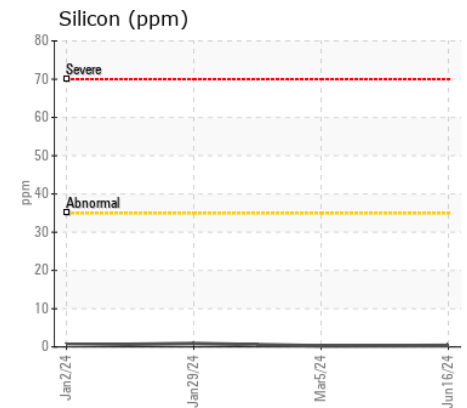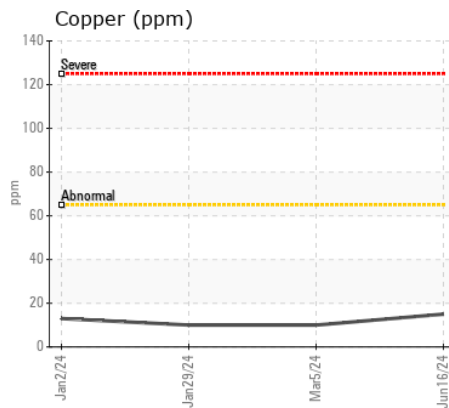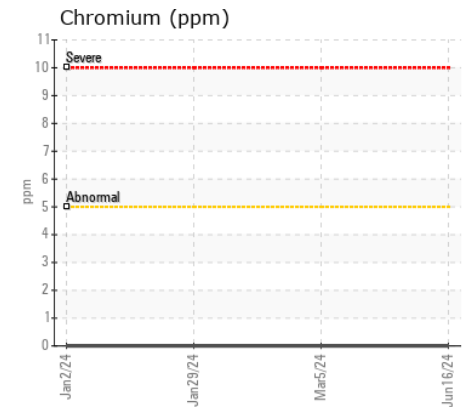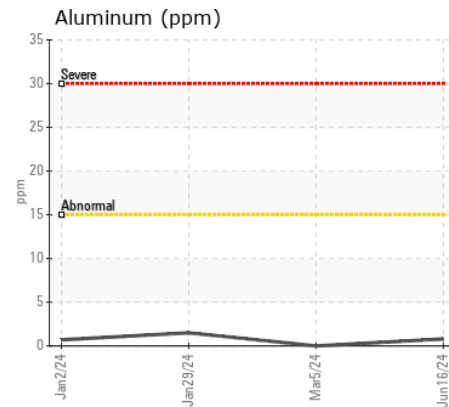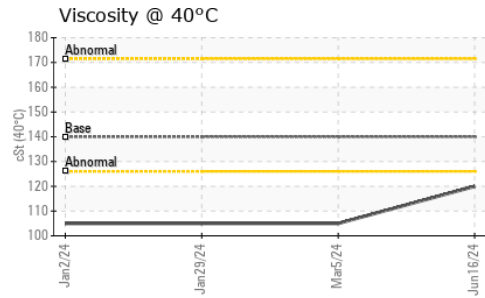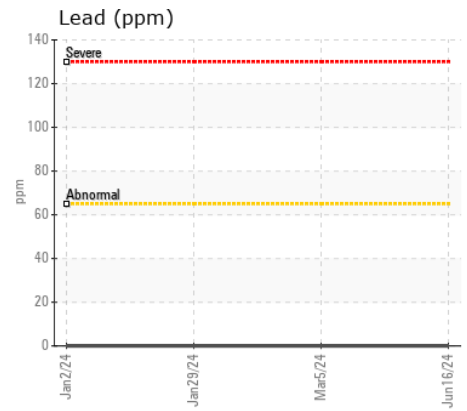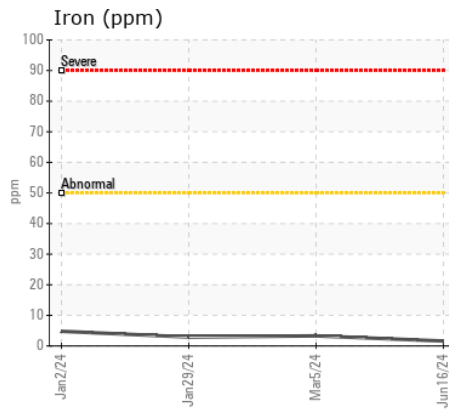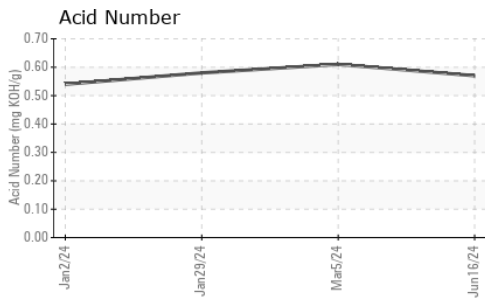

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : HPL0004583
Lab Number : 06211903
Unique Number : 11084767
Test Package : MOB 2

Received : 17 Jun 2024
Tested : 18 Jun 2024
Diagnosed : 18 Jun 2024 - Wes Davis

EAST DUBUQUE NITROGEN PRODUCTS
 16675 HWY 20 WEST
 EAST DUBUQUE, IL
 US 61025
 Contact: ABDUL QAYYUM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (815)747-2175
 F: (815)747-2175